

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS, DELHI FIRE SERVICE, CONNAUGHT PLACE
NEW DELHI-110001

No. F.6/DFS/MS/EH/SZ/2018/ 2615

Dated: 4/12/2018

FIRE SAFETY CERTIFICATE

Certified that M/S Jamie's Italian(A Unit of Dolomite Restaurant Pvt. Ltd.) located at T-301A, 3rd Floor Ambience Mall, Vasant Kunj, New Delhi.) comprised of Three basement, ground + three upper floor, owned/occupied by Dolomite Restaurant Pvt. Ltd. was granted FSC by this department vide letter No. F6/MS/DFS/EH/2015/SZ/1899 dated 23/10/2015. The restaurant was re-inspected by the officer concerned of this department on 15/11/2018 in the presence of Sh.Kunal Dewan and found that the said restaurant premises have deemed complied with the fire prevention and fire safety requirements in accordance with rule 33 of the Delhi Fire Service Rules, 2010 and that the premises fit for occupancy class "Assembly, Group-D" (Restaurant) with effect from 4/12/18 for a period of **three years** in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules, 2010.

Issued on 4/12/18 at New Delhi by


(Vipin Kental)
Chief Fire Officer
Ph: 011-23412225

Copy to: -

1. M/S Jamie's Italian(A Unit of Dolomite Restaurant Pvt. Ltd.) located at T-301A, 3rd Floor Ambience Mall, Vasant Kunj, New Delhi.)
2. The DHO (CNZ), South MCD, Health Department, Aurbindo marg, Green Park, New Delhi-110070.

Conditions for the validity of Fire Safety Certificate: -

1. All the means of escape/entry/exit shall be kept free from any obstruction.
2. All the fire safety arrangement provided therein shall be maintained in good working condition at all time as seen during inspection. Any loss of life property due to non-functional fire safety measures shall be at the responsibility of the management.
3. All the staff members must know the correct method of operation of fire fighting system.
4. The owner / occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on www.dfs.delhigovt.nic.in
5. This fire safety certificate may not in any way be treated as regularization (Clause 2.8 of UBBL-2016) of unauthorized construction or Alteration (Clause 1.4.3 of UBBL-2016), if any.
6. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in form 'J' [sub rule (I) of rule 37] along with a copy of this Certificate, six month prior to its expiry.

INSPECTION REPORT

1	Name & Address of the Building	M/s Jamie's Italian (A unit of Dolomite Restaurants Pvt. Ltd.)T-301, 3 rd Floor, Ambience Mall, Vasant Kunj, New Delhi-70		
2	Type of Occupancy	Assembly Building, (Restaurant)		
3	Building Comprised of	Three Basements + Ground + Three upper floor. (Restaurant at 3 rd floor).		
4	Type of Case	Renewal		
5	Details of Previous NOC	F6/DFS/MS/EH/2015/SZ/1899 dated 23-10-2015		
6	Fire Safety Directives Letter No	NIL		
7	Date of Inspection	15-11-2018		
8	Name of the Inspecting Officers	Mehmood, ADO (SJ)		
9	Name & Designation of Officers from the building side	Sh. Kunal Dewan, Head of Operation.		
10	Year of construction	2010		
11	Applicant letter No.	Outdoor Diary No. 15685 dated 26.10.2018		
S. No.	Minimum standards on Fire Prevention and Fire Safety U/R 33	Old NOC requirements	Provided at Site	Remarks MR/NMR
1	Access to Building.			
	• Road width	12 mtr	30 mtr	MR
	• Gate width	06 M	06 M	MR
	• Width of internal road	06 M	06 M	MR
2	Number, width, type & arrangement of exits.			
	a) Number of Staircase			
	➤ Upper floors.	02 Nos	02 Nos	MR
	➤ Basement floor.	-NA-	-NA-	-NA-
	b) Width of Staircase			
	➤ Upper floors	1.5m	1.5m (each)	MR
	➤ Basement floor	-NA-	-NA-	-NA-
	c) Protection of exits			
	➤ Fire check door	Required	Provided	MR
	➤ Pressurization	Required	Provided	MR
	d) No. of continuous staircase to terrace	Required	Provided by mall	MR
	e) Width of corridor	02 M	02 M	MR
	f) Door size	2m/90cm	1no=2m, 1no=90cm	MR
3	Compartmentation.			
	• Fire check door.	Required	Provided	MR
	• Sealing of electrical shafts.	Required	Provided	MR
	• Fire rating of shaft door.	01hr.	01hr.	MR
	• Water curtain	-NA-	-NA-	-NA-
	• Fire dampers.	Required	Provided	MR
4.	Smoke Management system.			
	• Basement	30 ACPH	Provided	MR
	• Upper floors	12 ACPH	Provided	MR
5.	Fire Extinguishers.			
	• Total numbers	08 Nos	Provided	MR
	• Types	ABC, Co2, WCo2	Provided	MR
	• ISI Marking	ISI marked	Provided	MR
6.	First Aid Hose Reels.			
	• Total numbers on each floor.	02 nos.	02 nos.	MR
	• Length of hose-reel hose.	30 mtr	30 mtr	MR
	• Nozzle Diameter	5 mm	5 mtr	MR

M/s Jamie's Italian (A unit of Dolomite Restaurants Pvt. Ltd.)T-301, 3rd Floor, Ambience Mall, Vasant Kunj, new delhi

7	Automatic fire detection & alarming system.			
	<ul style="list-style-type: none"> Type of detectors Location of Main Panel Location of Repeater Panel Alternate source of power Hooter's location 	Smoke & Heat	Smoke & Heat	MR
		Ground Floor	Ground Floor	MR
		FCR	FCR	MR
		Required	Provided	MR
		One each floor	Provided	MR
8.	MOEFA	Required	Provided	MR
9.	Public Address System	Required	Provided	MR
10.	Automatic Sprinkler System			
	<ul style="list-style-type: none"> Basement Upper floors Sprinkler above false ceiling 	-NA-	-NA-	-NA-
		Required	Provided	MR
		Required	Provided	MR
11.	Internal Hydrants.			
	<ul style="list-style-type: none"> Size of Riser/Down-comer Number of Hydrant per floor Hose box. 	100 mm	100 mm	MR
		02 nos.	02 nos.	MR
		02 nos.	02 nos.	MR
12.	Yard Hydrants.			
	<ul style="list-style-type: none"> Total number of hydrants. Hose box. 	-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
13.	Pumping arrangements.			
	<ul style="list-style-type: none"> Ground Level ➤ Discharge of main pump. ➤ Head of main pump. ➤ Number of main pumps. ➤ Jockey Pump output. ➤ Jockey Pump head. ➤ Standby Pump output. ➤ Standby Pump head. ➤ Auto Starting / Manual Stopping. ➤ Pump house access. 	2850 LPM(Two)	2850 LPM(Three)	MR
		70m(Two)	70m(Two)40m(1)	MR
		02	03 nos.	MR
		180 LPM(Two)	180 LPM(Two)	MR
		70m	70m	MR
		2850 LPM	2850 LPM	MR
		70m	70m	MR
		Required	Provided	MR
		Required	Provided	MR
	<ul style="list-style-type: none"> Terrace Level ➤ Discharge of pump. ➤ Head of pump. ➤ Power supply. ➤ Auto starting of pump. 	-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
14.	Captive water storage for fire fighting.			
	<ul style="list-style-type: none"> Underground tank capacity. ➤ Draw-off connection. ➤ Fire Service Inlet. ➤ Access to tank. Overhead tank capacity. 	2,00,000 Ltr	Provided	MR
		Required	Provided	MR
		Required	Provided	MR
		Required	Provided	MR
		20,000 Ltr	Provided	MR
15.	Exit Signage.	Required	Provided	MR
16.	Provision of Lifts.			
	<ul style="list-style-type: none"> Pressurization of lift shaft. Pressurization of lift lobby. Communication in lift car. Fireman's switch. Lift signage. 	Required	Provided	MR
		Required	Provided	MR
		Required	Provided	MR
		Required	Provided	MR
		Required	Provided	MR
17.	Standby Power Supply	Required	625 KVA(Two)	MR
18.	Refuge Area			
	<ul style="list-style-type: none"> Total area Location 	-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-

N/-7


19.	Fire Control Room.			
	• Detector system panel.	-NA-	-NA-	-NA-
	• Flow switch panel.	-NA-	-NA-	-NA-
	• PA system panel.	-NA-	-NA-	-NA-
	• Battery backup.	-NA-	-NA-	-NA-
	• Building floor plan.	-NA-	-NA-	-NA-
20.	Special Fire Protection System for the Protection of special Risk, if any.	-NA-	-NA-	-NA-

The fire protection system provided in the building/ premises were tested, checked at random and found functional at the time of inspection.

Keeping in view of the deemed compliance of the minimum standards of fire prevention and fire safety measures as required under the rules, the FSC issued vide letter No. F.6/DFS/MS/EH/2015/52/1899 dated 23/10/2015, renewal under rule 35 of the Delhi Fire Service Rules 2010, is recommended.

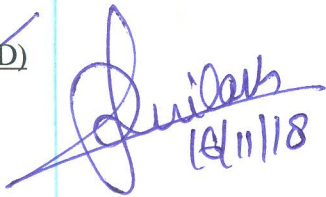
Accordingly DFA is put up for approval and signature please.

x


 Signature of the Inspecting Officer
 Name: Mehmood
 Design: ADO (SJ)

M/s Jamie's Italian (A unit of Dolomite Restaurants Pvt. Ltd.)T-301, 3rd Floor, Ambience Mall, Vasant Kunj, new delhi

DO (SD)


14/11/18



15/11/18


16/11




M.Scell


FTM.


22/11/18


220/cf/s2
21/12

A.D.T. letter put up for signature please


28/11/18
ADO (SJ)



M.Scell


29/11/18

