

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE: NEW DELHI- 110001
Fax No. 011-23412593, Ph. 011-23412225

No. F.6/DFS/MS/School/2018/SZ/ 16

Dated: 3.1.19

FIRE SAFETY CERTIFICATE

Certified that the Aryan Vidya Niketan located at D-56-57, Chhattarpur Extn., New Delhi-110074, comprised of ground floor only was inspected by the officer concerned of this department on 12/12/2018 in presence of Mr. Shyam Babu Sharma (Manager) of the school and found that said premises have complied with the fire prevention and fire safety arrangements in accordance with Directorate of Education Circular F.16//Estate/CC/Fire Safety/2011/3298 to 3398 dated 01.03.2011 issued by Director of Education, Govt. of NCT of Delhi and that the building is fit for occupancy class "Educational Building" Group-B, as above with effect from the date of issue of this certificate for a period of **Three years** in accordance with DOE circular dated 01.03.2011 subject to the condition mentioned below.

Issued on ..3.1.19.....at New Delhi by

Vipin Kental
Chief Fire Officer

Copy to: -

1. The Principal, Aryan Vidya Niketan, D-56-57, Chhattarpur Extn., New Delhi-110074
2. The Director of Education, Govt. of NCT of Delhi, Old Secretariat, New Delhi.

Conditions for the validity of Fire Safety Certificate

1. All the fire safety and means of escape facilities shall be maintained in good working condition at all time. Any lapse rendering the fire safety or means of evacuation facilities non-functional shall be the responsibility of the management.
2. Building Sanctioning authority may verify any deviation with regard to construction/occupancy in the building. In case of any deviation, the fire safety certificate stands null & void.
3. The staff shall be trained for operating fire fighting system and mock evacuation drill be conducted at regular interval and record be maintained.
4. This Certificate cannot be treated as regularization of unauthorized construction, if any.
5. The Owner/Occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rules, 2010. The form is available on www.dfs.delhigovt.nic.in.
6. The Owner/Occupier shall apply for renewal of this Fire Safety Certificate to the Director in the form 'J' [sub rule (1) of rule 37] along with copy of this certificate, six months prior to its expiry. The form is available on www.dfs.delhigovt.nic.in.

INSPECTION REPORT

1	Name & Address of the Building	Aryan Vidya Niketan, D-56-57, Chhattarpur Extn, New Delhi-110074		
2	Type of Occupancy	Educational, Group-B (School)		
3	Building Comprised of	Ground floor only		
4	Type of Case	New		
5	Details of Previous NOC	Nil		
6	Fire Safety Directives Letter No	F.16//Estate/CC/Fire Safety/2011/3298 to 3398 dated 01.03.2011		
7	Date of Inspection	12-12-2018		
8	Name of the Inspecting Officers	Mehmood, ADO (SJ)		
9	Name & Designation of Officers from the building side	Mr. Shyam Babu Sharma (Manager)		
10	Year of construction	2010		
11	Applicant letter No.	AVN/11/2018 dated 02/11/2018		
S. No.	Minimum standards on Fire Prevention and Fire Safety U/R 33	DOE Circular	Provided at Site	Remarks MR/NMR
1	Access to Building.			
	<ul style="list-style-type: none"> • Road width • Gate width • Width of internal road 	6 mtr -NA- -NA-	Provided -NA- -NA-	MR -NA- -NA-
2	Number, width, type & arrangement of exits.			
	a) Number of Staircase			
	➤ Upper floors.	-NA-	-NA-	-NA-
	➤ Basement floor.	-NA-	-NA-	-NA-
	b) Width of Staircase			
	➤ Upper floors	-NA-	-NA-	-NA-
	➤ Basement floor	-NA-	-NA-	-NA-
	c) Protection of exits			
	➤ Fire check door	-NA-	-NA-	-NA-
	➤ Pressurization	-NA-	-NA-	-NA-
	d) No. of continuous staircase to terrace	-NA-	-NA-	-NA-
	e) Width of corridor	-NA-	-NA-	-NA-
	f) Door size	1m	Provided	MR
3	Compartmentation.			
	<ul style="list-style-type: none"> • Fire check door. • Sealing of electrical shafts. • Fire rating of shaft door. • Water curtain • Fire dampers. 	-NA- -NA- -NA- -NA- -NA-	-NA- -NA- -NA- -NA- -NA-	-NA- -NA- -NA- -NA- -NA-
4.	Smoke Management system.			
	<ul style="list-style-type: none"> • Basement • Upper floors 	30 ACPH 12 ACPH	-NA- -NA-	-NA- -NA-
5.	Fire Extinguishers.			
	<ul style="list-style-type: none"> • Total numbers • Types • ISI Marking 	10 Nos ABC / CO2 ISI marked	10 Nos ABC & Co2 Provided	MR MR MR
6.	First Aid Hose Reels.			
	<ul style="list-style-type: none"> • Total numbers on each floor. • Length of hose-reel hose. • Nozzle Diameter 	-NA- -NA- -NA-	-NA- -NA- -NA-	-NA- -NA- -NA-


7.	Automatic fire detection & alarming system.			
	<ul style="list-style-type: none"> Type of detectors Location of Main Panel Location of Repeater Panel Alternate source of power Hooter's location 	-NA-	-NA-	-NA-
8.	MOEFA	-NA-	-NA-	-NA-
9.	Public Address System	-NA-	-NA-	-NA-
10.	Automatic Sprinkler System			
	<ul style="list-style-type: none"> Basement Upper floors Sprinkler above false ceiling 	-NA-	-NA-	-NA-
11.	Internal Hydrants.			
	<ul style="list-style-type: none"> Size of Riser/Down-comer Number of Hydrant per floor Hose box. 	-NA-	-NA-	-NA-
12.	Yard Hydrants.			
	<ul style="list-style-type: none"> Total number of hydrants. Hose box. 	-NA-	-NA-	-NA-
13.	Pumping arrangements.			
	<ul style="list-style-type: none"> Ground Level <ul style="list-style-type: none"> Discharge of main pump. Head of main pump. Number of main pumps. Jockey Pump output. Jockey Pump head. Standby Pump output. Standby Pump head. Auto Starting / Manual Stopping. Pump house access. Terrace Level <ul style="list-style-type: none"> Discharge of pump. Head of pump. Power supply. Auto starting of pump. 	-NA-	-NA-	-NA-
14.	Captive water storage for fire fighting.			
	<ul style="list-style-type: none"> Underground tank capacity. <ul style="list-style-type: none"> Draw-off connection. Fire Service Inlet. Access to tank. Overhead tank capacity. 	-NA-	-NA-	-NA-
15.	Exit Signage.	Required	Provided	MR
16.	Provision of Lifts.			
	<ul style="list-style-type: none"> Pressurization of lift shaft. Pressurization of lift lobby. Communication in lift car. Fireman's switch. Lift signage. 	-NA-	-NA-	-NA-
17.	Standby Power Supply	-NA-	-NA-	-NA-
18.	Refuge Area			
	<ul style="list-style-type: none"> Total area Location 	-NA-	-NA-	-NA-

19.	Fire Control Room.			
	• Detector system panel.	-NA-	-NA-	-NA-
	• Flow switch panel.	-NA-	-NA-	-NA-
	• PA system panel.	-NA-	-NA-	-NA-
	• Battery backup.	-NA-	-NA-	-NA-
	• Building floor plan.	-NA-	-NA-	-NA-
20.	Special Fire Protection System for the Protection of special Risk, if any.	-NA-	-NA-	-NA-

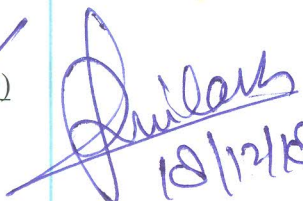
The Fire protection systems provided in the building were randomly tested, checked and found functional at the time of inspection.

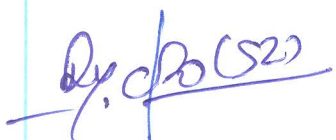
Keeping in view the substantial compliance of the minimum standards on fire prevention and fire safety measures as required under the rule, it is recommended to grant Fire Safety Certificate under rule 35 of the Delhi Fire Service Rules, 2010.

Accordingly DFA is put up for approval and signature please.


 Signature of the Inspecting Officer
 Name: Mehmood
 Design: ADO (SJ)

DO (SD)

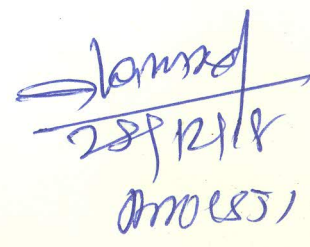

18/12/18





A. S. J. Datta


19/12

 M.Sc.ell
 M.Sc.ell
 RTD. 27/12

A. S. J. Datta letter put up for signature please


 28/12/18
 ADO (SJ)

 M.Sc.ell
 M.Sc.ell
 2/1/19.



28/12/18
3/1/19