

**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE: CONNAUGHT PLACE
NEW DELHI-110001**

No. F.6/DFS/MS/GH/SZ/2019/ 127

Dated: 18/1/19..

FIRE SAFETY CERTIFICATE

Certified that Guest House in the name & style of M/s **Hotel Olive** at A-406, Block-A, Road No-4, Street No-8, Mahipalpur Extn., New Delhi-110037 comprised of basement (parking), ground floor (Rec. & small kitchen), 1st Floor (07 guest rooms & office), 2nd Floor (07 guest rooms & office), 3rd Floor (12 guest rooms) and 4th Floor (owners residence), total 26 guest rooms have complied with the fire prevention and fire safety requirements in accordance with rule 33 of the Delhi Fire Service Rules, 2010 and verified by the officer concerned of this department on 09/01/2019 in the presence of Mr. Kuldeep Sehrawat (Proprietor) of the guest house and that the premises is fit for occupancy class "**Residential, Group-A**" (Lodging or Rooming House) as above with effect from the date of issue of this certificate for a period of **Three years** in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules, 2010

Issued 18/1/19 at New Delhi by

17/1
(Vipin Kental)
Chief Fire Officer
Ph. 011-23412225


Copy to: -

1. DHO, South MCD, Public Health Department, Najafgarh Zone, Dhansa Stand, Najafgarh, New Delhi-110043
2. Proprietor M/s Hotel Olive at A-406 Block-A, Road No-4, Street No-8, Mahipalpur Extn., New Delhi-110037

Conditions for the validity of Fire Safety Certificate: -


1. All the means of escape/entry/exit shall be kept free from any obstruction.
2. All the fire safety arrangement provided therein shall be maintained in good working condition at all time as seen during inspection. Any loss of life property due to non-functional fire safety measures shall be at the responsibility of the management.
3. All the staff members must know the correct method of operation of fire fighting system.
4. The owner/occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on www.dfs.delhigovt.nic.in
5. This fire safety certificate may not in any way be treated as regularization (Clause 2.8 of UBBL-2016) of unauthorized construction or alteration (Clause 1.4.3 of UBBL-2016), if any.
6. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in form 'J' [sub rule (I) of rule 37] along with a copy of this Certificate, six month prior to its expiry.

INSPECTION REPORT				
1	Name & Address of the Building	M/s Hotel Olive at A-406, Block-A, Road No-4, Street No-8, Mahipalpur Extn, New Delhi-110037		
2	Type of Occupancy	Residential, Group-A (Lodging or Rooming House)		
3	Building Comprised of	Basement, Ground + 04 upper floors.		
4	Type of Case	New		
5	Details of Previous NOC	Nil		
6	Fire Safety Directives Letter No	Nil		
7	Date of Inspection	09-01-2019		
8	Name of the Inspecting Officers	Mehmood, ADO (SJ)		
9	Name & Designation of Officers from the building side	Mr. Kuldeep Sehrawat (Prop.)		
10	Year of construction	2009	Basement (Parking), Gd. floor (Rec. & small kitchen), 1 st floor (07 guest rooms & office), 2 nd floor (07 guest rooms & office), 3 rd floor (12 guest rooms) and 4 th floor (Owners residence) Total- 26 Guest Rooms	
11	Applicant letter No.	Outdoor diary No. 18811 dated 17-12-2018		
S. No.	Minimum standards on Fire Prevention and Fire Safety U/R 33	NBC / BBL Requirement	Provided at Site	Remarks MR/NMR
1	Access to Building.			
	• Road width	6 mtr	Provided	MR
	• Gate width	-NA-	-NA-	-NA-
	• Width of internal road	-NA-	-NA-	-NA-
2	Number, width, type & arrangement of exits.			
	a) Number of Staircase			
	➤ Upper floors.	01 No	02 Nos	MR
	➤ Basement floor.	02 Nos	01 No + 01 ramp	MR
	b) Width of Staircase			
	➤ Upper floors	1.25 mtr	1.50m & 1.25m	MR
	➤ Basement floor	1.25 mtr	1.25m & 2.5m ramp	MR
	c) Protection of exits			
	➤ Fire check door	-NA-	-NA-	-NA-
	➤ Pressurization	-NA-	-NA-	-NA-
	d) No. of continuous staircase to terrace	One	Provided	MR
	e) Width of corridor	-NA-	-NA-	-NA-
	f) Door size	1m	2m (final exit)	MR
3	Compartmentation.			
	• Fire check door.	-NA-	-NA-	-NA-
	• Sealing of electrical shafts.	Required	Provided	MR
	• Fire rating of shaft door.	-NA-	-NA-	-NA-
	• Water curtain	-NA-	-NA-	-NA-
	• Fire dampers.	-NA-	-NA-	-NA-
4	Smoke Management system.			
	• Basement	30 ACPH	Exhaust fan provided	MR
	• Upper floors	12 ACPH	Natural ventilation	MR
5	Fire Extinguishers.			
	• Total numbers	10 Nos	Provided	MR
	• Types	ABC / CO2	ABC type	MR
	• ISI Marking	ISI marked	Provided	MR
6	First Aid Hose Reels.			
	• Total numbers on each floor.	One	Provided	MR
	• Length of hose-reel hose.	30 mtr	Provided	MR
	• Nozzle Diameter	5 mm	Provided	MR

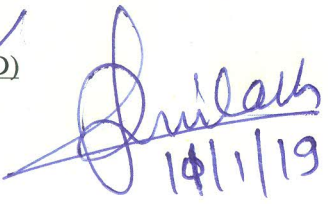
M/s Hotel Olive at A-406, Block-A, Road No-4, Street No-8, Mahipalpur Extn, New Delhi

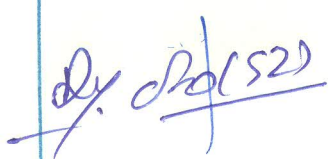
7	Automatic fire detection & alarming system.			
	<ul style="list-style-type: none"> Type of detectors Location of Main Panel Location of Repeater Panel Alternate source of power Hooter's location 	-NA-	-NA-	-NA-
8	MOEFA	Required	Provided	MR
9	Public Address System	-NA-	-NA-	-NA-
10	Automatic Sprinkler System			
	<ul style="list-style-type: none"> Basement Upper floors Sprinkler above false ceiling 	Required	Provided	MR
11	Internal Hydrants.			
	<ul style="list-style-type: none"> Size of Riser/Down-comer Number of Hydrant per floor Hose box. 	-NA-	-NA-	-NA-
12	Yard Hydrants.			
	<ul style="list-style-type: none"> Total number of hydrants. Hose box. 	-NA-	-NA-	-NA-
13	Pumping arrangements.			
	<ul style="list-style-type: none"> Ground Level <ul style="list-style-type: none"> Discharge of main pump. Head of main pump. Number of main pumps. Jockey Pump output. Jockey Pump head. Standby Pump output. Standby Pump head. Auto Starting/Manual Stopping. Pump house access. Terrace Level <ul style="list-style-type: none"> Discharge of pump. Head of pump. Power supply. Auto starting of pump. 	-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		900 LPM	900 LPM	MR
		40 mtr	40 mtr	MR
		Required	Provided	MR
		Required	Provided	MR
14	Captive water storage for fire fighting.			
	<ul style="list-style-type: none"> Underground tank capacity. <ul style="list-style-type: none"> Draw-off connection. Fire Service Inlet. Access to tank. Overhead tank capacity. 	-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		10,000 Ltr	10,000 Ltr	MR
15	Exit Signage.	Required	Provided	MR
16	Provision of Lifts.			
	<ul style="list-style-type: none"> Pressurization of lift shaft. Pressurization of lift lobby. Communication in lift car. Fireman's switch. Lift signage. 	-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
17	Standby Power Supply	Required	Provided	MR
18	Refuge Area			
	<ul style="list-style-type: none"> Total area Location 	-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-

M/s Hotel Olive at A-406, Block-A, Road No-4, Street No-8, Mahipalpur Extn, New Delhi

19	Fire Control Room.			
	• Detector system panel.	-NA-	-NA-	-NA-
	• Flow switch panel.	-NA-	-NA-	-NA-
	• PA system panel.	-NA-	-NA-	-NA-
	• Battery backup.	-NA-	-NA-	-NA-
	• Building floor plan.	-NA-	-NA-	-NA-
20	Special Fire Protection System for the Protection of special Risk, if any.			-NA-
<p>The fire protection systems provided in the premises were test checked at random and found functional at the time of inspection. Keeping in view of the substantially satisfactory compliance of the minimum standards on fire prevention and fire safety measures as required under the rules, it is recommended to issue Fire Safety Certificate under Rule 35 of the Delhi Fire Service Rules, 2010.</p> <p>Accordingly DFA is put up for approval and signature please.</p> <p style="text-align: right;">  Signature of the Inspecting Officer Name: Mehmood Design: ADO (SJ) </p>				

M/s Hotel Olive at A-406, Block-A, Road No-4, Street No-8, Mahipalpur Extn, New Delhi

DO (SD)

 14/1/19


 14/1/19



 14/1/19


366/cfo/s2
 16/1/19-18/1/19



CFOS 24
 m.s cell
 FTB.

 15/1/19

A S.T. letter put up for signature please

 16/1/19


 m.s cell

 17/1/19