

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE: CONNAUGHT PLACE
NEW DELHI-110001

No. F.6/DFS/MS/School/2018/SZ/ 185

Dated: 25/11/19

FIRE SAFETY CERTIFICATE

Certified that **The Heritage School** located at D-2, Vasant Kunj, New Delhi-110070, comprised of basement, ground plus three upper floors, owned/occupied by The Heritage School was issued FSC by this department vide letter No. F6/DFS/MS/School/2015/SZ/1982 dated 04/11/2015. The premises was re-inspected by officer concerned of this department on 14/12/2018 in presence of Mr. Arun Kr. Singh (Maintenance In-charge) and observed that the school building have deemed complied with the fire prevention and fire safety requirements in accordance with rule 33 of the Delhi Fire Service Rules, 2010 and that the school building is fit for occupancy class "**Educational Building**" Group-B, as above with effect from the date of issue of this certificate for a period of **Three years** in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules, 2010.

Issued on 25/11/19 at New Delhi by

(Vipin Kental)
Chief Fire Officer
Ph: 011-23412225

Copy to: -

1. Principal, The Heritage School located at D-2, Vasant Kunj, New Delhi-110070
2. Directorate of Education, Govt. of NCT of Delhi, Old Secretariat, New Delhi-110054

Conditions for the validity of Fire Safety Certificate: -


1. All the means of escape/entry/exit shall be kept free from any obstruction.
2. All the fire safety arrangement provided therein shall be maintained in good working condition at all time as seen during inspection. Any loss of life property due to non-functional fire safety measures shall be at the responsibility of the management.
3. All the staff members must know the correct method of operation of fire fighting system.
4. The owner/occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on www.dfs.delhigovt.nic.in
5. This fire safety certificate may not in any way be treated as regularization (Clause 2.8 of UBBL-2016) of unauthorized construction or alteration (Clause 1.4.3 of UBBL-2016), if any.
6. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in form 'J' [sub rule (I) of rule 37] along with a copy of this Certificate, six month prior to its expiry.

INSPECTION REPORT

S. No.	Minimum standards on Fire Prevention and Fire Safety U/R 33	Old NOC Requirement	Provided at Site	Remarks MR/NMR
1	Name & Address of the Building	THE HERITAGE SCHOOL, D-2 Vasant Kunj, New Delhi-110070		
2	Type of Occupancy	Educational, Group-B (School)		
3	Building Comprised of	Basement, Ground + 03 upper floors.		
4	Type of Case	Renewal		
5	Details of Previous NOC	F6/DFS/MS/School/2015/SZ/1982 Dated 04-11-2015		
6	Fire Safety Directives Letter No	F6/DFS/MS/BP/98/2172 Dated 27-10-1998 and F6/DFS/MS/BP/2014/05 Dated 07-01-2014		
7	Date of Inspection	14/12/2018		
8	Name of the Inspecting Officers	Mehmood, ADO (SJ)		
9	Name & Designation of Officers from the building side	Mr. Arun Kr. Singh (Maintenance In-charge)		
10	Year of construction	1999 & 2014		
11	Applicant letter No.	Outdoor Diary No. 15799 dated 29-10-2018		
1	Access to Building.			
	• Road width	6 mtr	Provided	MR
	• Gate width	Required	5 mtr	MR
	• Width of internal road	-NA-	-NA-	-NA-
2	Number, width, type & arrangement of exits.			
	a) Number of Staircase			
	➤ Upper floors.	03 Nos	Provided	MR
	➤ Basement floor.	03 Nos	03 Nos + 01 ramp	MR
	b) Width of Staircase			
	➤ Upper floors	1.5 mtr	1.7m, 1.7m & 1.5m	MR
	➤ Basement floor	1.5 mtr	1.7m, 1.7m, 1.5m & 5m ramp	MR
	c) Protection of exits			
	➤ Fire check door	Required	Provided in basement	MR
	➤ Pressurization	-NA-	-NA-	-NA-
	d) No. of continuous staircase to terrace	Required	02 Nos	MR
	e) Width of corridor	-NA-	-NA-	-NA-
	f) Door size	1m	Provided	MR
3	Compartmentation.			
	• Fire check door.	Required	Provided in basement only.	MR
	• Sealing of electrical shafts.	Required	Provided	MR
	• Fire rating of shaft door.	-NA-	-NA-	-NA-
	• Water curtain	-NA-	-NA-	-NA-
	• Fire dampers.	-NA-	-NA-	-NA-
4	Smoke Management system.			
	• Basement	30 ACPH	Provided	MR
	• Upper floors	12 ACPH	-NA-	-NA-
5	Fire Extinguishers.			
	• Total numbers	24 Nos	45 Nos	MR
	• Types	ABC/CO2	ABC & W.CO2	MR
	• ISI Marking	ISI mark	Provided	MR
6	First Aid Hose Reels.			
	• Total numbers on each floor.	03 Nos	Provided	MR
	• Length of hose-reel hose.	30m	Provided	MR
	• Nozzle Diameter	5mm	Provided	MR


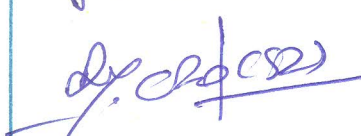
The Heritage School, D-2, Vasant Kunj, New Delhi-110070

7	Automatic fire detection & alarming system.			
	• Type of detectors	-NA-	-NA-	-NA-
	• Location of Main Panel	-NA-	-NA-	-NA-
	• Location of Repeater Panel	-NA-	-NA-	-NA-
	• Alternate source of power	-NA-	-NA-	-NA-
	• Hooter's location	-NA-	-NA-	-NA-
8	MOEFA	Required	Provided	MR
9	Public Address System	Required	Provided	MR
10	Automatic Sprinkler System			
	• Basement	Required	Provided	MR
	• Upper floors	-NA-	-NA-	-NA-
	• Sprinkler above false ceiling	-NA-	-NA-	-NA-
11	Internal Hydrants.			
	• Size of Riser/Down-comer	-NA-	-NA-	-NA-
	• Number of Hydrant per floor	-NA-	-NA-	-NA-
	• Hose box.	-NA-	-NA-	-NA-
12	Yard Hydrants.			
	• Total number of hydrants.	-NA-	-NA-	-NA-
	• Hose box.	-NA-	-NA-	-NA-
13	Pumping arrangements.			
	• Ground Level			
	➤ Discharge of main pump.	900 LPM	900 LPM	MR
	➤ Head of main pump.	60 mtr	60 mtr	MR
	➤ Number of main pumps.	One	One	MR
	➤ Jockey Pump output.	180 LPM	180 LPM	MR
	➤ Jockey Pump head.	60m	60m	MR
	➤ Standby Pump output.	-NA-	-NA-	-NA-
	➤ Standby Pump head.	-NA-	-NA-	-NA-
	➤ Auto Starting/Manual Stopping.	Required	Provided	MR
	➤ Pump house access.	Required	Provided	MR
	• Terrace Level			
	➤ Discharge of pump.	450 LPM	Provided	MR
	➤ Head of pump.	40 mtr	Provided	MR
	➤ Power supply.	Required	Provided	MR
	➤ Auto starting of pump.	Required	Provided	MR
14	Captive water storage for fire fighting.			
	• Underground tank capacity.	50,000 Lts	Required	Provided
	➤ Draw-off connection.	-NA-	-NA-	-NA-
	➤ Fire Service Inlet.	Required	Provided	MR
	➤ Access to tank.	Required	Provided	MR
	• Overhead tank capacity.	20,000 Ltr	Provided	MR
15	Exit Signage.	Required	Provided	MR
16	Provision of Lifts.			
	• Pressurization of lift shaft.	-NA-	-NA-	-NA-
	• Pressurization of lift lobby.	-NA-	-NA-	-NA-
	• Communication in lift car.	-NA-	-NA-	-NA-
	• Fireman's switch.	-NA-	-NA-	-NA-
	• Lift signage.	-NA-	-NA-	-NA-
17	Standby Power Supply	-NA-	-NA-	-NA-
18	Refuge Area			
	• Total area	-NA-	-NA-	-NA-
	• Location	-NA-	-NA-	-NA-

19	Fire Control Room.			
	• Detector system panel.	-NA-	-NA-	-NA-
	• Flow switch panel.	-NA-	-NA-	-NA-
	• PA system panel.	-NA-	-NA-	-NA-
	• Battery backup.	-NA-	-NA-	-NA-
	• Building floor plan.	-NA-	-NA-	-NA-
20	Special Fire Protection System for the Protection of special Risk, if any.			-NA-
<p>The fire protection system provided in the building was test checked at random and found functional at the time of inspection. Keeping in view of the deemed compliance of the minimum standards of fire prevention and fire safety measures as required under the rules, the fire safety certificate issued vide letter No. F6/DFS/MS/School/2015/SZ/1982 dated 04/11/2015, renewal under rule 37 of the Delhi Fire Service Rules, 2010 is recommended.</p> <p>Accordingly DFA is put up for approval and signature please.</p> <div style="text-align: right;">  Signature of the Inspecting Officer Name: Mehmood Design: ADO (SJ) </div>				


The Heritage School, D-2, Vasant Kunj, New Delhi-110070

DO (SD)


21/12/18


Pl speak

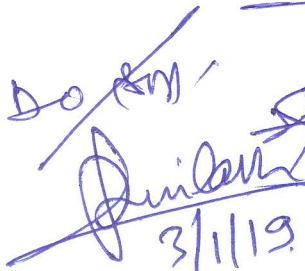

DO (SJ)

3/1/19

ADP
SJ
Sir, no classes in Basement, only using for storage purpose only submitted Mehmood
19/1/19
ADP (SJ)



382/CFD/SJ
18/1/19/25/1

