

**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE: NEW DELHI-110001**

No. F.6/DFS/MS/School/2019/SZ/ 968

Dated: 9.1.19.

FIRE SAFETY CERTIFICATE

Certified that the Manav Mangal Public School located at M.B. Road, Pul Pehladpur, New Delhi-110044, comprised of ground plus three upper floors was issued NOC by this department vide letter No. F.6/DFS/MS/2008/822 dated 30/06/2008. The premises was re-inspected by officer concerned of this department on 22/04/2019 in the presence of Mr. Vishal Katiyal (Manager) of the school and found that the school building have deemed complied with the fire prevention and fire safety requirements in accordance with Circular No. 262 - 362 dated 17/01/2005 issued by Education Directorate, Govt. of NCT of Delhi, Old Secretariat, New Delhi and that the premises is fit for occupancy class Educational Building Group-B, as above with effect from the date of issue of this certificate for period of **Three years** subject to compliance of the conditions given below.

Issued 9/1/19 at New Delhi by


(Rajesh Panwar)
Dy. Chief Fire Officer
Tel. 011-23412225

Copy to: -

1. The Principal, Manav Mangal Public School, M.B. Road, Pul Pehladpur, New Delhi-110044
2. The Director of Education, Govt. of NCT of Delhi, Old Secretariat, New Delhi-110054

Conditions for the validity of Fire Safety Certificate: -


1. All the means of escape/entry/exit shall be kept free from any obstruction.
2. All the fire safety arrangement provided therein shall be maintained in good working condition at all time as seen during inspection. Any loss of life property due to non-functional fire safety measures shall be at the responsibility of the management.
3. All the staff members must know the correct method of operation of fire fighting system.
4. The owner/occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on www.dfs.delhigovt.nic.in
5. This fire safety certificate may not in any way be treated as regularization (Clause 2.8 of UBBL-2016) of unauthorized construction or Alteration (Clause 1.4.3 of UBBL-2016), if any.
6. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in form 'J' [sub rule (I) of rule 37] along with a copy of this Certificate, six month prior to its expiry. The form is available on www.dfs.delhigovt.nic.in

INSPECTION REPORT

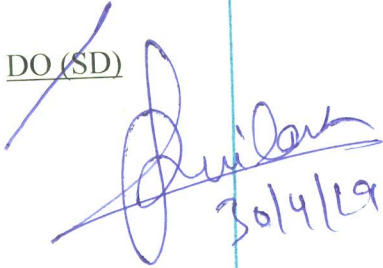
1	Name & Address of the Building	Manav Mangal Public School, M.B. Road, Pul Pehladpur, New Delhi-110044		
2	Type of Occupancy	Educational "Group-B" (School)		
3	Building Comprised of	Ground + 03 upper floor		
4	Type of Case	Renewal		
5	Details of Previous NOC	F6/DFS/MS/2008/1822 Dated 30/06/2008		
6	Fire Safety Directives Letter No	DOE Circular 262-232 dated 17/01/2005		
7	Date of Inspection	22-04-2019		
8	Name of the Inspecting Officers	Mehmood, ADO (SJ)		
9	Name & Designation of Officers from the building side	Mr. Vishal Katiyal (Manager)		
10	Year of construction	2000		
11	Applicant letter No.	MMPS/FNOC/2019 dated 28/03/2019		
S. No	Minimum standards on Fire Prevention and Fire Safety U/R 33	As Per Old NOC	Provided at Site	Remarks MR/NMR
1	Access to Building.			
	<ul style="list-style-type: none"> • Road width • Gate width • Width of internal road 	<ul style="list-style-type: none"> Required N/A N/A 	<ul style="list-style-type: none"> Accessible N/A N/A 	<ul style="list-style-type: none"> MR N/A N/A
2	Number, width, type & arrangement of exits			
	a) Number of Staircase			
	➤ Upper floors	02 Nos	02 Nos	MR
	➤ Basement floor	N/A	N/A	N/A
	b) Width of Staircase			
	➤ Upper floors	1.5 m/0.75m	1.07m & 1.06m	MR
	➤ Basement floor	N/A	N/A	N/A
	c) Protection of exits			
	➤ Fire check door	N/A	N/A	N/A
	➤ Pressurization	N/A	N/A	N/A
	d) No. of continuous staircase to terrace	One	Two	MR
	e) Width of corridor	1.5 mtr	Provided	MR
	f) Door size	1 mtr	1mtr	MR
3	Compartmentation.			
	<ul style="list-style-type: none"> • Fire check door. • Sealing of electrical shafts. • Fire rating of shaft door. • Water curtain • Fire dampers. 	<ul style="list-style-type: none"> N/A N/A N/A N/A NA 	<ul style="list-style-type: none"> N/A N/A N/A N/A NA 	<ul style="list-style-type: none"> N/A N/A N/A N/A NA
4.	Smoke Management system.			
	<ul style="list-style-type: none"> • Basement • Upper floors 	<ul style="list-style-type: none"> 30 ACPH 12 ACPH 	<ul style="list-style-type: none"> NA N/A 	<ul style="list-style-type: none"> MR N/A
5.	Fire Extinguishers.			
	<ul style="list-style-type: none"> • Total numbers • Types • ISI Marking 	<ul style="list-style-type: none"> 07 No's ABC / CO2 ISI marked 	<ul style="list-style-type: none"> 07 No's ABC & CO2 Provided 	<ul style="list-style-type: none"> MR MR MR

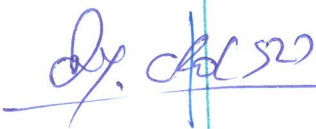
6.	First Aid Hose Reels.			
	<ul style="list-style-type: none"> Total numbers on each floor. 	One	Provided	MR
	<ul style="list-style-type: none"> Length of hose-reel hose. 	30m	Provided	MR
	<ul style="list-style-type: none"> Nozzle Diameter 	5mm	Provided	MR
7	Automatic fire detection & alarming system			
	<ul style="list-style-type: none"> Type of detectors 	N/A	N/A	N/A
	<ul style="list-style-type: none"> Location of Main Panel 	N/A	N/A	N/A
	<ul style="list-style-type: none"> Location of Repeater Panel 	N/A	N/A	N/A
	<ul style="list-style-type: none"> Alternate source of power 	N/A	N/A	N/A
	<ul style="list-style-type: none"> Hooter's location 	N/A	N/A	N/A
8.	MOEFA	N/A	N/A	N/A
9.	Public Address System	N/A	N/A	N/A
10.	Automatic Sprinkler System			
	<ul style="list-style-type: none"> Basement 	N/A	N/A	N/A
	<ul style="list-style-type: none"> Upper floors 	N/A	N/A	N/A
	<ul style="list-style-type: none"> Sprinkler above false ceiling 	N/A	N/A	N/A
11.	Internal Hydrants.			
	<ul style="list-style-type: none"> Size of Riser/Down-comer 	N/A	N/A	N/A
	<ul style="list-style-type: none"> Number of Hydrant per floor 	N/A	N/A	N/A
	<ul style="list-style-type: none"> Hose box. 	N/A	N/A	N/A
12.	Yard Hydrants.			
	<ul style="list-style-type: none"> Total number of hydrants. 	N/A	N/A	N/A
	<ul style="list-style-type: none"> Hose box. 	N/A	N/A	N/A
13.	Pumping arrangements.			
	<ul style="list-style-type: none"> Ground Level 			
	<ul style="list-style-type: none"> ➤ Discharge of main pump. 	N/A	N/A	N/A
	<ul style="list-style-type: none"> ➤ Head of main pump. 	N/A	N/A	N/A
	<ul style="list-style-type: none"> ➤ Number of main pumps. 	N/A	N/A	N/A
	<ul style="list-style-type: none"> ➤ Jockey Pump output. 	N/A	N/A	N/A
	<ul style="list-style-type: none"> ➤ Jockey Pump head. 	N/A	N/A	N/A
	<ul style="list-style-type: none"> ➤ Standby Pump output. 	N/A	N/A	N/A
	<ul style="list-style-type: none"> ➤ Standby pump head. 	N/A	N/A	N/A
	<ul style="list-style-type: none"> ➤ Auto Starting/Manual Stopping. 	N/A	N/A	N/A
	<ul style="list-style-type: none"> Terrace Level 			
	<ul style="list-style-type: none"> ➤ Discharge of pump. 	225 LPM	Provided	MR
	<ul style="list-style-type: none"> ➤ Head of pump. 	30 m	30 m	MR
	<ul style="list-style-type: none"> ➤ Power supply. 	Required	Provided	MR
	<ul style="list-style-type: none"> ➤ Auto starting of pump. 	Required	Provided	MR
14.	Captive water storage for Fire Fighting.			
	<ul style="list-style-type: none"> Underground tank capacity. 	N/A	N/A	N/A
	<ul style="list-style-type: none"> ➤ Draw-off connection. 	N/A	N/A	N/A
	<ul style="list-style-type: none"> ➤ Fire Service Inlet. 	N/A	N/A	N/A
	<ul style="list-style-type: none"> ➤ Access to tank. 	N/A	N/A	N/A
	<ul style="list-style-type: none"> Overhead tank capacity. 	5,000 Litr	Provided	MR
15.	Exit Signage.	Required	Provided	MR

2/6

16.	Provisions of Lifts.			
	• Pressurization of lift shaft.	N/A	N/A	N/A
	• Pressurization of lift lobby.	N/A	N/A	N/A
	• Communication in lift car.	N/A	N/A	N/A
	• Fireman's switch.	N/A	N/A	N/A
	• Lift signage.	N/A	N/A	N/A
17	Standby Power Supply			
18.	Refuge Area			
	• Total area	N/A	N/A	N/A
	• Location	N/A	N/A	N/A
19.	Fire Control Room.			
	• Detector System Panel.	N/A	N/A	N/A
	• Flow Switch Panel.	N/A	N/A	N/A
	• PA system Panel.	N/A	N/A	N/A
	• Battery backup	N/A	N/A	N/A
	• Building floor plan	N/A	N/A	N/A
20.	Special Fire Protection System for the Protection of special Risk, if any.			
The fire protection system provided in the building / premises were test checked at random and found functional at the time of inspection				
Keeping in view the deemed compliance of the minimum standards on fire prevention and fire safety measures as required under the DOE circular, FSC issued vide letter No. F.6/DFS/MS/2008/822 dated 30/06/2008, renewal under rule 37 of the Delhi Fire Service rules, 2010 is recommended				
Accordingly, DFA is put up for approval and signature please.				
 Signature of the Inspecting Officer Name: Mehmoed Designation: ADO (SJ)				


DO (SD)


30/4/19


30/4/19

Please speak with the dischargee
at SNO 6




3/4

