

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE: NEW DELHI- 110001

No. F.6/DFS/MS/School/2019/SZ/ 983

Dated: 10/5/19

FIRE SAFETY CERTIFICATE

Certified that the **S.S. Public School** located at B-545, Sangam Vihar, New Delhi-110080, comprised of **ground plus two upper floors** was issued FSC by this department vide letter No. F.6/DFS/MS/School/2015/SZ/229 dated 17/01/2015. The premises was re-inspected by officer concerned of this department on 26/04/2019 in the presence of Mr. Ramesh Chand (Manager) of the school and observed that school building have complied with the fire prevention and fire safety arrangements in accordance with Rule 33 of Delhi Fire Service Rules, 2010 and that the building/premises is fit for occupancy class "Educational Building, Group-B" with effect from the date of issue of this certificate for a period of **Three years** in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules, 2010.

Issued on 10/5/19 at New Delhi by

(Rajesh Panwar)
Dy. Chief Fire Officer
Ph: 011-26189168

Copy to: -

1. Manager, S.S. Public School located at B-545, Sangam Vihar, New Delhi-110080
2. Director of Education, Govt. of NCT of Delhi, Old Secretariat, New Delhi-110054

Conditions for the validity of Fire Safety Certificate

1. All the means of escape/entry/exit shall be kept free from any obstruction.
2. All the fire safety arrangements provided therein shall be maintained in good working condition at all time as seen during inspection. Any loss of life or property due to non functional fire safety measures shall be at the responsibility of the management.
3. All the staff members must know the correct method of operation of firefighting system.
4. This certificate cannot be treated as regularization of unauthorized construction, if any.
5. The owner/occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on www.dfs.delhigovt.nic.in
6. "The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in the form 'J' [sub rule (1) of rule 37] along with copy of this certificate, six months prior to its expiry."

INSPECTION REPORT

1	Name & Address of the Building	S.S. Public School at B-545, Sangam Vihar, New Delhi-110080 [Managed By S.S. SIWAS Education Society (Regd.)]		
2	Type of Occupancy	Educational, Group-B (School)		
3	Building Comprised of	Ground plus two upper floors.		
4	Type of Case	Renewal		
5	Details of Previous NOC	F6/DFS/MS/School/2015/SZ/229 dated 17-02-2015		
6	Fire Safety Directives Letter No	Nil		
7	Date of Inspection	26-04-2019		
8	Name of the Inspecting Officers	Mehmood, ADO (SJ)		
9	Name & Designation of Officers from the building side	Sh. Ramesh Chand (Manager)		
10	Year of construction	2006		
11	Applicant letter No.	Outdoor Diary No. 4732 dated 05-03-2019		
S. No.	Minimum standards on Fire Prevention and Fire Safety U/R 33	Requirements	Provided at Site	Remarks MR/NMR
1	Access to Building.			
	• Road width	6 mtr	Provided	MR
	• Gate width	-NA-	-NA-	-NA-
	• Width of internal road	-NA-	-NA-	-NA-
2	Number, width, type & arrangement of exits.			
	a) Number of Staircase			
	➤ Upper floors.	02 Nos	Provided	MR
	➤ Basement floor.	-NA-	-NA-	-NA-
	b) Width of Staircase			
	➤ Upper floors	1.5 mtr	1.50m & 1.12m	MR (old case)
	➤ Basement floor	-NA-	-NA-	-NA-
	c) Protection of exits			
	➤ Fire check door	-NA-	-NA-	-NA-
	➤ Pressurization	-NA-	-NA-	-NA-
	d) No. of continuous staircase to terrace	One	Provided	MR
	e) Width of corridor	1.5m	Provided	MR
	f) Door size	1m	Provided	MR
3	Compartmentation.			
	• Fire check door.	-NA-	-NA-	-NA-
	• Sealing of electrical shafts.	-NA-	-NA-	-NA-
	• Fire rating of shaft door.	-NA-	-NA-	-NA-
	• Water curtain	-NA-	-NA-	-NA-
	• Fire dampers.	-NA-	-NA-	-NA-
4	Smoke Management system.			
	• Basement	30 ACPH	-NA-	-NA-
	• Upper floors	12 ACPH	Natural Ventilation	MR
5	Fire Extinguishers.			
	• Total numbers		05 Nos	MR
	• Types	ISI marked	ABC & CO2	MR
	• ISI Marking		Provided	MR
6	First Aid Hose Reels.			
	• Total numbers on each floor.		One	MR
	• Length of hose-reel hose.	Hose-reel	30m	MR
	• Nozzle Diameter		5mm	MR

S.S. Public School at B-545, Sangam Vihar, New Delhi-110080


7	Automatic fire detection & alarming system.	-NA-	-NA-	-NA-
	• Type of detectors	-NA-	-NA-	-NA-
	• Location of Main Panel	-NA-	-NA-	-NA-
	• Location of Repeater Panel	-NA-	-NA-	-NA-
	• Alternate source of power	-NA-	-NA-	-NA-
	• Hooter's location	-NA-	-NA-	-NA-
8	MOEFA	Required	Provided	MR
9	Public Address System	Required	Provided	MR
10	Automatic Sprinkler System	-NA-	-NA-	-NA-
	• Basement	-NA-	-NA-	-NA-
	• Upper floors	-NA-	-NA-	-NA-
	• Sprinkler above false ceiling	-NA-	-NA-	-NA-
11	Internal Hydrants.	-NA-	-NA-	-NA-
	• Size of Riser/Down-comer	-NA-	-NA-	-NA-
	• Number of Hydrant per floor	-NA-	-NA-	-NA-
	• Hose box.	-NA-	-NA-	-NA-
12	Yard Hydrants.	-NA-	-NA-	-NA-
	• Total number of hydrants.	-NA-	-NA-	-NA-
	• Hose box.	-NA-	-NA-	-NA-
13	Pumping arrangements.	-NA-	-NA-	-NA-
	• Ground Level	-NA-	-NA-	-NA-
	➤ Discharge of main pump.	-NA-	-NA-	-NA-
	➤ Head of main pump.	-NA-	-NA-	-NA-
	➤ Number of main pumps.	-NA-	-NA-	-NA-
	➤ Jockey Pump output.	-NA-	-NA-	-NA-
	➤ Jockey Pump head.	-NA-	-NA-	-NA-
	➤ Standby Pump output.	-NA-	-NA-	-NA-
	➤ Standby Pump head.	-NA-	-NA-	-NA-
	➤ Auto Starting/Manual Stopping.	-NA-	-NA-	-NA-
	➤ Pump house access.	-NA-	-NA-	-NA-
	• Terrace Level	450 LPM	Provided	MR
	➤ Discharge of pump.	40m	Provided	MR
	➤ Head of pump.	Required	Provided	MR
	➤ Power supply.	Required	Provided	MR
	➤ Auto starting of pump.	Required	Provided	MR
14	Captive water storage for fire fighting.	-NA-	-NA-	-NA-
	• Underground tank capacity.	-NA-	-NA-	-NA-
	➤ Draw-off connection.	-NA-	-NA-	-NA-
	➤ Fire Service Inlet.	-NA-	-NA-	-NA-
	➤ Access to tank.	-NA-	-NA-	-NA-
	• Overhead tank capacity.	10,000 Ltr	Provided	MR
		Required	Provided	MR
15	Exit Signage.	-NA-	-NA-	-NA-
16	Provision of Lifts.	-NA-	-NA-	-NA-
	• Pressurization of lift shaft.	-NA-	-NA-	-NA-
	• Pressurization of lift lobby.	-NA-	-NA-	-NA-
	• Communication in lift car.	-NA-	-NA-	-NA-
	• Fireman's switch.	-NA-	-NA-	-NA-
	• Lift signage.	-NA-	-NA-	-NA-
17	Standby Power Supply	-NA-	-NA-	-NA-
18	Refuge Area	-NA-	-NA-	-NA-
	• Total area	-NA-	-NA-	-NA-
	• Location	-NA-	-NA-	-NA-

19	Fire Control Room.			
	• Detector system panel.	-NA-	-NA-	-NA-
	• Flow switch panel.	-NA-	-NA-	-NA-
	• PA system panel.	-NA-	-NA-	-NA-
	• Battery backup.	-NA-	-NA-	-NA-
	• Building floor plan.	-NA-	-NA-	-NA-
20	Special Fire Protection System for the Protection of special Risk, if any.	Required	ABC type fire extinguisher provided near elect. panel	MR

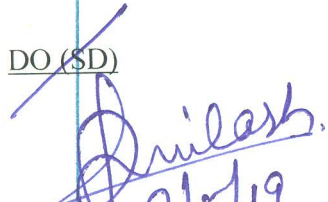
S.S. Public School at B-545, Sangam Vihar, New Delhi-110080


The Fire protection systems provided in the building/ premises were test checked at random and found functional at the time of inspection. Keeping in view of the deemed compliance of the minimum standards on fire prevention and fire safety measures as required under the rules, the FSC issued vide letter No. F6/DFS/MS/School/2015/SZ/229 dated 17/02/2015, renewal under rule 37 of the Delhi Fire Service Rules, 2010 is recommended.

Accordingly DFA is put up for approval and signature please.



Signature of the Inspecting Officer
Name: Mehmood
Design: ADO (SJ)

DO (SD)



8/5/19



9/5/19



9/5


9/5/19

Sir A B. I letter put up for Signature Please


9/5/19
ADO (SJ)


9/5/19


9/5


9/5/19

