

FORM 'H'  
FORM FOR ISSUING FIRE SAFETY CERTIFICATE  
[Refer sub - rule (1) of rule 35]  
GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI  
HEAD QUARTERS: DELHI FIRE SERVICE, CONNAUGHT PLACE  
NEW DELHI

No. F6/DFS/MS/WZ/2019/ 1698

Dated: 29/08/2019

**FIRE SAFETY CERTIFICATE**

Certified that the Govt. Sarvodava Bal Vidyalaya (ID-1208229) Located at Lalita Block , Shastri Nagar, Delhi-110052. comprised of Ground + 01 Upper Floors was issued FSC vide Letter No. F6/DFS/MS/SCHOOL/2016/WZ/1223 Dated-02/08/2016. The premises was re inspected by the officer concerned of this department on 19/08/2019 in the presence of Sh. K.M. Tiwari ( HOS) and observed that all the fire prevention and fire safety arrangements provided in the premises found in good working condition. The premises have therefore deemed complied with the fire prevention and fire safety requirements in accordance DOE Circular 3298 – 3398 Dated 17-01-2011 and that the premises is fit for occupancy class "Educational" Group B with effect from 29/8/19 for a period of three years in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules, 2010.

Issued on 29/8/19 at New Delhi by.

(Dharampal Bhardwaj)  
DY. Chief Fire Officer  
Delhi Fire Service

Copy to:

1. The Govt. Sarvodava Bal Vidyalaya (ID-1208229) Lalita Block , Shastri Nagar, Delhi-110052.
2. Director of Education, Old Secretariat, Delhi-110054

**Following fire safety directives must be adhered to:-**

1. All the fire safety arrangements provided therein shall be maintained in good working condition at all times.
2. Any loss of life or property due to non-functional fire safety measures shall be at the risk and responsibility of the management.
3. The trained staff should be available round the clock.
4. Any deviations w.r.t. construction shall be verified by the concerned building sanctioning agency.
5. The certificate may not be treated in any case for the regularization of the unauthorized construction, if any.
6. The owner/ occupier shall apply for renewal of this Fire Safety Certificate to the Director in Form 'J' [sub rule (1) of rule 37] along with a copy of this certificate, six months prior to its expiry.
7. The owner/occupier shall submit a declaration every year in the form 'K' provided in the first schedule of Delhi Fire Service Rules 2010, form is available on [www.dfs.delhigovt.nic.in](http://www.dfs.delhigovt.nic.in).

## INSPECTION REPORT

1. Name & address of the building: **Govt. Sarvodaya Bal Vidyalaya, (ID-1208229)** Located at **Lalita Block , Shastri Nagar, Delhi-110052.**
2. Type of Occupancy : Educational (Ground + 1 Upper Floor)
3. Type of Case : Renewal
4. Details of previous NOC : F6/DFS/MS/SCHOOL/2016/WZ/1223 Dated-02/08/16
5. Fire Safety directives Letter No. : Cr.No .3298-3398 dated 1-3-11
6. Date of inspection : 19/08/2019
7. Name of the Inspecting Officer : Udai vir singh, ADO (WP)
8. Name and designation of Officer  
from the building side : Sh. K.M. Tiwari ( HOS)
9. Year of Construction : 2014
10. Applicant's letter No. : SBV/SH/LBLK./2019/1542 dated 20/07/2019

No. of Students=1088 No. of class rooms=22 Plot area=3484sqmt Covered Area—984 sqmt
--

S No	Minimum standards on fire prevention and fire safety U/R 33	Cr.No.3298-3398 dated 1-3-11	Provided at site	Remarks MR/NMR
1.	Access of building			
	<ul style="list-style-type: none"> <li>• Road width</li> <li>• Gate width</li> <li>• Width of internal road</li> </ul>	Accessible Accessible NA	Provided Provided NA	MR MR NA
2.	Number, width, Type & Arrangements of exits			
	a. Number of staircases			
	<ul style="list-style-type: none"> <li>• Upper floors</li> <li>• Basements</li> </ul>	2 NA	Provided NA	MR NA
	b. Width of staircases			
	<ul style="list-style-type: none"> <li>• Upper floors</li> <li>• Basements</li> </ul>	1.5 mtrs. each NA	2x160cm NA	MR NA
	c. Protection of exits			
	<ul style="list-style-type: none"> <li>• Fire check door</li> <li>• Pressurization</li> </ul>	NA NA	NA NA	NA NA
	d. No of continuous staircase to terrace	Required	Provided	MR
	e. Width Of Corridor	1.5m	233cm	MR
	f. Door Size	1 mtr	Provided ( Including door frame)	MR


3.	Compartmentation			
	<ul style="list-style-type: none"> <li>• Fire check door</li> </ul>	NA	NA	NA
	<ul style="list-style-type: none"> <li>• Sealing of electrical shafts</li> </ul>	NA	NA	NA
	<ul style="list-style-type: none"> <li>• Fire Rating of shaft door</li> </ul>	NA	NA	NA
	<ul style="list-style-type: none"> <li>• Water Curtain</li> </ul>	NA	NA	NA
	<ul style="list-style-type: none"> <li>• Fire Dampers</li> </ul>	NA	NA	NA
4.	Smoke managements System			
	<ul style="list-style-type: none"> <li>• Basements</li> </ul>	NA	NA	NA
	<ul style="list-style-type: none"> <li>• Upper floors</li> </ul>	NA	NA	NA
5.	Fire Extinguishers			
	<ul style="list-style-type: none"> <li>• Total numbers</li> </ul>	4 nos.	24 Provided	MR
	<ul style="list-style-type: none"> <li>• Types</li> </ul>	ABC & CO <sub>2</sub>	Provided	MR
	<ul style="list-style-type: none"> <li>• IS marking</li> </ul>	ISI marked	Provided	MR
6.	First – Aid Hose Reels			
	<ul style="list-style-type: none"> <li>• Total numbers on each floor</li> </ul>	NA	NA	NA
	<ul style="list-style-type: none"> <li>• Length of hose reel hose</li> </ul>	NA	NA	NA
	<ul style="list-style-type: none"> <li>• Nozzle diameter</li> </ul>	NA	NA	NA
7.	Automatic fire detection and alarming system			
	<ul style="list-style-type: none"> <li>• Type of detectors</li> </ul>	NA	NA	NA
	<ul style="list-style-type: none"> <li>• Location of Main Panel</li> </ul>	NA	NA	NA
	<ul style="list-style-type: none"> <li>• Location of Repeater Panel</li> </ul>	NA	NA	NA
	<ul style="list-style-type: none"> <li>• Alternate source of power</li> </ul>	NA	NA	NA
	<ul style="list-style-type: none"> <li>• Hooters' Location</li> </ul>	NA	NA	NA
8.	MOEFA	NA	NA	NA
9.	Public Address System	Required	Provided	MR
10.	Automatic Sprinkler System			
	<ul style="list-style-type: none"> <li>• Basements</li> </ul>	NA	NA	NA
	<ul style="list-style-type: none"> <li>• Upper Floor</li> </ul>	NA	NA	NA
	<ul style="list-style-type: none"> <li>• Sprinkler above false ceiling</li> </ul>	NA	NA	NA
11.	Internal Hydrants:			
	<ul style="list-style-type: none"> <li>• Size of riser/down- comer</li> </ul>	NA	NA	NA
	<ul style="list-style-type: none"> <li>• Number of hydrants per floor</li> </ul>	NA	NA	NA
	<ul style="list-style-type: none"> <li>• Hose Box</li> </ul>	NA	NA	NA
12.	Yard Hydrants			
	<ul style="list-style-type: none"> <li>• Total number of hydrants</li> </ul>	NA	NA	NA
	<ul style="list-style-type: none"> <li>• Hose Box</li> </ul>	NA	NA	NA


13.	Pumping Arrangements:			
	<ul style="list-style-type: none"> <li>• Ground Level</li> <li>• Discharge of main pump</li> <li>➤ Head of main pump</li> <li>➤ Number of main pumps</li> <li>➤ Jockey pump out put</li> <li>➤ Jockey pump head</li> <li>➤ Standby Pump out put</li> <li>➤ Standby Pump Head</li> <li>➤ Auto Staring/Manual stopping</li> <li>➤ Pump House Access</li> <li>• Terrace level</li> <li>➤ Discharge of pump</li> <li>➤ Head of the pump</li> <li>➤ Power supply</li> <li>➤ Auto starting of pump</li> </ul>	NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA
14.	Captive water Storage for fire fighting:			
	<ul style="list-style-type: none"> <li>• Under ground tank capacity</li> <li>➤ Draw off connection</li> <li>➤ Fire service inlet</li> <li>➤ Access to tank</li> <li>• Overhead Tank capacity</li> </ul>	NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA
15	Exit Signage	Required	Provided	MR
16.	Provision of Lifts			
	<ul style="list-style-type: none"> <li>➤ Pressurization of Lift Shaft</li> <li>➤ Pressurization of lift lobby</li> <li>➤ Communication in lift Car</li> <li>➤ Fireman's Grounding Switch</li> <li>➤ Lift Signage</li> </ul>	NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA
17.	Standby power supply	NA	NA	NA
18.	Refuge Area			
	<ul style="list-style-type: none"> <li>➤ Total area</li> <li>➤ Location</li> </ul>	NA	NA	NA
		NA	NA	NA
19.	Fire control room			
	<ul style="list-style-type: none"> <li>➤ Detector system panel</li> <li>➤ Flow Switch Panel</li> <li>➤ PA System Panel</li> <li>➤ Battery backup</li> <li>➤ Building Floor Plans</li> </ul>	NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA


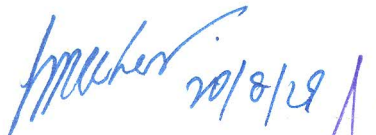
20.	Special Fire Protection Systems for Protection of special Risks, if any;	NA	NA	NA
-----	--	----	----	----

The fire protection systems provided in the building were test checked and found functional at the time of inspection.

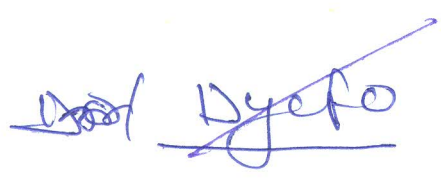

In view of the deemed compliance of minimum standards on fire prevention and fire safety as required under the rules the NOC issued vide letter no. F6/MS/DFS/S/2015/WZ/01 Dated 01/01/2016 renewal under rule 35 of the Delhi Fire Service Rules 2010 is recommended.

  
 Signature of the Inspecting Officer  
 Name Uday Vir Singh  
 Designation ADDO/WP

  
 Signature of the Inspecting Officer  
 Name  
 Designation

  
  
 Dy. PO WZ  
 20/8/19

ADDO/WP - F.T  
 Sir AP letter is put up for  
 sign please.

  
  
 Dy. PO  
 25/8

ms/leef