

**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI**  
**HEADQUARTERS DELHI FIRE SERVICE, NEW DELHI- 110001.**


NO.F6/DFS/MS/School/2019/SZ/ 2179

Dated: 18/11/19

**FIRE SAFETY CERTIFICATE**

Certified that the Shanti Gyan Vidhyapeeth School located at Goyla (Dwarka) Near Sector-19, New Delhi-110071, comprised of ground plus two upper floors was issued Fire Safety Certificate by this department vide letter no. F6/DFS/MS/School/2016/SZ/1249 dated 8.8.2016. The said school building was re-inspected by the officer concerned of this department on 5.11.2019 in presence of Sh. Rohit Khuran (Manager) and found that the school management has added one more upper floor i.e. 3<sup>rd</sup> floor and have complied with the fire prevention and fire safety requirements in accordance rule 33 of the Delhi Fire Service Rules, 2010, and that the building/premises is fit for occupancy class B "Educational building" for ground plus three upper floors with effect from 18/11/19 for a period of **three** years, in accordance with rule 36 unless renewed 37 or sooner cancelled under rule 40 subject to compliance of the conditions under rule 38 of the Delhi Fire Service, Rules 2010, printed overleaf.

Issued on 18/11/19 at New Delhi by

 (Vipin Kental)  
Chief Fire Officer  


Copy to:-

1. The Dy. Director (Education), GNCT of Delhi, Old Secretariat, Delhi-110054.
2. The Manager, the Shanti Gyan Vidhyapeeth School located at Goyla (Dwarka) Near Sector-19, New Delhi-110071.

## CONDITIONS

1. All the means of escape shall be kept free of all type of obstruction all the time.
2. All the employees shall be acquainted with the use and maintenance of all fire equipments and method of smooth and speedy safe evacuation of occupants in case of emergency.
3. All the fire fighting equipments shall be maintained in perfect working condition all the time and any lapse rendering non-functional if fire safety measures, management shall be responsible.
4. Any deviation, with regards to construction, ventilation, occupation, electric installation etc. may be got verified from the concerned authorities.
5. The Fire Safety Certificate may not be treated in any case for regularizations of unauthorized construction / unauthorized use of land if any.
6. All comments / directions of licensing Department shall always be permitted and followed.
7. The owner / occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rule 2010. The form is available on [www.dfs.delhigovt.nic.in](http://www.dfs.delhigovt.nic.in)
8. The owner / occupier shall apply for renewal of this **Fire Safety Certificate to the Director in 'Form J' (sub Rule (1) of Rule 37)** along with copy of the certificate, six months prior to its expiry.

# INSPECTION REPORT

1	Name & address of the building	Shanti Gyan Vidhyapeeth School, Goyla Near Sector-19, Dwarka, New Delhi-110071.		
2	Type of Occupancy	Educational Building "B"		
3	Type of case	Renewal/ Addition of Floor		
4	Details of previous NOC	F6/DFS/MS/School/2016/SZ/1249 dated 8.8.2016		
5	Fire safety directives letter No	As per UBBL/NBC Part IV		
6	Date of inspection	5.11.2019		
7	Name of the inspecting Officers :	ADO S.P. Bhardwaj		
8	Name and designation of officers from the building side	Sh. Rohit Khurana (Manager)		
9	Year of construction	2009/ 2014/2019		
10	Applicant's letter No.	Nil Dated 22.10.2019	(Ground plus two upper floors) One more floor is added i.e 3rd floor	

S. NO.	Minimum Standards on fire prevention and fire safety U/R 33	UBBL/NBC Requirement	Provided at site	Remarks MR / NMR
1	<b>Access to building</b>			
	1) Road width	6 Mtrs.	6 Mtrs.	MR
	2) Gate width	4.5 Mtrs.	4.5 Mtrs.	MR
	3) Width of internal road	N/A	N/A	N/A
2	<b>Number, width Type &amp; arrangement of exits</b>			
	<b>a. Number of staircases</b>			
	1. Upper floors	Two	Two	MR
	2. basements	N/A	N/A	N/A
	<b>b. Width of staircase</b>			
	1. Upper floors	1.50 Mtr	1.50 Mtr.	MR
	2. basements	N/A	N/A	N/A
	<b>c. Protection of exits</b>			
	1. Fire check door	N/A	N/A	N/A
	2. Pressurization	N/A	N/A	N/A
	<b>d. No. of continuous staircase to terrace</b>	Required	Two	MR
	e. Width of corridor	1.50 Mtrs.	1.75 Mtrs.	N/A
	f. Door size	1.20 Mtr.	1.20 Mtr.	MR
3	<b>Compartmentation.</b>			
	1. Fire check door	N/A	N/A	N/A
	2. Sealing of electrical shafts	N/A	N/A	N/A
	3. Fire Rating of shaft door	N/A	N/A	N/A
	4. water curtain	N/A	N/A	N/A
	5. Fire dampers	N/A	N/A	N/A
4	<b>Smoke Management system.</b>			
	basement	N/A	N/A	N/A
	upper floors	N/A	N/A	N/A


5	<b>Fire Extinguishers</b>			
	total numbers	2 Nos. Each Floor	10 Nos	MR
	Types	(CO2 OR ABC)	ABC & CO2	MR
	ISI marking	ISI	Provided	MR
6	<b>First-Aid Hose Reels.</b>			
	total numbers on each floor	One each floor	One each floor	MR
	Length of Hose reel hose	30 m	30 m	MR
	Nozzle Diameter	5 mm	5 mm	MR
7	<b>Automatic fire detection and alarming system</b>			
	Type of detectors	N/A	N/A	N/A
	location of Main Panel	N/A	N/A	N/A
	location of Repeater panel	N/A	N/A	N/A
	Alternate source of power	N/A	N/A	N/A
	hooter's location	N/A	N/A	N/A
8	<b>MOEFA</b>	N/A	N/A	N/A
9	<b>Public Address System.</b>	N/A	N/A	N/A
10	<b>Automatic Sprinkler System.</b>			
	basement	N/A	N/A	N/A
	upper floors	N/A	N/A	N/A
	sprinkler above false ceiling	N/A	N/A	N/A
11	<b>Internal Hydrants</b>			
	Size of riser/down-corner	75 mm	100 mm	MR
	Number of Hydrants per floor	N/A	One each floor	N/A
	hose Box	N/A	One each floor	N/A
12	<b>Yard Hydrants.</b>			
	total number of hydrants	N/A	One	N/A
	hose box	N/A	N/A	N/A
13	<b>Pumping arrangements</b>			
	<b>1. Ground level</b>			
	a. Discharge of main Pump	N/A	N/A	N/A
	b. Head of main pump	N/A	N/A	N/A
	c. Number of main pumps	N/A	N/A	N/A
	d. jockey pump out put	N/A	N/A	N/A
	e. jockey pump head	N/A	N/A	N/A
	f. Standby Pump output	N/A	N/A	N/A
	g. Stanby Pump head	N/A	N/A	N/A
	h. Auto Starting/Manual stopping	N/A	N/A	N/A
	pump house access	N/A	N/A	N/A
	<b>2. Terrace level</b>			
	a. Discharge of pump	450 LPM	450 LPM	MR
	b. head of the pump	30 Meter	30 Meter	MR
	c. Power supply	Required	Provided	MR
	d. Auto starting of pump	Required	Provided	MR
14	<b>Captive water storage for fire fighting</b>			
	1. Underground tank capacity	N/A	N/A	N/A
	a. Draw-off connection	N/A	N/A	N/A
	b. fire service inlet	N/A	N/A	N/A
	c. Access to tank	N/A	N/A	N/A
	Over head tank Capacity	10000 Ltrs.	10000 Ltrs.	MR
15	<b>Exit Signage.</b>	Required	Provided	MR


N/13


16	Provision of lifts.			
	a. Pressurization of lift shaft	N/A	N/A	N/A
	b. pressurization of lift lobby	N/A	N/A	N/A
	c. communication in lift car	N/A	N/A	N/A
	d. Fireman's grounding switch	N/A	N/A	N/A
	e. Lift signage	N/A	N/A	N/A
17	Standby power supply	N/A	N/A	N/A
18	Refuge Area.			
	total area	Not Required		
	location			
19	Fire control room			
	a. detector system Panel	N/A	N/A	N/A
	b. Flow switch Panel	N/A	N/A	N/A
	c. PA system Panel	N/A	N/A	N/A
	d. Batter backup	N/A	N/A	N/A
	e. Building floor plans	N/A	N/A	N/A
20	Special Fire Protection systems for protection of special risks, if any: ABC fire extinguisher near electric panel			MR


Fire protection system provided in the building were checked & found functional at the time of inspection. Keeping In view compliance of the substntial compliance of minimum standards of fire prevention & fire safety requirements under the rules the Fire safety certificate issued vide letter no. F6/DFS/MS/School/2016/SZ/1249 dated 8.8.2016 for ground plus two upper floors is recommended for ground plus three upper floors.

Accordingly DFA is put up for approval and signature please.


  
S.P. Bhardwaj ADO Dwarka

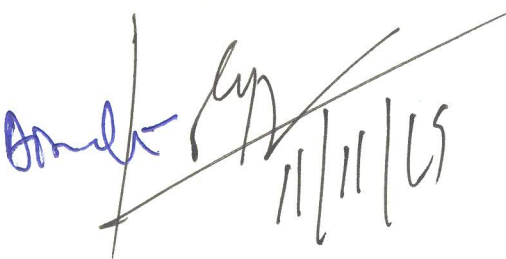


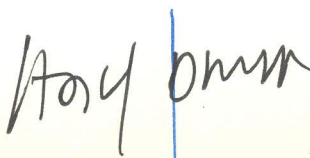
  
27/11/2019

  
DFA/SZ

496  
27/11/19

  
9/11

  
11/11/19

  
Arya Datta

