

**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI**

**HEADQUARTERS: DELHI FIRE SERVICE: NEW DELHI – 110001**


NO F 6/DFS/MS/GH/2019/ NDZ/ 2282

Dated: 10/12/19

**FIRE SAFETY CERTIFICATE**

Certified that the **M/S Marigold Rooms located at D-7, Krishna, Nagar Delhi -51** , comprised of Basement, Stilt, Upper ground+3 Upper floors( basement vacant, stilt floor parking, upper ground 05 nos. guest rooms, first floor 06 nos guest rooms, second floor 06 guest rooms, third floor 06 nos guest rooms). The building have complied with the fire prevention and fire safety requirements in accordance with the NBC Part- IV and verified by the officer concerned of Delhi Fire Service on 04/12/2019 in the presence of **Mr.Vineet Arora (Manager)** of the guest house and found that the building is fit for residential occupancy class A (ii) for Guest House of 23 guest rooms with effect from 10/12/19 for a period of **three** years in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under rule 40, subject to compliance of the conditions under rule 38 of the Delhi Fire service rule 2010, subject to conditions printed below.

Issued 10/12/19 at New Delhi by.

  
(Sunil Chawdhary)  
Dy. Chief Fire Officer  
Delhi Fire Service

copy to:-

1. The Deputy Health Officer, Shahdara (South) Zone, EDMC, Health Department, Shahdara South Zone, Delhi.
2. M/S Marigold Rooms located at D-7, Krishna, Nagar Delhi -51.

**Condition for the validity of fire safety certificate**

1. All the fire safety arrangement provided therein shall be maintained in good working conditions at all times.
2. All the means of escape shall be kept unobstructed /unlocked & remain available for speedy evacuation of occupants in case of an emergency.
3. Any loss of life or property due to non functional fire safety measures shall be at the responsibility of the management.
4. The trained fire fighting staff should be available round the clock.
5. Any deviation w.r.t construction etc. shall be verified by the concerned building sanctioning authority.
6. The fire safety certificate may not be treated in any case for regularization of unauthorized construction if any.
7. The owner / occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi fire service 2010. The form is available on [www.dfs.delhigovt.nic.in](http://www.dfs.delhigovt.nic.in).
8. The owner / occupier shall apply for renewal of this fire safety certificated to the director in Form 'J' [sub rule (1) of rule 37] alongwith a copy of this certificate, six months prior to it expiry.
9. The owner / occupier shall apply for renewal of this fire safety certificated to the director in Form 'the [sub rule (1) of rule 37] along with a copy of this certificate, six months prior to it expiry.

1. Name & address of the building : M/s Merigold Rooms at D-7, Krishna Nagar Delhi-51.
2. Building is comprised of : Basement, Stilt, Upper ground plus three upper floors *For 27 Guest Room*
3. Type of Occupancy : Residential (Guest House) class A (ii)
4. Type of Case : **New**
5. Details of Previous FSC letter : Nil
6. Fire Safety direction letter No : As per NBC Part-IV
7. Date of Inspection : 04/12/19
8. Name of the Inspecting officers : ADO R.K. Yadav
9. Name and designation of officer from the building side : Mr. Vineet Arora (Manager)
10. Year of construction : Construction year 2015-16 & Sanction year 2013
- 11 Applicant's letter No : 16343/Addl. CP/Lic.(H) dated-20/11/19

S N	Minimum Standards on Fire Prevention and Fire Safety U/R33	NBC Part-IV Requirement	Provided at Site	Remarks MR/NMR
1	Access to Building.			
	• Road width	06m	06m	MR
	• Gate width	N/A	N/A	N/A
	• Width of internal road	N/A	N/A	N/A
2	Number, Width, Type and Arrangement of Exits.			
	a. Number of Staircases			
	• Upper floor	02 Nos.	02No.	MR
	• Basement	02 Nos	02 No.	MR
	B. Width of Staircases			
	• Upper floor	1.5 m	1.50 M each	MR
	• Basement	1.5 m	1.50 & 1.14 M	MR
	c. Protection of Exits			
	• Fire check door	Required	Provided	MR
	• Pressurization	N/A	N/A	N/A
	d. No. of Continuous Staircases to Terrace	01 No.	01 No.	MR
	e. Width of Corridor	1.5 m	1.5 m	MR
	f. Door Size	1.0 m	1.0 m	MR
3	Compartmentation.			
	• Fire check door	Required	Provided	MR
	• Sealing of electrical shafts	Required	Provided	MR
	• Fire rating of shaft door	Required	Provided	MR
	• Water curtain	N/A	N/A	N/A
	• Fire dampers	N/A	N/A	N/A
4	Smoke Management System.			
	• Basement	Required	Provided	MR
	• Upper floor	Required	Provided	MR
5.	Fire Extinguishers.			
	• Total numbers	12 nos.	20 Nos.	MR
	• Types	ABC /CO <sub>2</sub>	Provided	MR
	• IS marking	ISI marked	Provided	MR



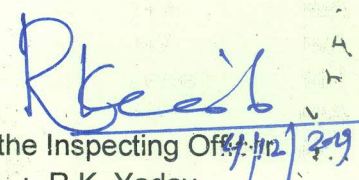
06	First-Aid-Hose Reels.			
	• Total numbers on each floor	1 No	1 No	MR
	• Length of hose reel hose	30 m	30 m	MR
	• Nozzle diameter	05 mm	05 mm	MR
07	Automatic Fire Detection and Alarming System.			
	• Type of detectors	N/A	Provided	MR
	• Location of main panel	N/A	Provided	MR
	• Location of repeater panel	N/A	Provided	MR
	• Alternate source of power	N/A	Provided	MR
	• Hooter's location	N/A	Provided	MR
08	MOEFA	Required	Provided	MR
09	Public Address System.	Required	Provided	MR
10	Automatic Sprinkler System.			
	• Basement	N/A	Provided	MR
	• upper floor	N/A	N/A	N/A
	• sprinkler above false ceiling	N/A	N/A	N/A
11	Internal Hydrants			
	• size of riser/down-comer	100 mm	100 mm	MR
	• Number of hydrants per floor	1 No.	1 No.	MR
	• Hose box	1 No.	1 No.	MR
12	Yard Hydrants.			
	• Total number of hydrants	N/A	N/A	N/A
	• Hose box	N/A	N/A	N/A
13	Pumping Arrangements.			
	➤ Ground Level			
	• Discharge of main pump			
	• Head of main pump	N/A	N/A	N/A
	• Number of main pumps	N/A	N/A	N/A
	• Jockey pump out put	N/A	N/A	N/A
	• Jockey pump head	N/A	N/A	N/A
	• Standby pump out put	N/A	N/A	N/A
	• Standby pump head	N/A	N/A	N/A
	• Auto starting /manual stopping	N/A	N/A	N/A
	• Pump house access	N/A	N/A	N/A
	➤ Terrace Level			
	• Discharge of pump	900 LPM	900 LPM	MR
	• Head of the pump	40 M	40 M	MR
	• Power supply	Required	Provided	MR
	• Auto Starting of pump	Required	Provided	MR
14	Captive Water Storage for Fire Fighting.			
	• Underground tank capacity	N/A	N/A	N/A
	• Draw-off connection	N/A	N/A	N/A
	• Fire service inlet	N/A	N/A	N/A
	• Access to tank	N/A	N/A	N/A
	• Overhead Tank capacity	10,000 Ltrs	10,000 Ltrs	MR
15	Exit Signage.	Required	Provided	MR





16	Provision of Lifts.			
	• Pressurization of lift shaft	N/A	N/A	N/A
	• Pressurization of lift lobby	N/A	N/A	N/A
	• Communication in lift car	Required	Provided	MR
	• Firemen's grounding switch	Required	Provided	MR
	• Lift signage	Required	Provided	MR
17	Standby Power Supply	Required	Provided	MR
18	Refuge Area.			
	• Total area	N/A	N/A	N/A
	• Location	N/A	N/A	N/A
19	Fire Control Room			
	• Detector system panel	N/A	N/A	N/A
	• Flow switch panel	N/A	N/A	N/A
	• PA system panel	N/A	N/A	N/A
	• Battery backup	Required	Provided	MR
	• Building floor plans	N/A	N/A	N/A
20	Special Fire Protection Systems for Protection of Special Risks, if Any:	N/A	N/A	N/A


The fire protection systems provided in the building were tested/checked and found functional at the time of inspection.

Keeping in view compliance of the minimum standards on fire prevention and fire safety required under the rules, it is recommended to grant Fire Safety Certificate under rule 35 of the Delhi Fire Service Rule 2010.

Signature of the Inspecting Officer:   
Name :- R.K. Yadav  
Designation :- ADO (LN)

DO (ED)

  
DY. CPO F.T. plan  


NO E,  
FT letter is put up for approval  
  
Dy CPO (N/2) 10/12/19