

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE: NEW DELHI-110001

No. F.6/DFS/MS/EH/2019/SZ/ 25

Dated: 17/01/2020

FIRE SAFETY CERTIFICATE

Certified that M/s **Gastronomica Kitchen & Bar** (A unit of Delicious Concepts Pvt. Ltd) situated at M-55, M Block Market, Greater Kailash-I, New Delhi-110048, running at 2nd Floor of a building comprised of **basement, ground & two upper floors** was issued FSC in the name & style of M/s **KYC** (A unit of Yum Restaurants India Pvt. Ltd) by this department vide letter No. F.6/DFS/MS/2012/EH/3129 dated 29/08/2012. The said premise was re-inspected by the officer concerned of this department on 09/01/2019 in the presence of Sh. Subhash Goel of the restaurant and found that the said premises have deemed complied with the fire prevention and fire safety requirements in accordance with Rule 33 of the Delhi Fire Service Rules, 2010 and that the premises is fit for occupancy class "**Assembly, Group-D**" (Restaurant) with effect from the date of issue of this certificate for a period of **three years** in accordance with Rule 36 unless renewed under Rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under Rule 38 of the Delhi Fire Service Rules-2010.

Issued on 17/01/2020 at New Delhi by


(Rajesh Panwar)
Dy. Chief Fire Officer
Tel. 011-26189168

Copy to: -

1. The Director M/s Delicious Concepts Pvt. Ltd at M-55, 2nd Floor, M Block Market, Greater Kailash-I, New Delhi-110048
2. The Dy. Health Officer, South Delhi Municipal Corporation, South Zone, Aurobindo Marg, Green Park, New Delhi-110016

Conditions for the validity of Fire Safety Certificate: -

1. All the means of escape/entry/exit shall be kept free from any obstruction.
2. All the fire safety arrangement provided therein shall be maintained in good working condition at all time as seen during inspection. Any loss of life property due to non-functional fire safety measures shall be at the responsibility of the management.
3. All the staff members must know the correct method of operation of fire fighting system.
4. The owner/occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on www.dfs.delhigovt.nic.in
5. This fire safety certificate may not in any way be treated as regularization (Clause 2.8 of UBBL-2016) of unauthorized construction or alteration (Clause 1.4.3 of UBBL-2016), if any.
6. "The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in form 'J' [sub rule (I) of rule 37] along with a copy of this Certificate, six month prior to its expiry."

INSPECTION REPORT

1	Name & Address of the Building	M/s Gastronomica Kitchen & Bar (U/o Delicious Concepts Pvt. Ltd) at 2 nd Floor, M-55, M Block Market, Greater Kailash-I, New Delhi-110048		
2	Type of Occupancy	Assembly, "Group-D" (Restt. at 2nd Floor only)		
3	Building Comprised of	Ground & Two Upper Floors.		
4	Type of Case	Renewal		
5	Details of Previous NOC	F.6/DFS/MS/2012/EH/3129 dated 29/08/2012 in f/o M/s KYC (Yum Restaurants India Pvt. Ltd)		
6	Fire Safety Directives Letter No	Nil		
7	Date of Inspection	09-01-2020		
8	Name of the Inspecting Officers	ADO (SJ) Mehmood		
9	Name & Designation of Officers from the building side	Mr. Subhash Goel		
10	Year of construction	Before 1990		
11	Applicant letter No.	Outdoor Diary No. 19173 dated 29/08/2019		
S. No.	Minimum standards on Fire Prevention and Fire Safety U/R 33	Requirement Old NOC	Provided at Site	Remarks MR/NMR
1	Access to Building.			
	<ul style="list-style-type: none"> Road width Gate width Width of internal road 	4.5 mtr -NA- -NA-	Provided -NA- -NA-	MR -NA- -NA-
2	Number, width, type & arrangement of exits.			
	a) Number of Staircase			
	<ul style="list-style-type: none"> Upper floors. Lower ground floor. 	2 Nos -NA-	2 Nos -NA-	MR -NA-
	b) Width of Staircase			
	<ul style="list-style-type: none"> Upper floors Basement floor 	As per circular dated 22.03.2005 -NA-	1.5m & 1m -NA-	MR -NA-
	c) Protection of exits			
	<ul style="list-style-type: none"> Fire check door Pressurization 	Required -NA-	Provided -NA-	MR -NA-
	d) No. of continuous staircase to terrace	One	Provided	MR
	e) Width of corridor	-NA-	-NA-	-NA-
	f) Door size	2 Exits	Provided	MR
3	Compartmentation.			
	<ul style="list-style-type: none"> Fire check door. Sealing of electrical shafts. Fire rating of shaft door. Water curtain Fire dampers. 	-NA- -NA- -NA- -NA- -NA-	-NA- -NA- -NA- -NA- -NA-	-NA- -NA- -NA- -NA- -NA-
4	Smoke Management system.			
	<ul style="list-style-type: none"> Basements Upper Floor 	30 ACPH 12 ACPH	-NA- Exhaust fan	-NA- MR
5	Fire Extinguishers.			
	<ul style="list-style-type: none"> Total numbers Types ISI Marking 	Required ISI marked	08 Nos ABC & CO ₂ Provided	MR MR MR
6	First Aid Hose Reels.			
	<ul style="list-style-type: none"> Total numbers on each floor. Length of hose-reel hose. Nozzle Diameter 	Hose Reel	One 30m 5mm	MR MR MR
7	Automatic fire detection & alarming system.			
	<ul style="list-style-type: none"> Type of detectors Location of Main Panel Location of Repeater Panel Alternate source of power Hooter's location 	Smoke/Heat Required -NA- Required Required	Provided Provided -NA- Provided Provided	MR MR -NA- MR MR

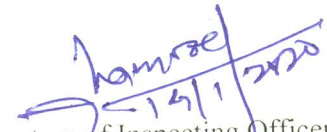
8	MOEFA	Required	Provided	MR
9	Public Address System	-NA-	-NA-	-NA-
10	Automatic Sprinkler System			
	<ul style="list-style-type: none"> Basement 	-NA-	-NA-	-NA-
	<ul style="list-style-type: none"> Upper floors 	Required	Provided	MR
	<ul style="list-style-type: none"> Sprinkler above false ceiling 	-NA-	-NA-	-NA-
11	Internal Hydrants.			
	<ul style="list-style-type: none"> Size of Riser/Down-comer 	Required	100mm	MR
	<ul style="list-style-type: none"> Number of Hydrant per floor 	Required	One	MR
	<ul style="list-style-type: none"> Hose box. 	Required	One	MR
12	Yard Hydrants.			
	<ul style="list-style-type: none"> Total number of hydrants. 	-NA-	-NA-	-NA-
	<ul style="list-style-type: none"> Hose box. 	-NA-	-NA-	-NA-
13	Pumping arrangements.			
	<ul style="list-style-type: none"> Ground Level <ul style="list-style-type: none"> Discharge of main pump. Head of main pump. Number of main pumps. Jockey Pump output. Jockey Pump head. Standby Pump output. Standby Pump head. Auto Starting/Manual Stopping. Pump house access. 	-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
	<ul style="list-style-type: none"> Terrace Level <ul style="list-style-type: none"> Discharge of pump. Head of pump. Power supply. Auto starting of pump. 	450 & 180 LPM	Provided	MR
		30m	Provided	MR
		Required	Provided	MR
		Required	Provided	MR
14	Captive water storage for fire fighting.			
	<ul style="list-style-type: none"> Underground tank capacity. 	-NA-	-NA-	-NA-
	<ul style="list-style-type: none"> <ul style="list-style-type: none"> Draw-off connection. 	-NA-	-NA-	-NA-
	<ul style="list-style-type: none"> <ul style="list-style-type: none"> Fire Service Inlet. 	Required	Provided	MR
	<ul style="list-style-type: none"> <ul style="list-style-type: none"> Access to tank. 	-NA-	-NA-	-NA-
	<ul style="list-style-type: none"> Overhead tank capacity. 	10,000 Ltr	Provided	MR
15	Exit Signage.	Required	Provided	MR
16	Provision of Lifts.			
	<ul style="list-style-type: none"> Pressurization of lift shaft. 	-NA-	-NA-	-NA-
	<ul style="list-style-type: none"> Pressurization of lift lobby. 	-NA-	-NA-	-NA-
	<ul style="list-style-type: none"> Communication in lift car. 	-NA-	-NA-	-NA-
	<ul style="list-style-type: none"> Fireman's switch. 	-NA-	-NA-	-NA-
	<ul style="list-style-type: none"> Lift signage. 	-NA-	-NA-	-NA-
17	Standby Power Supply	Required	Provided	MR
18	Refuge Area			
	<ul style="list-style-type: none"> Total area 	-NA-	-NA-	-NA-
	<ul style="list-style-type: none"> Location 	-NA-	-NA-	-NA-
19	Fire Control Room.			
	<ul style="list-style-type: none"> Detector system panel. 	-NA-	-NA-	-NA-
	<ul style="list-style-type: none"> Flow switch panel. 	-NA-	-NA-	-NA-
	<ul style="list-style-type: none"> PA system panel. 	-NA-	-NA-	-NA-
	<ul style="list-style-type: none"> Battery backup. 	-NA-	-NA-	-NA-
	<ul style="list-style-type: none"> Building floor plan. 	-NA-	-NA-	-NA-
20	Special Fire Protection System for the Protection of Special Risk, if any.	-NA-	-NA-	-NA-

N/ -7


M/s Gastronomica Kitchen & Bar at 2nd Floor, M-55 M Block Market, Greater Kailash-I, New Delhi-110048


The fire protection system provided in the restaurant premises were checked, tested at random and found functional at the time of inspection. Keeping in view of the deemed compliance of the minimum standards of fire prevention and fire safety measures as required under the rules, the fire safety certificate issued vide letter No. F.6/DFS/MS/2012/EH/3129 dated 29/08/2012 in favour of M/s KYC (Yum Restaurants India Pvt. Ltd), renewal under Rule 37 of the Delhi Fire Service Rules, 2010 is recommended in favour of M/s Gastronomica Kitchen & Bar (Delicious Concepts Pvt. Ltd)).

Accordingly, DFA is put up for approval and signature please.


Signature of Inspecting Officer
Name: Mehmood
Design: ADO (SJ)

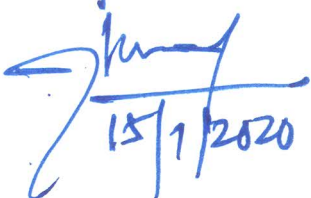
DO (SD)


15/01/2020


By CRO - 


15/1

DO (SD)

Sir A G.T. letter put up for Approval

15/1/2020
ADO (SJ)

Adopted


15/1

DO (SD)