

FORM 'H'
FORM FOR ISSUING FIRE SAFETY CERTIFICATE
[Refer sub - rule (1) of rule 35]
GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEAD QUARTERS: DELHI FIRE SERVICE, CONNAUGHT PLACE,
NEW DELHI


No. F6/DFS/MS/2020/53

Dated: 20/01/2020

FIRE SAFETY CERTIFICATE

Certified that the **M2K Entertainment Pvt. Ltd, Plot no 4. Road no. 44, Community Center, Pitampura, New Delhi** comprised B1+B2 +Ground + 03 Upper Floors was issued FSC vide Letter No. F6/DFS/MS/Cinema/2016/WZ/139 dated 20/01/2016. The premises was re inspected by the officers concerned of this department on **16-01-2020** in the presence of **Mr. Sanjay Koul (President)** and found that the said building have deemed complied with the fire prevention and fire safety requirements in accordance with rule 33 of the Delhi Fire Service Rule, 2010 and that the premises is fit for occupancy class "Mercantile & Assembly Building" Group F & Group D with effect from 20/01/2020 for a period of three years in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules, 2010.

Issued on 20/01/2020 at New Delhi by.


(Atul Garg)
Director
01/02/2020

Copy to:

Sh. Sanjay Koul (President), M2K Entertainment Pvt Ltd, Plot no 4. Road no. 44, Community Center, Pitampura, New Delhi.

Following fire safety directives must be adhered to:-

1. All the fire safety arrangements provided therein shall be maintained in good working condition at all times.
2. Any loss of life or property due to non-functional fire safety measures shall be at the risk and responsibility of the management.
3. The trained staff should be available round the clock.
4. Any deviations w.r.t. construction shall be verified by the concerned building sanctioning agency.
5. The certificate may not be treated in any case for the regularization of the unauthorized construction, if any.
6. Basement shall be used as per building bye laws.
7. The owner/ occupier shall apply for renewal of this Fire Safety Certificate to the Director in Form 'J' [sub rule (1) of rule 37] along with a copy of this certificate, six months prior to its expiry.
8. The owner/occupier shall submit a declaration every year in the form 'K' provided in the first schedule of Delhi Fire Service Rules 2010, form is available on www.dfs.delhigovt.nic.in.
9. All the doors, Exits and internal roads must be kept free from any obstruction.
10. The owner/occupier has submitted undertaking that lift will not be used in the basement and shall run from ground to upper floor only. The earth filling portion shown in the plan of second basement found excavated that portion shall be kept closed by brick work and shall not be used for any purpose.

INSPECTION REPORT

1. Name & address of the building: M2K Entertainment Pvt Ltd, Plot no 4.Road no. 44,
community center, Pitampura, New Delhi
2. Type of Occupancy : Class- F (Mercantile)
3. Type of Case : Renewal
4. Details of previous NOC : F6/DFS/MS/Cinema/2016/WZ/139dated 20/01/2016
5. Fire Safety directives Letter No. : Letter No. F6/DFS/MS/BP/1611 Date 21-07-2003 &
F6/DFS/MS/2004/468 dated 27/02/2004
6. Date of inspection : 16-01-2020
7. Name of the Inspecting Officer : ADO (WP)
8. Name and designation of Officer
from the building side : Mr. Sanjay Koul
9. Year of Construction : 2004-05
10. Applicant's letter No. : Nil Dated 13/01/2020

S No	Minimum standards on fire prevention and fire safety U/R 33	BBL Requirements	Provided at site	Remarks MR/NMR
1.	Access of building			
	• Road width	09mtrs	24mtr	MR
	• Gate width	5 mtr	Provided	MR
	• Width of internal road	6 m	Provided as per DDA control drawing	MR (old case)
2.	Number, width, Type & Arrangements of exits			
	a. Number of staircases			
	• Upper floors	2	4 provided	MR
	• Basements	2+1 Ramp	Provided	MR
	b. Width of staircases			
	• Upper floors	2x1.5mtrs	2x 170cm 2X145cm	MR being old case
	• Basements	2x1.5mtrs	Provided	MR being old case
	c. Protection of exits			
	• Fire check door	Required	Provided	MR
	• Pressurization	NA	NA	NA
	d. No of continuous staircase to terrace	02	Provided	MR
	e. Width Of Corridor	1.5m	Provided (Old case)	MR Being old case
	f. Door Size	1m	Provided(Old case)	MR Being old case

3.	Compartmentation			
	• Fire check door	Required	Provided	MR
	• Sealing of electrical shafts	Required	Provided	MR
	• Fire Rating of shaft door	Required	Provided	MR
	• Water Curtain	Required	Provided	MR
	• Fire Dampers	Required	Provided	MR
4.	Smoke managements System			
	• Basements	Required	Provided	MR
	• Upper floors	Required	Provided	MR
5.	Fire Extinguishers			
	• Total numbers	22	Provided	MR
	• Types	ABC,CO2 type	Provided	MR
	• IS marking	ISI marked	Provided	MR
6.	First – Aid Hose Reels			
	• Total numbers on each floor	3	Provided	MR
	• Length of hose reel hose	30 m	Provided	MR
	• Nozzle diameter	5 mm	Provided	MR
7.	Automatic fire detection and alarming system			
	• Type of detectors	Required	Provided	MR
	• Location of Main Panel	Ground floor	Provided	MR
	• Location of Repeater Panel	Each floor	Provided	MR
	• Alternate source of power	Required	Provided	MR
	• Hooters' Location	Required	Provided	MR
8.	MOEFA	Required	Provided	MR
9.	Public Address System	Required	Provided	MR
10.	Automatic Sprinkler System			
	• Basements	Required	Provided	MR
	• Upper Floor	Required	Provided	MR
	• Sprinkler above false ceiling	Required	Provided	MR
11.	Internal Hydrants			
	• Size of riser/down- comer	150 mm	Provided	MR
	• No. of hydrants per floor	3	Provided	MR
	• Hose Box	3	Provided	MR
12.	Yard Hydrants			
	• Total no. of hydrants	Required	Provided	MR
	• Hose Box	Required	Provided	MR
13.	Pumping Arrangements			
	• Ground Level			
	• Discharge of main pump	2850LPM	Provided	MR
	➤ Head of main pump	60 mtr	Provided	MR
	➤ Number of main pumps	1	Provided	MR
	➤ Jockey pump out put	180 lpm	Provided	MR
	➤ Jockey pump head	60 m	Provided	MR
	➤ Standby Pump out put	2850lpm	Provided	MR
	➤ Standby Pump Head	60 mtr	Provided	MR
	➤ Auto Staring/Manual stopping	Required	Provided	MR
	➤ Pump House Access	Required	Provided	MR
	• Terrace level			
	➤ Discharge of pump	900lpm	Provided	MR
	➤ Head of the pump	NA	Provided	MR

	➤ Power supply	NA	Provided	MR
	➤ Auto starting of pump	NA	Provided	MR
Captive water Storage for fire fighting				
	• Under ground tank capacity	1,000,00litres	Provided	MR
	➤ Draw of connection	Required	Provided	MR
	➤ Fire service inlet	Required	Provided	MR
	➤ Access to tank	Required	Provided	MR
	• Overhead Tank capacity	20, 000 litres	Provided	MR
15.	Exit Signage	Required	Provided	MR
16.	Provision of Lifts : Lift shall run from ground to upper floor only			
	➤ Pressurization of Lift Shaft	Required	Provided	MR
	➤ Pressurization of lift lobby	NA	NA	As lift lobby is not shown in DDA sanction plan.
	➤ Communication in lift Car	Required	Provided	MR
	➤ Fireman's Grounding Switch	Required	Provided	MR
	➤ Lift Signage	Required	Provided	MR
17.	Standby power supply	Required	Provided	MR
18.	Refuge Area			
	➤ Total area	NA	NA	NA
	➤ Location	NA	NA	NA
19.	Fire control room			
	➤ Detector system panel	Required	Provided	MR
	➤ Flow Switch Panel	Required	Provided	MR
	➤ PA System Panel	Required	Provided	MR
	➤ Battery backup	Required	Provided	MR
	➤ Building Floor Plans	Required	Provided	MR
20.	Special Fire Protection Systems for Protection of special Risks, if any;	NA	NA	NA

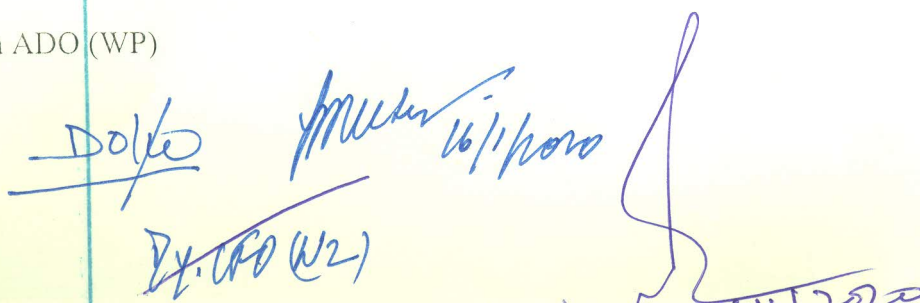
In view of the deemed compliance of minimum standards on fire prevention and fire safety as required under the rules the NOC issued vide letter no. F6/DFS/MS/Cinema/2016/WZ/139 dated 20/01/2016 renewal under rule 35 of the Delhi Fire Service Rules 2010 is recommended.

Note : - The owner/occupier has submitted undertaking that lift will not be used in the basement and shall run from ground to upper floor only. The earth filling portion show in the plansst second basement found excavated that portion shall be kept closed by brick work and shall not be used for any purpose.


Signature of the Inspecting Officer

Name Udai Vir Singh

Designation ADO (WP)


DO/16/1/2020
16/1/2020
By: ADO (WZ)