

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS, DELHI FIRE SERVICE, NEW DELHI


No.F6/DFS/MS/FW/2019/ 110

Dated: 19/02/2020

FIRE SAFETY CERTIFICATE

Certified that M/s **Master-G, Fire Work, at Shop No. G-12, R.G. Bazar, CSC, Sector-11, Rohini, Delhi-110085** at ground floor of building comprised of **Ground+1 upper floor** owned/occupied by **Master-G Sec-11, Rohini Fire Work** was issued Fire Safety Certificate by this department vide letter **No. F.6/DFS/MS/FW/2016/WZ/1586 dated 26.10.2016**. The premises was re-inspected by the officer concerned of this department on 8.12.2019 in presence of **Sh. Akhil** and observed the premises is deemed complied with fire prevention and fire safety requirements in accordance with Guidelines issued by Additional Commissioner of Police (Lic) and fit for occupancy Class Fire Works with effect from 19/02/2020 for a period of three years in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under Rule 40 and subject to compliance of conditions under rule 38 of Delhi Fire Service Rules-2010

Issued on. 19/02/2020 at New Delhi.


(Dharmpal Bhardwaj)
Dy. Chief Fire Officer
Ph-011-25156707

Copy to:-

1. Sh. Akhil & Nikhil S/o Late Sh. Suraj Bhan, R/o Y-91,92, Camp No.1, Nangloi, Delhi 110041
2. The Additional Commissioner of Police, Licensing, Police Station, 1st floor, Defense Colony, New Delhi

Conditions for the validity of fire safety certificate

1. All the means of escape/entry/exit shall be kept free from any obstruction.
2. All the fire protections measures shall be maintained in perfect conditions all the time as seen during inspection.
3. All the staff members must know the correct method of operation of fire fighting system.
4. Any lapse rendering fire fighting system/equipment non-functional shall be the risk and responsibility of the management.
5. This inspection report may not in any way be treated as regularization of unauthorized construction, if any.
6. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in form 'J' [sub rule (I) of rule 37] along with a copy of this Certificate, six month prior to its expiry".
7. The owner/occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rules 2010. the form is available on

http://www.delhi.gov.in/wps/wcm/connect/doi_fire/FIRE/Home/Fire+Safety+Acts+and+Rules/ http://www.delhi.gov.in/wps/wcm/connect/doi_fire/FIRE/Home/Forms

INSPECTION REPORT


1. Name & address of the building : M/s Master-G, Fire Work, at Shop No. G-12, R.G. Bazar CSC, Sector 11, Rohini, Delhi-110085
2. Type of Occupancy : Class Fire Works (Gr. Floor)
3. Type of Case : Renewal
4. Details of Previous NOC : F6/DFS/MS/FW/WZ/2016/1586 Dated 26/10/2016-
5. Fire Safety directives letter No : N/A
6. Date of inspection : 08/12/2019
7. Name of Inspecting Officer : A.K. Sharma
8. Name and designation of officers : Sh. Akhil & Sh. Nikhil
- From the building side : N/A
9. Year of Construction : N/A
10. Applicant's letter No. : 1017/Addl.CP/Lic.(Expl.) Dated 21/11/2019

S. No.	Point of Inspection	Requirement	Provided at site	Remarks MR/NMR
1.	Type of construction and floor area & floor level			
	a. Minimum floor area	Accessible	Accessible	MR
	b. Construction	Pucca	Provided	MR
	c. Premises Location	Not under the staircase/Mean of escape	Provided	MR
	d. Business permissible only at ground floor level	Required	Provided	MR
	e. Business from pavement of road prohibited	Prohibited	Provided	MR
2.	Entrance & Exits to the Licensed Premises			
	The Licensed premises shall have independent entrance and exit	Required	Provided	MR
3.	Type and distance of the surrounding risk			
	The premises shall be situated at a distance of 15m from any such premises used for similar explosive/inflammable or hazardous material	Required 15m	Provided	MR
4.	Nature of business run in the licensed premises			
	The premises in which fireworks are kept shall be used only for possession and sale for fireworks and no other purpose	Required	Provided	MR
5.	Type of electrical wiring and electrical fitting			
	a. Preferably concealed or through conduit	Required	Provided	MR
	b. All electrical fitting should be flame/spark proof	Required	Provided with Casing & Capping	MR
6.	Extension of shop for business			
	Prohibited	Prohibited	Yes	MR
7.	Approach Road			
	The road width on the side of which premises is located should be 12m	12m	12m	MR
8.	Fire Protection Arrangement			
	a. Extinguisher Type and No's	7no. of Water type & ABC/CO ₂ type	Provided	MR
	b. Sand and water buckets	3 No's Each	Provided	MR
	c. Water Drum	1 No.	Provided	MR
9.	Any Other point that is contrary to the safety of people-NA-			

The fire protection systems provided in the building premises were test checked and found functional at the time of inspection.

Keeping in view of the deemed compliance of the minimum standards of the fire prevention and fire safety measures as required under the DFS rules of NOC issued vide letter no.F6/DFS/MS/FW/WZ/2016/1586 Dated 26/10/2016, renewal under rule 37 of the Delhi Fire Service rules 2010, is recommended.

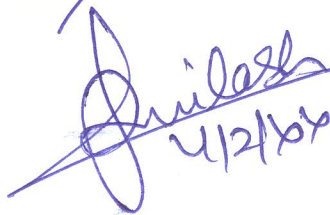
Accordingly DFA is put up for approval for signature please

 30/11/17


Signature of the Inspecting Officer
Name Ajay Kumar Sharma
Designation ADO(Rohini)

Received on 4/2/18

Do (wz)


 4/2/18

By ADO (wz)

 6/1/2018

ADP Refuse - FT

FT letter is put up for signature please

 6/2/2020

DEFO (wz)

 11/2/2020

Noted