

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE: NEW DELHI-110001

No. F.6/DFS/MS/School/2020/SZ/ 65

Dated: 24/02/2020

FIRE SAFETY CERTIFICATE

Certified that the NGF Junior School located at T-21, Khirki Extn. Malviya Nagar, New Delhi-110017 comprised of two blocks A block- Ground plus One Upper Floors, B block- Basement, Ground plus One and Half upper upper floors was granted fire safety certificate by this department vide letter No. F6/DFS/MS/SZ/School/2016/825 Dated 19/05/2016. The premises was re-inspection by officer concerned by this department on 13/11/2019 in the presence of Mrs. Vanita (Principal) of the school and found that fire prevention and fire safety requirements have deemed complied in accordance with the rule 33 of Delhi Fire Service Rules 2010 and that the school building is fit for occupancy class Education Building, Group-B as above with effect from the date of issue of this certificate for a period of Three years, in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under rule 40 and subject to compliance of the condition under rule 38 of the Delhi Fire Service Rules 2010.

Issued on 24/02/2020 at New Delhi by


18/2/2020

(S S Tuli)

Dy. Chief Fire Officer

Tel. 011-26189168



Copy to: -

1. The Principal, NGF Junior School, T-21, Khirki Extn. Malviya Nagar, New Delhi-110017
2. The Director of Education, Govt. of NCT of Delhi, Old Secretariat, New Delhi.

Conditions for the validity of Fire Safety Certificate

1. All the means of escape/entry/exit shall be kept free from any obstruction.
2. All the fire safety arrangements provided therein shall be maintained in good working condition at all time as seen during inspection. Any loss of life or property due to non-functional fire safety measures shall be at the responsibility of the management.
3. All the staff members must know the correct method of operation of firefighting system.
4. This Certificate cannot be treated as regularization of unauthorized construction, if any.
5. The owner/occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rules-2010.
6. The Owner/Occupier shall apply for renewal of this Fire Safety Certificate to the Director in the form 'J' [sub rule (1) of rule 37] along with copy of this certificate, six months prior to its expiry. The form is available on www.dfs.delhigovt.nic.in.

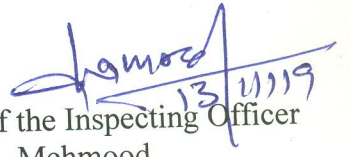
N/11

INSPECTION REPORT

1	Name & Address of the Building	NGF Junior School, T-21, Khirki Extn. Malviya Nagar, New Delhi-110017		
2	Type of Occupancy	Educational, Group-B (School)		
3	Building Comprised of	Two Blocks- A block- Ground plus One upper floors, B block- Basement, Ground Plus One and Half upper floors.		
4	Type of Case	Renewal		
5	Details of Previous NOC	F6/DFS/MS/SZ/School/2016/825 Dated 19/05/2016		
6	Fire Safety Directives Letter No	Nil		
7	Date of Inspection	13/11/2019		
8	Name of the Inspecting Officers	Mehmood, ADO (SJ)		
9	Name & Designation of Officers from the building side	Mrs. Vanita (Admin)		
10	Year of construction	2005 & 2015		
11	Applicant letter No.	Nil dated 05/09/2019		
S. No.	Minimum standards on Fire Prevention and Fire Safety U/R 33	As Per Old NOC-	Provided at Site	Remarks MR/NMR
1	Access to Building.			
	• Road width	6m	6m	MR
	• Gate width	4m	Abutting on Road	MR
	• Width of internal road	-NA-	-NA-	-NA-
2	Number, width, type & arrangement of exits.			
	a) Number of Staircase			
	➤ Upper floors.	01No	02Nos in each block	MR
	➤ Basement floor.	01No	02nos	MR
	b) Width of Staircase			
	➤ Upper floors	1.50m	A block-1.25m & 1.1m B block-1.22m & 1.17m	MR
	➤ Basement floor	1.50m	1.22m & 1.17m	MR
	c) Protection of exits			
	➤ Fire check door	Required	Provided	MR
	➤ Pressurization	-NA-	-NA-	-NA-
	d) No. of continuous staircase to terrace	01 No	Provided	MR
	e) Width of corridor	1.5m	1.66m	MR
	f) Door size	1m	1m	MR
3	Compartmentation.			
	• Fire check door.	Required	Provided	MR
	• Sealing of electrical shafts.	-NA-	-NA-	-NA-
	• Fire rating of shaft door.	-NA-	-NA-	-NA-
	• Water curtain	-NA-	-NA-	-NA-
	• Fire dampers.	-NA-	-NA-	-NA-
4.	Smoke Management system.			
	• Basement	30 ACPH	Exhaust Fan	MR
	• Upper floors	12 ACPH	-NA-	-NA-
5.	Fire Extinguishers.			
	• Total numbers	10 Nos	10Nos	MR
	• Types	ABC / CO2	ABC & Co2	MR
	• ISI Marking	ISI marked	Provided	MR
6.	First Aid Hose Reels.			
	• Total numbers on each floor.	01 no	Provided at each floor	MR
	• Length of hose-reel hose.	30m	Provided	MR
	• Nozzle Diameter	5m	Provided	MR

7.	Automatic fire detection & alarming system.			
	• Type of detectors	-NA-	-NA-	-NA-
	• Location of Main Panel	-NA-	-NA-	-NA-
	• Location of Repeater Panel	-NA-	-NA-	-NA-
	• Alternate source of power	-NA-	-NA-	-NA-
	• Hooter's location	-NA-	-NA-	-NA-
8.	MOEFA	-NA-	-NA-	-NA-
9.	Public Address System	-NA-	-NA-	-NA-
10.	Automatic Sprinkler System			
	• Basement	Required	Provided	MR
	• Upper floors	-NA-	-NA-	-NA-
	• Sprinkler above false ceiling	-NA-	-NA-	-NA-
11.	Internal Hydrants.			
	• Size of Riser/Down-comer	-NA-	-NA-	-NA-
	• Number of Hydrant per floor	-NA-	-NA-	-NA-
	• Hose box.	-NA-	-NA-	-NA-
12.	Yard Hydrants.			
	• Total number of hydrants.	-NA-	-NA-	-NA-
	• Hose box.	-NA-	-NA-	-NA-
13.	Pumping arrangements.			
	• Ground Level			
	➤ Discharge of main pump.	-NA-	-NA-	-NA-
	➤ Head of main pump.	-NA-	-NA-	-NA-
	➤ Number of main pumps.	-NA-	-NA-	-NA-
	➤ Jockey Pump output.	-NA-	-NA-	-NA-
	➤ Jockey Pump head.	-NA-	-NA-	-NA-
	➤ Standby Pump output.	-NA-	-NA-	-NA-
	➤ Standby Pump head.	-NA-	-NA-	-NA-
	➤ Auto Starting / Manual Stopping.	-NA-	-NA-	-NA-
	➤ Pump house access.	-NA-	-NA-	-NA-
	• Terrace Level			
	➤ Discharge of pump.	900 LPM	900LPM	MR
	➤ Head of pump.	40m	40m	MR
	➤ Power supply.	Required	Provided	MR
	➤ Auto starting of pump.	Required	Provided	MR
14.	Captive water storage for firefighting.			
	• Underground tank capacity.	-NA-	-NA-	-NA-
	➤ Draw-off connection.	-NA-	-NA-	-NA-
	➤ Fire Service Inlet.	-NA-	-NA-	-NA-
	➤ Access to tank.	-NA-	-NA-	-NA-
	• Overhead tank capacity.	15,000liter	Provided	MR
15.	Exit Signage.	Required	Provided	MR
16.	Provision of Lifts.			
	• Pressurization of lift shaft.	-NA-	-NA-	-NA-
	• Pressurization of lift lobby.	-NA-	-NA-	-NA-
	• Communication in lift car.	-NA-	-NA-	-NA-
	• Fireman's switch.	-NA-	-NA-	-NA-
	• Lift signage.	-NA-	-NA-	-NA-
17.	Standby Power Supply	-NA-	-NA-	-NA-
18.	Refuge Area			
	• Total area	-NA-	-NA-	-NA-
	• Location	-NA-	-NA-	-NA-

113

19.	Fire Control Room.			
	• Detector system panel.	-NA-	-NA-	-NA-
	• Flow switch panel.	-NA-	-NA-	-NA-
	• PA system panel.	-NA-	-NA-	-NA-
	• Battery backup.	-NA-	-NA-	-NA-
	• Building floor plan.	-NA-	-NA-	-NA-
20.	Special Fire Protection System for the Protection of special Risk, if any.			
The Fire protection systems provided in the premises were checked / operated at random and found functional at the time of inspection				
Keeping in view the deemed compliance of the minimum standards on fire prevention and fire safety measures as required under the rules 35, FSC issued vide letter No. F6/DFS/MS/SZ/School/2016/825 Dated 19/05/2016, renewal under rule 37 of the Delhi Fire Service rules, 2010 is recommended.				
Accordingly DFA is put up for approval and signature please.				
			 Signature of the Inspecting Officer Name: Mehmood Design: ADO (SJ)	

DO (SD)

Ring
14/11

DEFO (S2)


Ring
15/11

DO (S2)

SW
15/11

ADO (SJ)

Sir, A letter put up for signature please.


18/11/19
ADO (SJ)

Dycho (S2)

