

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEAD QUARTERS: DELHI FIRE SERVICE: NEW DELHI – 110001

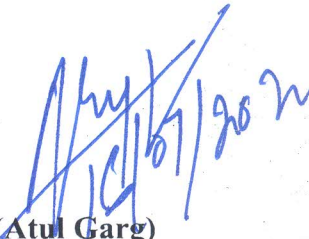
No. F.6/DFS/MS/Indl./SZ/2020/ 264

Dated: 17 / 07 /2020

FIRE SAFETY CERTIFICATE

Certified that **M/s Frontier Autoworld Pvt Ltd., Plot No. D-81, Okhla Industrial Area Phase-I, New Delhi,** is comprised of Basement, Stilt, Ground + two upper floors owned/ occupied by M/s Frontier Autoworld Pvt Ltd. have complied with the fire prevention and fire safety requirements in accordance with rule 33 of the Delhi Fire Service Rule, 2010 and verified by the officers concerned of this department on **09/07/2020** in the presence of Mr. Ashok Sharma (AGM) & Mr. Ramesh Kumar (JE/SDMC) and found that the said building / premises is fit for occupancy class “ **Industrial” Group-G-2** with effect from **17 / 07 /2020** for a period of three years in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules, 2010.

Issued on **17 / 07 /2020** at New Delhi by


(Atul Garg)
Director
Delhi Fire Service

Copy to:

1. M/s Frontier Autoworld Pvt. Ltd., Plot No. D-81, Okhla Industrial Area Phase-I, New Delhi,
2. The Executive Engineer (Building), SDMC, Jal Vihar, Lajpat Nagar, New Delhi-110024.

Following fire safety directives must be adhered to:-

1. All the fire safety arrangements provided therein shall be maintained in good working condition at all times.
2. Any loss of life or property due to non-functional fire safety measures shall be at the risk and responsibility of the management.
3. The trained staff should be available round the clock.
4. Any deviations w.r.t. construction shall be verified by the concerned building sanctioning agency.
5. The certificate may not be treated in any case for the regularization of the unauthorized construction, if any.
6. Basement shall be used strictly as per Building Bye Laws.
7. The owner/ occupier shall apply for renewal of this Fire Safety Certificate to the Director in Form ‘J’ [sub rule (1) of rule 37] along with a copy of this certificate, six months prior to its expiry.
8. The owner/occupier shall submit a declaration every year in the form ‘K’ provided in the first schedule of Delhi Fire Service Rules 2010, form is available on www.dfs.delhigovt.nic.in.

INSPECTION REPORT

1	Name & Address of the Building	M/s Frontier Autoworld Pvt Ltd., Plot No. D-81, Okhla Industrial Area Phase-I, New Delhi		
2	Type of Occupancy	Group-G (Industrial)		
3	Building Comprised of	Basement + Stilt+ Ground floor + 2 nd Upper Floors		
4	Type of Case	New		
5	Details of Previous NOC	Nil		
6	Fire Safety Directives Letter No	F.6/DFS/MS/2018/BP/386 dated 06/12/18		
7	Date of Inspection	09/07/2020		
8	Name of the Inspecting Officers	DO S.K.Dua, ADO Avtar Singh & ADO Bhupender Prakash.		
9	Name & Designation of Officers from the building side	Mr.Ashok Sharma (AGM), Mr. Ramesh Kumar (JE/SDMC)		
10	Year of construction	2020		
11	Applicant letter No.	Online no. 10056376 dated 07/07/2020		
S. No	Minimum standards on Fire Prevention and Fire Safety U/R 33	BBL/NBC Requirement	Provided at Site	Remarks MR/NMR
1	Access to Building.			
	➤ Road width	6 m	Provided	MR
	➤ Gate width	4.5 m	4.5 m	MR
	➤ Width of internal road	-N/A-	-N/A-	-N/A-
2	Number, width, type & arrangement of exits.			
	a) Number of Staircase			
	➤ Upper floors.	2 nos	Provided	MR
	➤ Basement floor.	2 nos	Provided	MR
	b) Width of Staircase			
	➤ Upper floors	1.50 m each	1.50 m each	MR
	➤ Basement floor	1.50 m each	1.50 m each	MR
	c) Protection of exits			
	➤ Fire check door	Required	Provided	MR
	➤ Pressurization	-NA-	-NA-	-NA-
	d)No. of continuous staircase to terrace	Two	Provided	MR
	e)Width of corridor	-NA-	-NA-	-NA-
	f) Door size	-NA-	-NA-	-NA-
3	Compartmentation.			
	• Fire check door.	Required	Provided	MR
	• Sealing of electrical shafts.	Required	Provided	MR
	• Fire rating of shaft door.	Required	Provided	MR
	• Water curtain	-NA-	-NA-	-NA-
	• Fire dampers	-NA-	-NA-	-NA-
4.	Smoke Management system.			
	• Basement	18 ACPH	Provided	MR
	• Upper floors	12 ACPH	Provided	MR
5.	Fire Extinguishers.			
	• Total numbers	22 nos	22 nos	MR
	• Types	ABC /Co2	ABC /Co2/ W.CO2/Foam	MR
	• ISI Marking	ISI marked	Provided	MR

6.	First Aid Hose Reels.			
	• Total numbers on each floor	Required	02 Nos. Each Floor	MR
	• Length of hose-reel hose.	30m	Provided	MR
	• Nozzle Diameter	5mm	Provided	MR
7	Automatic fire detection & alarming system.			
	• Type of detectors	Smoke & heat	Provided	MR
	• Location of Main Panel	Ground floor	Provided	MR
	• Location of Repeater Panel	Required	Provided	MR
	• Alternate source of power	Required	Provided	MR
	• Hooter's location	Required	Provided	MR
8.	MOEFA	Required	Provided	MR
9.	Public Address System	-N/A-	-N/A-	-N/A-
10.	Automatic Sprinkler System			
	• Basement.	Required	Provided	MR
	• Ground & Above floors	Required	Provided	MR
	• Sprinkler above false ceiling	-N/A-	-N/A-	-N/A-
11.	Internal Hydrants.			
	• Size of Riser / Down-comer	100mm	Provided	MR
	• Number of Hydrant per floor	Required	Provided	MR
	• Hose box.	Required	Provided	MR
12.	Yard Hydrants			
	• Total number of hydrants	04 Nos	04 Nos	MR
	• Hose box	Required	Provided	MR
13.	Pumping arrangements.			
	• Ground Level			
	➤ Discharge of main pump.	2280 LPM	2280 LPM	MR
	➤ Head of main pump.	56 m	56 mtr	MR
	➤ Number of main pumps.	01 no.	01 No	MR
	➤ Jockey Pump output.	180 LPM.	180 LPM	MR
	➤ Jockey Pump head.	56 m	56 m	MR
	➤ Standby Pump output.	2280 LPM	2280 LPM	MR
	➤ Standby Pump head.	56 m	56 mtr	MR
	➤ Auto Starting/Manual Stopping.	Required	Provided	MR
	➤ Pump house access	Required	Provided	MR
	• Terrace Level			
	➤ Discharge of pump.	900 LPM	900 LPM	MR
	➤ Head of pump.	60 m	60 m	MR
	➤ Power supply.	Required	Provided	MR
	➤ Auto starting of pump.	Required	Provided	MR
14.	Captive water storage for firefighting.			
	• Underground tank capacity.	2,00,000 Ltrs	2,00,000 ltrs	MR
	➤ Draw-off connection.	Required	Provided	MR
	➤ Fire Service Inlet.	Required	Provided	MR
	➤ Access to tank.	Required	Provided	MR
	• Overhead tank capacity.	50,000 ltrs	50,000ltrs	MR
15.	Exit Signage.	Required	Provided	MR

N/7

16.	Provision of Lifts.			
	• Pressurization of lift shaft.	-N/A-	-N/A-	-N/A-
	• Pressurization of lift lobby.	-N/A-	-N/A-	-N/A-
	• Communication in lift car.	Required	Provided	MR
	• Fireman's switch.	Required	Provided	MR
	• Lift signage.	Required	Provided	MR
17	Standby Power Supply	Required	Provided	MR
18.	Refuge Area			
	• Total area	-N/A-	-N/A-	-N/A-
	• Location	-N/A-	-N/A-	-N/A-
19.	Fire Control Room.			
	• Detector System Panel.	Required	Provided	MR
	• Flow Switch Panel.	Required	Provided	MR
	• PA system Panel.	Required	Provided	MR
	• Battery backup	Required	Provided	MR
	• Building floor plan	-N/A-	-N/A-	-N/A-
20.	Special Fire Protection System for the Protection of special Risk, if any.	Required for HT/LT panels	02 ABC fire extinguishers provided near LT Panel	MR

The Fire protection systems provided in the premises were test checked at random and found functional at the time of inspection.

Keeping in view the substantial satisfactory compliance of the minimum standards on fire prevention and fire safety measures as required under the rules, it is recommended to issue Fire Safety Certificate under rule 35 of the Delhi Fire Service Rules, 2010.

Accordingly, DFA is put up for approval and signature please.

Signature of the Inspecting Officer
Name: S. K. Dua
Designation: DO (SD)

Signature of the Inspecting Officer
Name: Avtar Singh
Designation: ADO (MR)

DCFO (SZ)

