

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEAD QUARTERS: DELHI FIRE SERVICE: NEW DELHI - 110001


No F 6/DFS/MS/2020/ 282

Dated: 14/08/2020

FIRE SAFETY CERTIFICATE

Certified that the **Govt. Boys Secondary School, D-Block Mangol Puri, Delhi-110083** comprised of **Ground + One upper floor** owned/occupied by **Govt Boys Secondary School** was granted FSC by this department vide letter No. **F.6/DFS/MS/School/2017/WZ/704 dated 17.05.2017**. The premises was re-inspected by the officer concerned of this department on **31.07.2020** in the presence of **M. Mahesh Kumar (Vice Principal)** and observed that all the fire prevention and fire safety arrangements as provided in the premises found in good working condition. The premises have deemed complied with requirements of circular issued by Director of Education letter no 3298-3398 dated 01.03.2011 and the building/ premise is fit for occupancy Group B Educational with effect from **14.08.2020** for a period of **three** years, subject to compliance of the conditions mentioned below:

Issued on **14.08.2020** at New Delhi


(Dhrampal Bhardwaj)
Dy.Chief Fire Officer
Tel;-01125156707

Copy to: -

1. The Director, Education, Government of N.C.T of Delhi. Old Sect. Delhi - 54.
2. The Principal, Govt. Boys Secondary School, D-Block Mangol Puri, Delhi-110083

Conditions for the validity of Fire Safety Certificate:

1. All the fire safety arrangement provided there-in shall be maintained in good working conditions at all times.
2. Loss of life or property due to non functional fire safety measure shall be at the responsibility of the management.
3. The trained fire fighting staff should be available round the clock.
4. Any deviation with regard to the construction etc shall be verified by the concerned building sanctioning agency.
5. This certificate cannot be treated in any case for regularizations of unauthorized construction.
6. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director of Form 'J' [sub rule (1) of rule 37] along with a copy of this Certificate, six months prior to its expiry".
7. The owner / occupier shall submit a declaration every year in form "K" provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on http://www.delhi.gov.in/wps/wcm/connect/doi_fire/FIRE/Home/Fire+Safety+Acts+and+Rules/ http://www.delhi.gov.in/wps/wcm/connect/doi_fire/FIRE/Home/Forms

1. Name & address of the building : Govt. Boys Secondary School, D. D. Road, Delhi-110083.
2. Type of Occupancy : Educational
3. Type of Case : Renewal (Gr. + Owo upper floor)
4. Details of previous NOC : F.6/DFS/MS/School/WZ/704 dated 17.05.2017
5. Fire Safety directives letter No : N/A
6. Date of inspection : 31.07.2020
7. Name of the Inspecting Officers : ADO (Rohini)
8. Name and designation of officers from the building side : Mr. Mahesh Kumar (Principal)
9. Year of Construction : 2009
10. Applicant's letter No. : GBSSS/D/MP/221 dated 22.04.2020, O.D. No5270 dated 15.06.2020

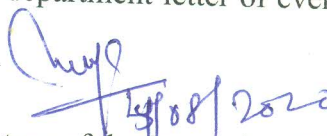
Plot Area-4000Sq m Cover Area-2375sq m No. of Class Rooms-42

	Minimum Standards on fire prevention and fire safety U/R 33	Circular of Director of Education	Provided at site	Remarks MR/NMR
1	Access to building			
	• Road width	Accessible	6.0 mtr	M/R
	• Gate width	Accessible	4.5 mtr	M/R
	• Width of internal road	N/A	N/A	N/A
2	Number, Width, Type & Arrangement of Exits			
	a. Number of staircases	N/A	N/A	N/A
	• Upper Floors	04	04	MR
	• Basements	N/A	N/A	N/A
	b. Width of staircases	1.50 mtr	1.5 mtr each	MR
	• Upper Floors			
	• Basements	N/A	N/A	N/A
	c. Protection of exits	N/A	N/A	N/A
	• Fire check door	N/A	N/A	N/A
	• Pressurization	N/A	N/A	N/A
	e. No. of continuous staircases to terrace	N/A	N/A	N/A
	g. Width of Corridor			
	h. Door Size	1.0 mtr	1.00 mtr	MR
3	Compartmentation.			
	• Fire check door	N/A	N/A	N/A
	• Sealing of electrical shafts	N/A	N/A	N/A
	• Fire Rating of shaft door	N/A	N/A	N/A
	• Water Curtain	N/A	N/A	N/A
	• Fire Dampers	N/A	N/A	N/A
4	Smoke Management System.			
	• Basements	30 a/c per hu	N/A	N/A
	• Upper floors		Natural ventilated	MR

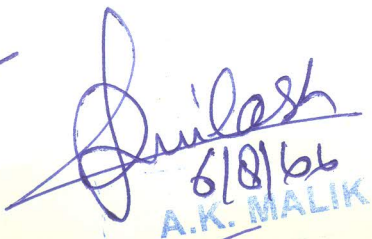
	➤ Auto Starting of pump	N/A	N/A	N/A
14	Captive Water Storage for fire fighting.			
	• Underground tank capacity	N/A	N/A	N/A
	➤ Draw-off connection	N/A	N/A	N/A
	➤ Fire service inlet	N/A	N/A	N/A
	➤ Access to tank	N/A	N/A	N/A
	• Overhead Tank capacity	N/A	N/A	N/A
15	Exit Signage.	N/A	N/A	N/A
16	Provision of Lifts.			
	• Pressurization of Lift Shaft	N/A	N/A	N/A
	• Pressurization of Lift lobby	N/A	N/A	N/A
	• Communication In lift Car	N/A	N/A	N/A
	• Fireman's Grounding Switch	N/A	N/A	N/A
	• Lift Signage	N/A	N/A	N/A
17	Standby power supply	N/A	N/A	N/A
18	Refuge Area.			
	➤ Total Area	N/A	N/A	N/A
	➤ Location	N/A	N/A	N/A
19	Fire Control Room			
	• Detector System Panel	N/A	N/A	N/A
	• Flow Switch Panel	N/A	N/A	N/A
	• PA System Panel	N/A	N/A	N/A
	• Batter backup	N/A	N/A	N/A
	• Building Floor Plans	N/A	N/A	N/A
20	Special Fire Protection Systems for Protection of special Risks, if any:	N/A	N/A	N/A

Accordingly, the fire protection systems provided in the building were tested/checked randomly and found in working condition at the time of inspection.

Keeping in view the satisfactory compliance of the minimum standards on fire prevention and fire safety required as stipulated in director of education Circular dated 01.03.2011, it is recommended to renewal of fire safety certificate issued vide this department letter of even no. 704 dated 17.05.2017.


Signature of the Inspecting Officer
Name :- A.K.Sharma
Designation:- ADO/Rohini

DO (NW)


6/8/20
A.K. MALIK


7/8/20