

FORM 'H': FORM FOR ISSUING FIRE SAFETY CERTIFICATE

[See sub-rule (1) of rule 35]

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE, NEW DELHI-110001

No. F6/DFS/MS/2020/WZ/ 391

Dated: 01 / 10 / 2020

FIRE SAFETY CERTIFICATE

Certified that the Bindra Brothers located at Ground Floor, C-38-39, Rajdhani Market, Raghbir Nagar, New Delhi-110027 in a building comprising of Ground & 1st Floor only owned / occupied by Bindra Brothers, has already been issued FSC by this department vide letter No. No. F5/(5)/DFS/2009/227 dated 13.07.2009. The premises was re-inspected by the officer concerned of Fire Service on 23.09.2020 in the presence of Mr. Roshan (Manager) and found that building / premises have deemed complied with the fire prevention and fire safety requirements in accordance with rule 33 of the Delhi Fire Service Rules, 2010 and that the building / premises is fit for occupancy class Storage of rectified spirit and Absolute Alcohol with effect from 01 / 10 / 2020 for a period of three years in accordance with Rule 36 unless renewed under Rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules 2010.

Issued on 01/10/2020 at New Delhi by.


(DHARAMPAL BHARDWAJ)
DY.CHIEF FIRE OFFICER.

Copy to :-

1. Authorized Signatory, Bindra Brothers, Ground Floor, C-38-39, Rajdhani Market, Raghbir Nagar, New Delhi-110027.
2. Assistant Commissioner, (M & TP) Govt. of NCT of Delhi, O/o Commissioner of Excise, L & N Block, Vikas Bhawan, New Delhi-110002.

Conditions for the validity of Fire Safety Certificate:

1. **Fire Safety Certificate is valid for Ground Floor only.**
2. All the fire safety arrangement provided their in shall be maintained in good working conditions at all times.
3. Loss of life or property due to non-functional fire safety measure shall be at the responsibility of the management.
4. The trained fire fighting staff should be available round the clock.
5. **The Correct labeling of rectified Spirit & Absolute Alcohol be followed.**
6. Any deviation with regard to the construction etc. shall be verified by the concerned building sanctioning agency.
7. This certificate cannot be treated in any case for regularizations of unauthorized construction.
8. The owner / occupier shall submit a declaration every year in form "K" provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on www.dfs.delhigovt.nic.in
9. **"The owner / Occupier shall apply for renewal of this Fire Safety Certificate to the Director in Form 'J' [sub rule (1) of rule 37] along with a copy of this Certificate, six months prior to its expiry"**

INSPECTION REPORT

1. Name & address of the building: Bindra Brothers, C-38-39, Rajdhani Market, Raghbir Nagar, New Delhi-110027.
2. Type of Occupancy : Godown (Storage of rectified spirit and Absolute Alcohol)
3. Type of Case : **Renewal (Bldg. is Ground & 1st Floor but storage is only on Ground Floor only)**
4. Details of previous NOC : No.F5/(5)/DFS/2009/227 dated 13.07.2009
5. Fire Safety directives Letter No. : Nil
6. Date of inspection : 23/09/2020
7. Name of the Inspecting Officer : A.D.O. (Jwala Puri)
8. Name and designation of Officer
from the building side : Mr. Roshan (Manager)
9. Year of Construction : -----

10. Applicant's letter received through email ID-advocate@lai-law.com dated 15/09/20

S No	Minimum standards on fire prevention and fire safety U/R 33	BBL Requirements	Provided at site	Remarks MR/NMR
1.	Access of building			
	• Road width	Accessible	Accessible	MR
	• Gate width	Accessible	Accessible	MR
	• Width of internal road	NA	NA	NA
2.	Number, width, Type & Arrangements of exits			
	a. Number of staircases			
	• Upper floors	N/A	N/A	N/A
	• Basements	N/A	N/A	N/A
	b. Width of staircases	N/A		
	• Upper floors	N/A	N/A	N/A
	• Basements	N/A	N/A	N/A
	c. Protection of exits	N/A		
	• Fire check door	N/A	N/A	N/A
	• Pressurization	N/A	N/A	N/A
	d. No of continuous staircase to terrace	N/A	N/A	N/A
	e. Width Of Corridor	N/A	N/A	N/A
	f. Door Size	1.00 mtr	1.50 mtr	MR
3.	Compartmentation			
	• Fire check door	N/A	N/A	N/A
	• Sealing of electrical shafts	N/A	N/A	N/A
	• Fire Rating of shaft door	N/A	N/A	N/A
	• Water Curtain	N/A	N/A	N/A
	• Fire Dampers	N/A	N/A	N/A
4.	Smoke managements System			
	• Basements	N/A	N/A	N/A
	• Upper floors	N/A	N/A	N/A
5.	Fire Extinguishers			
	• Total numbers	3	6	MR
	• Types	ISI marked ABC/CO ₂ /Mechanical Foam	Provided	MR
	• IS marking	Required	Provided	MR

(Handwritten Signature)

N/E

6.	First – Aid Hose Reels			
	• Total numbers on each floor	N/A	N/A	N/A
	• Length of hose reel hose	N/A	N/A	N/A
	• Nozzle diameter	N/A	N/A	N/A
7.	Automatic fire detection and alarming system			
	• Type of detector	N/A	N/A	N/A
	• Location of Main Panel	N/A	N/A	N/A
	• Location of Repeater	N/A	N/A	N/A
	• Panel	N/A	N/A	N/A
	• Alternate source of power	N/A	N/A	N/A
	• Hooters' Location	N/A	N/A	N/A
8.	MOEFA	N/A	N/A	MR
9.	Public Address System	N/A	N/A	N/A
10.	Automatic Sprinkler System			
	• Ground Floor	Required	Provided	MR
	• Upper Floor	N/A	N/A	N/A
	• Sprinkler above false ceiling	N/A	N/A	N/A
11.	Internal Hydrants			
	• Size of riser/down-comer	N/A	N/A	N/A
	• Number of hydrants per floor	N/A	N/A	N/A
	• Hose Box	N/A	N/A	N/A
12.	Yard Hydrants			
	• Total number of hydrants	N/A	N/A	N/A
	• Hose Box	N/A	N/A	N/A
13.	Pumping Arrangements			
	• Ground Level			
	• Discharge of main pump	N/A	N/A	N/A
	➤ Head of main pump	N/A	N/A	N/A
	➤ Number of main pumps	N/A	N/A	N/A
	➤ Jockey pump out put	N/A	N/A	N/A
	➤ Jockey pump head	N/A	N/A	N/A
	➤ Standby Pump out put	N/A	N/A	N/A
	➤ Standby Pump Head	N/A	N/A	N/A
	➤ Auto Starting/Manual stopping	N/A	N/A	N/A
	➤ Pump House Access	N/A	N/A	N/A
	• Terrace level			
	➤ Discharge of pump	450 LPM	450 LPM x 2	MR
	➤ Head of the pump	40 MH	40 MH	MR
	➤ Power supply	Required	Provided	MR
	➤ Auto starting of pump	Required	Provided	MR
14.	Captive water Storage for fire fighting			
	• Underground tank capacity	N/A	N/A	N/A
	➤ Draw of connection	N/A	N/A	N/A
	➤ Fire service inlet	N/A	N/A	N/A
	➤ Access to tank	N/A	N/A	N/A
	• Overhead Tank	10,000 ltr	10,000 ltr	MR

15.	Exit Signage	N/A	N/A	N/A
16.	Provision of Lifts			
	➤ Pressurization of Lift Shaft	N/A	N/A	N/A
	➤ Pressurization of lift lobby	N/A	N/A	N/A
	➤ Communication in lift Car	N/A	N/A	N/A
	➤ Fireman's Grounding Switch	N/A	N/A	N/A
	➤ Lift Signage	N/A	N/A	N/A
17.	Standby power supply	N/A	N/A	N/A
18.	Refuge Area	N/A	N/A	
	➤ Total area	N/A	N/A	N/A
	➤ Location	N/A	N/A	N/A
19.	Fire control room			
	➤ Detector system panel	N/A	N/A	N/A
	➤ Flow Switch Panel	N/A	N/A	N/A
	➤ PA System Panel	N/A	N/A	N/A
	➤ Battery backup	N/A	N/A	N/A
	➤ Building Floor Plans	N/A	N/A	N/A
20.	Special Fire Protection Systems for Protection of special Risks, if any;	N/A	N/A	N/A

Note:- Building comprised of Ground & 1st Floor only. Storage is done on Ground Floor only. 1st Floor is being used as rest room for the labours.

The fire protection systems provided in the building were tested, checked and found functional at the time of inspection. MCB and Conduit Metal Wiring has also been provided.

In view of the deemed compliance of the minimum standards of fire prevention and fire safety measures as required under the rules the NOC issued vide letter No. F5/(5)/DFS/2009/227 dated 13.07.2009 renewal under rule 35 of the Delhi Fire Service rules 2010 is recommended.


DO (V D)

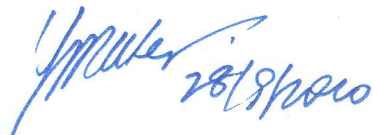
ADO (FPH) mention at C-4 that original file is not traceable

in this section. If agreed, case may be considered.

Dy. CPO (W2)

29/9/2020


25/9/2020
Signature of the Inspecting Officer
Name : Ashok Kumar Jaiswal
Designation : A.D.O. (Jwala Puri)


28/8/2020

~~ADO (FPH)~~ - f.t
is put up for sign. pl.