

**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEAD QUARTERS: DELHI FIRE SERVICE: NEW DELHI-110001**

No. F.6/DFS/MS/Indl/SZ/2020/ 408


Dated: 07/10/2020

FIRE SAFETY CERTIFICATE

Certified that M/s. Blue Heaven Cosmetics Private Limited located at B-104/5, Naraina Industrial Area, Naraina, Delhi- 28, comprised of basement, stilt, ground plus two upper floors was inspected by the officers concerned of this department on 27.09.2020 in presence of Sh. Vishav Dhamija (G.M.) and found that the management of M/s. Blue Heaven Cosmetics Private Limited have complied with the fire prevention and fire safety requirements in accordance with rule 33 of the Delhi Fire Service Rules, 2010 and that the premises is fit for occupancy **Class Group G 'Industrial Building (Moderate Hazard)'**, with effect from the date of issue of this certificate for a period of three years in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules 2010, printed overleaf.

Issued 07/10/2020 at New Delhi by.

(Atul Garg)
Director


06/10/2020

Copy to:-

1. The Manager, M/s. Blue Heaven Cosmetics Private Limited, B-104/5, Naraina Industrial Area, Naraina, Delhi- 28.
2. The Executive Engineer (Building), HQ-II, SDMC, 8th Floor, Dr. S.P.M. Civic Centre, E-Wing, J.L. Nehru Marg, New Delhi- 110002.

Conditions for the validity of Fire Safety Certificate

1. All the means of escape shall be kept free of all type of obstruction all the time.
2. All the employees shall be acquainted with the use and maintenance of all fire equipments and method of smooth and speedy safe evacuation of occupants in case of emergency.
3. All the fire fighting equipments shall be maintained in perfect working condition all the time and any lapse rendering non-functional of fire safety measures, management shall be responsible.
4. Any deviation, with regards to construction, ventilation, occupation, electric installation etc. may be got verified from the concerned authorities.
5. The Fire Safety Certificate may not be treated in any case for regularizations of unauthorized construction / unauthorized use of land if any.
6. Basement shall be used as per UBBL. Stilt floor shall only be used for parking.
7. All comments / directions of licensing department shall always be permitted and followed.
8. The owner / occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rule 2010. The form is available on www.dfs.delhigovt.nic.in
9. The owner / occupier shall apply for renewal of this **Fire Safety Certificate to the Director in 'Form J' (sub Rule (1) of Rule 37)** along with copy of the certificate, six months prior to its expiry.

1. Name & address of the building : M/s. Blue Heaven Cosmetics Private Limited, B-104/5, Naraina Industrial Area, Naraina, Delhi- 28
2. Type of Occupancy : Class Group G 'Industrial Building (Moderate Hazard)
3. Type of Case : New Case
4. Details of previous NOC : N/A
5. Fire Safety directives letter No : F.6/DFS/MS/Indl/BP/2012/401 dated 07.02.2012
6. Date of inspection : 27.09.2020
7. Name of the Inspecting Officers : M.K. Chattopadhyay, D.O (SW), Sandeep Duggal, ADO (JKP)
8. Name and designation of officers from the building side : Sh. Vishav Dhamija (G.M.)
9. Year of Construction : Before 2019
10. Applicant's letter No. : E-mail dated 31.08.2020 <dhamija@blueheavencosmetics.in>

The said industrial building is comprised of basement, stilt, ground plus two upper floors.

| S. No. | Minimum Standards on fire prevention and fire safety U/R 33 | Fire safety requirements as per NBC | Provided at site | Remarks MR/NMR |
|--------|-------------------------------------------------------------|-------------------------------------|----------------------|----------------|
| 1 | Access to building | | | |
| | • Road width | 09 mts | Provided | MR |
| | • Gate width | 4.5mts | Provided | MR |
| | • Width of internal road | N/A | N/A | N/A |
| 2 | Number, Width, Type & Arrangement of Exits | | | |
| | a. Number of staircases | - | - | - |
| | • Upper Floors | 02 | 02 | MR |
| | • Basements | 02 | 02 | MR |
| | b. Width of staircases | - | - | - |
| | • Upper Floors | 1.5 mts each | 1.5 mts each | MR |
| | • Basements | 1.5 mts each | 1.5 mts each | MR |
| | c. Protection of exits | - | - | - |
| | • Fire check door | Required | Provided | MR |
| | • Pressurization | Required | Provided | MR |
| | e. No. of continuous staircases to terrace | 02 | 02 | MR |
| | g. Width of Corridor | 1.5 mts | Provided | MR |
| | h. Door Size | 1.25 mt. | Provided | MR |
| 3 | Compartmentation. | | | |
| | • Fire check door | N/A | N/A | N/A |
| | • Sealing of electrical shafts | N/A | N/A | N/A |
| | • Fire Rating of shaft door | N/A | N/A | N/A |
| | • Water Curtain | N/A | N/A | N/A |
| | • Fire Dampers | N/A | N/A | N/A |
| 4 | Smoke Management System. | | | |
| | • Basements | 30 a/c per hour | Exhaust fan provided | MR |
| | • Upper floors | 12 a/c per hour | Exhaust fan provided | MR |
| 5 | Fire Extinguishers | | | |
| | • Total numbers | 03 per floor | Provided | MR |
| | • Types | CO ₂ , ABC | Provided | MR |
| | • IS marking | ISI marked | Provided | MR |

| | | | | |
|----|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|--------------------------------------------------------------------------------------------------------------------------------------------------------------|-------------------------------------------------------------------------------------------------------------------------------------------------------------------------|--------------------------------------------------------------------------------------------|
| | <ul style="list-style-type: none"> Length of hose reel hose Nozzle diameter | 30 m 5 mm | Provided Provided | MR MR |
| 7 | Automatic fire detection and alarming system. | | | |
| | <ul style="list-style-type: none"> Type of detectors Location of Main Panel Location of Repeater Panel Alternate source of power Hooters' Location | Required Fire control room N/A D.G. set Entire building | Provided Provided N/A Provided Provided | MR MR N/A MR MR |
| 8 | MOEFA | Required | Provided | MR |
| 9 | Public Address System. | Required | Provided | MR |
| 10 | Automatic Sprinkler System. | | | |
| | <ul style="list-style-type: none"> Basement Upper Floor Sprinkler above false ceiling | Required Required Required | Provided Provided Provided | MR MR MR |
| 11 | Internal Hydrants | | | |
| | <ul style="list-style-type: none"> Size of riser/down-comer Number of hydrants per floor Hose Box | 100 mm 01 No. 01 No. | Provided Provided Provided | MR MR MR |
| 12 | Yard Hydrants. | | | |
| | <ul style="list-style-type: none"> Total number of hydrants Hose Box | 01 No. 01 No. | Provided Provided | MR MR |
| 13 | Pumping Arrangements. | | | |
| | <ul style="list-style-type: none"> Ground Level <ul style="list-style-type: none"> Discharge of main Pump Head of Main pump Number of main pumps Jockey Pump out put Jockey pump head Standby Pump out put Standby Pump Head Auto Starting/ Manual stopping Pump House Access Terrace level <ul style="list-style-type: none"> Discharge of pump Head of the pump Power Supply Auto Starting of pump | --- 2280 LPM 60 mts 01 No. 220 LPM 60 mts 2280 LPM 60 mts Required Required ----- 900 LPM 30 mts Required Required | --- Provided Provided Provided Provided Provided Provided Provided Provided Provided ----- 900 LPM Provided Provided Provided | --- MR MR MR MR MR MR MR MR MR ----- MR MR MR MR |
| 14 | Captive Water Storage for fire fighting. | | | |
| | <ul style="list-style-type: none"> Underground tank capacity Draw-off connection Fire service inlet Access to tank Overhead Tank capacity | 1,00,000 lts Required Required Required 20,000 lts | Provided Provided Provided Provided Provided | MR MR MR MR MR |

711


| | | | | |
|----|--------------------------------------------------------------------------|----------|----------------------------------------------------------------------|-----|
| 15 | Exit Signage. | Required | Provided | MR |
| 16 | Provision of Lifts. | | | |
| | • Pressurization of Lift Shaft | Required | Provided | MR |
| | • Pressurization of Lift lobby | Required | Provided | MR |
| | • Communication In lift Car | N/A | N/A | N/A |
| | • Fireman's Grounding Switch | Required | Provided | MR |
| | • Lift Signage | Required | Provided | MR |
| 17 | Standby power supply | Required | Provided | MR |
| 18 | Refuge Area. | | | |
| | ➤ Total Area | N/A | N/A | N/A |
| | ➤ Location | N/A | N/A | N/A |
| 19 | Fire Control Room | | | |
| | • Detector System Panel | Required | Provided | MR |
| | • Flow Switch Panel | N/A | N/A | N/A |
| | • PA System Panel | Required | Provided | MR |
| | • Battery backup | Required | Provided | MR |
| | • Building Floor Plans | N/A | N/A | N/A |
| 20 | Special Fire Protection Systems for Protection of special Risks, if any: | Required | CO ₂ type fire extinguishers provided near electric panel | MR |


The fire protection systems provided in the building were checked and found functional at the time of inspection.



In view the substantial compliance of the minimum standards on fire prevention and fire safety required under the rules, it is recommended to grant fire safety certificate under Delhi Fire Service Act-2007 & Rules- 2010.

DFA is put up for approval & signature please.


295/DO(SW)
29/09/2020

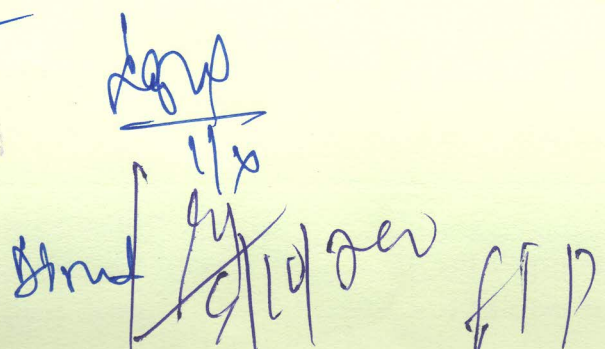

29/9
M.K. Chattopadhyay
Div. Officer (SW)


29/09/2020
Sandeep Duggal
Asst. Div. Officer (JKP)


DCFD(S2)

29/09


dfo




Handwritten signatures and notes including '1/10', '1/10', and 'ATP'.