

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEAD QUARTERS: DELHI FIRE SERVICE, CONNAUGHT PLACE
NEW DELHI



No. F6/DFS/MS/WZ/2020/ 523

Dated: 17/12/2020

FIRE SAFETY CERTIFICATE

Certified that the **Shalimar Place**, Located at **Plot no. 1, District Centre, Shalimar Bagh, New Delhi**, comprised of **Basement + Ground + 02 Upper Floors** was issued FSC by this department Vide Letter No.F6/DFS/MS/2016/WZ/639 dated-26.04.2016. The said premises was re inspected by the officers concerned of this department on 05.12.2020 in the presence of **Sh. Gaggan Seth (Chief Advisor Commercial)**, and found that the premises / building have deemed complied with the fire prevention and fire safety requirements in accordance with rule 33 of the Delhi Fire Service Rule, 2010, and that the premises/building is fit for occupancy class "Mercantile" Group F with effect from 17/12/2020 for a period of three years in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules, 2010, printed overleaf.

Issued on 17/12/2020 at New Delhi by.


 (Dharampal Bhardwaj)
Dy. Chief Fire Officer
(West Zone)

Copy to:-

1. Sh. Arun Mitter, Shalimar Place, Plot no. 1, District Centre, Shalimar Bagh, New Delhi.
2. The Dy. Director (Bldg.), DDA, INA, Vikas Sadan, New Delhi.

CONDITIONS

1. All the means of escape shall be kept free of all type of obstruction all the time. It should not bolted /locked.
2. All the employees shall be acquainted with the use and maintenance of all fire equipments and method of smooth and speedy safe evacuation of occupants in case of emergency.
3. All the fire fighting equipments shall be maintained in perfect working condition all the time and any loss of life any property due to the non-functional of any fire safety measures, management shall be held responsible.
4. Any deviation, with regards to construction, ventilation, occupation, electric installation etc. may be got verified from the concerned authorities.
5. The Fire Safety Certificate may not be treated in any case for regularizations of unauthorized construction / unauthorized use of land if any.
6. All comments / directions of licensing Department shall always be permitted and followed.
7. The owner /occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rule 2010. The form is available on www.dfs.delhigovt.nic.in
8. The owner / occupier shall apply for renewal of this **Fire Safety Certificate to the Director in 'Form J' (sub Rule (1) of Rule 37)** along with copy of the certificate, six months prior to its expiry.
9. The basement shall be used as per BBL.

1. Name & address of the building: Shalimar Place, Located at Plot No.1,
District Centre, Shalimar Bagh, New
Delhi.

2. Type of Occupancy : Mercantile (Basement + Ground + 02 Upper Floors)

3. Type of Case : Renewal

4. Details of previous NOC : F6/DFS/MS/2016/WZ/639 dated-26.04.2016

5. Fire Safety directives Letter No.: F6/DFS/MS/BP/2007/1288 dated
08.05.2007

6. Date of inspection : 05.12.2020

7. Name of the Inspecting Officer: M K Chattopadhyay DO (West)
S.P. Bhardwaj ADO (WP)

8. Name and designation of Officer
from the building side :Sh. Gaggan Seth (Chief Advisor Commerical)

9. Year of Construction : 2007-2008

10. Applicant's letter No. : email dated 25.11.2020


| S No | Minimum standards on fire prevention and fire safety U/R 33 | NBC Requirements/ letter dated 26.4.2016 | Provided at site | Remarks MR/NMR |
|------|---|--|------------------|---------------------|
| 1. | Access of building | | | |
| | • Road width | 12 m | Provided | MR |
| | • Gate width | 4.5 m | Provided | MR |
| | • Width of internal road | 06 m | Provided | MR |
| 2. | Number, width, Type & Arrangements of exits | | | |
| | a. Number of staircases | | | |
| | • Upper floors | 05 | Provided | MR |
| | • Basements | 05 | Provided | MR |
| | b. Width of staircases | | | |
| | • Upper floors | 1.5m each | 5x148cm | MR (Being Old Case) |
| | • Basements | 1.5m each | 5x148cm | MR (Being Old Case) |
| | c. Protection of exits | | | |
| | • Fire check door | Required | Provided | MR |
| | • Pressurization | Required | Provided | MR |
| | d. No of continuous staircase to terrace | | | |
| | e. Width Of Corridor | 1.5m each | Provided | MR |
| | f. Door Size | 1.5m each | Provided | MR |
| 3. | Compartmentation | | | |
| | • Fire check door | Required | Provided | MR |
| | • Sealing of electrical shafts | Required | Provided | MR |
| | • Fire Rating of shaft door | Required | Provided | MR |
| | • Water Curtain | Required | Provided | MR |
| | • Fire Dampers | Required | Provided | MR |
| 4. | Smoke managements System | | | |
| | • Basements | Required | Provided | MR |
| | • Upper floors | Required | Provided | MR |
| 5. | Fire Extinguishers | | | |
| | • Total numbers | 40 nos. | Provided | MR |
| | • Types | ABC & CO ₂ | Provided | MR |
| | • IS marking | ISI marked | Provided | MR |

| | | | | |
|-----|---|-------------------|-------------|----|
| 6. | First – Aid Hose Reels | | | |
| | <ul style="list-style-type: none"> Total numbers on each floor Length of hose reel hose Nozzle diameter | 03 | 05 Provided | MR |
| | | 30 m | Provided | MR |
| | | 5 mm | Provided | MR |
| 7. | Automatic fire detection and alarming system | | | |
| | <ul style="list-style-type: none"> Type of detectors Location of Main Panel Location of Repeater Panel Alternate source of power Hooters' Location | Required | Provided | MR |
| | | Required | Provided | MR |
| | | Each floor | Provided | MR |
| | | Required | Provided | MR |
| | | Required | Provided | MR |
| 8. | MOEFA | Required | Provided | MR |
| 9. | Public Address System | Required | Provided | MR |
| 10. | Automatic Sprinkler System | | | |
| | <ul style="list-style-type: none"> Basements Upper Floor Sprinkler above false ceiling | Required | Provided | MR |
| | | Required | Provided | MR |
| | | Required | Provided | MR |
| 11. | Internal Hydrants: | | | |
| | <ul style="list-style-type: none"> Size of riser/down- comer Number of hydrants per floor Hose Box | 150 mm | Provided | MR |
| | | 03 | Provided | MR |
| | | 03 | Provided | MR |
| 12. | Yard Hydrants | | | |
| | <ul style="list-style-type: none"> Total number of hydrants Hose Box | 04 | Provided | MR |
| | | 04 | Provided | MR |
| 13. | Pumping Arrangements: | | | |
| | <ul style="list-style-type: none"> Ground Level Discharge of main pump ➤ Head of main pump ➤ Number of main pumps ➤ Jockey pump out put ➤ Jockey pump head ➤ Standby Pump out put ➤ Standby Pump Head ➤ Auto Staring/Manual stopping ➤ Pump House Access Terrace level ➤ Discharge of pump ➤ Head of the pump ➤ Power supply ➤ Auto starting of pump | NA | NA | NA |
| | | NA | NA | NA |
| | | NA | NA | NA |
| | | NA | NA | NA |
| | | NA | NA | NA |
| | | NA | NA | NA |
| | | NA | NA | NA |
| | | NA | NA | NA |
| | | NA | NA | NA |
| | | 900 lpm & 180 lpm | Provided | MR |
| | | 40 m | Provided | MR |
| | | Required | Provided | MR |
| | | Required | Provided | MR |
| 14. | Captive water Storage for firefighting: | | | |
| | <ul style="list-style-type: none"> Underground tank capacity ➤ Draw off connection ➤ Fire service inlet ➤ Access to tank Overhead Tank capacity | NA | NA | NA |
| | | NA | NA | NA |
| | | NA | NA | NA |
| | | NA | NA | NA |
| | | 25,000 liters | Provided | MR |
| 15 | Exit Signage | Required | Provided | MR |
| 16. | Provision of Lifts | | | |
| | <ul style="list-style-type: none"> ➤ Pressurization of Lift Shaft ➤ Pressurization of lift lobby ➤ Communication in lift Car ➤ Fireman's Grounding Switch ➤ Lift Signage | Required | Provided | MR |
| | | Required | Provided | MR |
| | | Required | Provided | MR |
| | | Required | Provided | MR |
| | | Required | Provided | MR |
| 17. | Standby power supply | Required | Provided | MR |
| 18. | Refuge Area | | | |
| | <ul style="list-style-type: none"> ➤ Total area ➤ Location | NA | NA | NA |
| | | NA | NA | NA |


| | | | | |
|-----|--|----------|----------|----|
| 19. | Fire control room | | | |
| | ➤ Detector system panel | Required | Provided | MR |
| | ➤ Flow Switch Panel | Required | Provided | MR |
| | ➤ PA System Panel | Required | Provided | MR |
| | ➤ Battery backup | Required | Provided | MR |
| | ➤ Building Floor Plans | Required | Provided | MR |
| 20. | Special Fire Protection Systems for Protection of special Risks, if any; | NA | NA | NA |

The fire protection systems provided in the building were test checked and found functional at the time of inspection.

In view of the deemed compliance of minimum standards on fire prevention and fire safety as requirements under the rules, renewal of FSC issued vide letter no. F6/DFS/MS/2016/WZ/639 dated-26.04.2016 is recommended under rule 36 of the Delhi Fire Service Rules 2010.



Signature of the Inspecting Officer
Name: M.K. Chattopadhyay
Designation: DO (West)




Signature of the Inspecting Officer
Name: S. P. Bhardwaj
Designation: ADO/WP

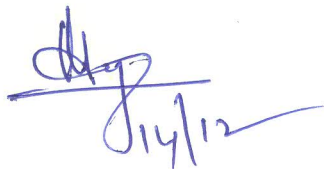
26/DO(W)
08/12/2020
14/12/2020

~~DCFO (W2)~~

what type of occupancy it is

~~DO/West~~



9/12/2020

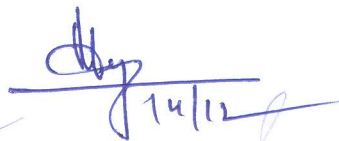

14/12

~~ADO (WP)~~

Sir, It is mercantile building the same is mentioned in inspection report/plan

~~DO/West~~


14/12/20


14/12

~~DCFO (W2)~~


15/12/2020

~~ADO/WP~~

FI for signatur/plan