

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEAD QUARTERS: DELHI FIRE SERVICE, CONNAUGHT PLACE
NEW DELHI

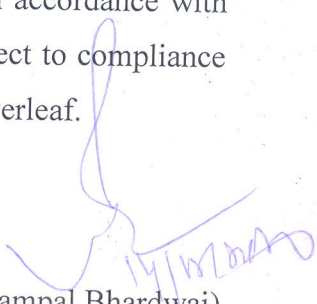
No. F6/DFS/MS/WZ/2020/ 180

Dated: 16/12/2020

FIRE SAFETY CERTIFICATE

Certified that the M/s Barshala (A Unit of Indo Spirit Bars Pvt. Ltd.) located at Plot no. 23-A, First Floor, Road No. 44, NN Towers, Community Centre, Pitampura, Delhi – 110034 in a building comprised of G + 01 Upper Floor was issued Fire Safety Certificate by this department vide Letter No. F6/DFS/MS/EH/2016/WZ/1658 dated 11-11-2016. The said premises was re inspected by the officer concerned of this department on 02.12.2020 in the presence of **Sh. Sudhir Kumar (Manager)** and found that the building have deemed complied with the fire prevention and fire safety requirements in accordance with rule 33 of the Delhi Fire Service Rule, 2010 and that the premises is fit for occupancy class “ Assembly” Group D (Restaurant) with effect from 16/12/2020 for a period of three years in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under Rule 40, subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules, 2010, printed overleaf.

Issued on 16/12/2020 at New Delhi by.


(Dharampal Bhardwaj)
Dy. Chief Fire Officer
(West Zone)

Copy to:

1. The Addl. Commissioner of Police (Lic), 1st Floor, Licensing Unit, Police Station, Defence Colony, New Delhi
2. The Dy. Health Officer, Keshav Puram Zone, **NDMC**, Public Health Department, **A-1 Block**, Keshav Puram Zone, Delhi.
3. Sh. Sumit Wadhwa, M/s Barshala (A Unit of Indo Spirit Bars Pvt. Ltd.) located at Plot no. 23-A, First Floor, Road No. 44, NN Towers, Community Centre, Pitampura, Delhi – 110034.

CONDITIONS

1. All the means of escape shall be kept free of all type of obstruction all the time.
2. All the employees shall be acquainted with the use and maintenance of all fire equipments and method of smooth and speedy safe evacuation of occupants in case of emergency.
3. All the fire fighting equipments shall be maintained in perfect working condition all the time and any lapse rendering non-functional if fire safety measures, management shall be responsible.
4. Any deviation, with regards to construction, ventilation, occupation, electric installation etc. may be got verified from the concerned authorities.
5. The Fire Safety Certificate may not be treated in any case for regularizations of unauthorized construction / unauthorized use of land if any.
6. All comments / directions of licensing Department shall always be permitted and followed.
7. The owner / occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rule 2010. The form is available on www.dfs.delhigovt.nic.in
8. The owner / occupier shall apply for renewal of this **Fire Safety Certificate to the Director in 'Form J' (sub Rule (1) of Rule 37)** along with copy of the certificate, six months prior to its expiry.

INSPECTION REPORT

1. Name & address of the building: **M/s Barshala (A Unit of Indo Spirit Bars Pvt. Ltd.), Located at Plot no. 23-A, First Floor, Road No. 44, NN Towers, Community Centre, Pitampura, Delhi – 110034.**
2. Type of Occupancy : Assembly (1st Floor)
3. Type of Case : Renewal
4. Details of previous NOC : F6/DFS/MS/EH/2016/WZ/1658 dated 11-11-2016
5. Fire Safety directives Letter No. : Nil
6. Date of inspection : 02.12.2020
7. Name of the Inspecting Officer : S. P. Bhardwaj ADO (WP)
8. Name and designation of Officer
from the building side : Mr. Sudhir (Manager)
9. Year of Construction : 2005
10. Applicant's letter no. : online application no. 2020102407983 dated 18/11/2020

S No	Minimum standards on fire prevention and fire safety U/R 33	BBL/NBC Requirements	Provided at site	Remarks MR/NMR
1.	Access of building			
	• Road width	6 m	Provided	MR
	• Gate width	NA	NA	NA
	• Width of internal road	NA	NA	NA
2.	Number, width, Type & Arrangements of exits			
	a. Number of staircases			
	• Upper floors	2	Provided	MR
	• Basements	NA	NA	NA
	b. Width of staircases			
	• Upper floors	2 m & 87cm	Provided	MR (old case)
	• Basements	NA	NA	NA
	c. Protection of exits			
	• Fire check door	NA	NA	NA
	• Pressurization	NA	NA	NA
	d. No of continuous staircase to terrace	NA	NA	NA
	e. Width Of Corridor	2 m	Provided	MR
	f. Door Size	1x2m & 1x1 m	Provided	MR
3.	Compartmentation			
	• Fire check door	Required in Kitchen	Provided	MR
	• Sealing of electrical shafts	NA	NA	NA
	• Fire Rating of shaft door	NA	NA	NA
	• Water Curtain	NA	NA	NA
	• Fire Dampers	NA	NA	NA



4.	Smoke managements System			
	• Basements	30 a/c per hour	NA	NA
	• Upper floors	12 a/c per hour	Provided	MR
5.	Fire Extinguishers			
	• Total numbers	06 nos.	Provided	MR
	• Types	ABC & CO ₂	Provided	MR
	• IS marking	ISI marked	Provided	MR
6.	First – Aid Hose Reels			
	• Total numbers on each floor	1	Provided	MR
	• Length of hose reel hose	30 m	Provided	MR
	• Nozzle diameter	6.5 mm	Provided	MR
7.	Automatic fire detection and alarming system			
	• Type of detectors	NR	Provided	NR
	• Location of Main Panel	NR	Provided	NR
	• Location of Repeater Panel	NR	Provided	NR
	• Alternate source of power	NR	Provided	NR
	• Hooters' Location	NR	Provided (Near Entry)	NR
8.	MOEFA	Required	Provided	MR
9.	Public Address System	NR	Provided	NR
10.	Automatic Sprinkler System			
	• Basements	NA	NA	NA
	• Upper Floor	Required	Provided	MR
	• Sprinkler above false ceiling	NR	NR	NR
11.	Internal Hydrants:			
	• Size of riser/down- comer	100 mm	Provided	MR
	• Number of hydrants per floor	1	Provided	MR
	• Hose Box	Required	Provided	MR
12.	Yard Hydrants			
	• Total number of hydrants	NA	NA	NA
	• Hose Box	NA	NA	NA
13.	Pumping Arrangements:			
	• Ground Level			
	• Discharge of main pump	NA	NA	NA
	➤ Head of main pump	NA	NA	NA
	➤ Number of main pumps	NA	NA	NA
	➤ Jockey pump out put	NA	NA	NA
	➤ Jockey pump head	NA	NA	NA
	➤ Standby Pump out put	NA	NA	NA
	➤ Standby Pump Head	NA	NA	NA
	➤ Auto Staring/Manual stopping	NA	NA	NA
	➤ Pump House Access	NA	NA	NA
	• Terrace level			
	➤ Discharge of pump	450 lpm, 180 lpm	Provided	MR
	➤ Head of the pump	36 m	Provided	MR
	➤ Power supply	Required	Provided	MR
	➤ Auto starting of pump	Required	Provided	MR

Singh

14.	Captive water Storage for firefighting:			
	• Underground tank capacity	NA	NA	NA
	➤ Draw off connection	NA	NA	NA
	➤ Fire service inlet	NA	NA	NA
	➤ Access to tank	NA	Provided	MR
	• Overhead Tank capacity	5000 liters	Provided	MR
15	Exit Signage	Required	Provided	MR
16.	Provision of Lifts			
	➤ Pressurization of Lift Shaft	NA	NA	NA
	➤ Pressurization of lift lobby	NA	NA	NA
	➤ Communication in lift Car	NA	NA	NA
	➤ Fireman's Grounding Switch	NA	NA	NA
	➤ Lift Signage	NA	NA	NA
17.	Standby power supply	Required	Provided	MR
18.	Refuge Area			
	➤ Total area	NA	NA	NA
	➤ Location	NA	NA	NA
19.	Fire control room			
	➤ Detector system panel	NA	NA	NA
	➤ Flow Switch Panel	NA	NA	NA
	➤ PA System Panel	NA	NA	NA
	➤ Battery backup	NA	NA	NA
	➤ Building Floor Plans	NA	NA	NA
20.	Special Fire Protection Systems for Protection of special Risks, if any;	NA	NA	NA

The fire protection systems provided in the building were checked/tested and found functional at the time of inspection.

In view of the deemed compliance of minimum standards on fire prevention and fire safety requirements under the rules, renewal of FSC issued vide letter no. **F6/DFS/MS/EH/2016/WZ/1658** dated **11-11-2016** is recommended.

S.P. Bhardwaj
3/12/20

Signature of the Inspecting Officer
Name: S.P. Bhardwaj
Designation: ADO (WP)

~~DO NOT~~

~~03/12/2020~~

~~DCFO (WZ)~~

~~11/12/20~~

~~ADDO (WZ) FT~~

~~Defot WZ~~

FT for Signat per

S.P. Bhardwaj
11/12/20

2/20/WD
3/12/2020