

**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI**  
**HEAD QUARTERS, DELHI FIRE SERVICE, NEW DELHI - 110001**

No.F6/DFS/MS/2020/

556

Dated: -----

31/12/2020

**FIRE SAFETY CERTIFICATE**

Certified that the **Rashtriya Seva Samithi** located at **Plot No 1 , DDU marg , New Delhi** is comprised of **Basement, Stilt Ground + 02 Upper floors**. The premises was inspected jointly by officers concerned of this department on **22/12/20** in the presence of Sh. Nootan Gupta , AE ( MCD) & Sh Sachin JE ( MCD) , Sh Pradeep Sharma Arch. and found that the said building have complied with the fire prevention and fire safety requirements in accordance with rule 33 of the Delhi Fire Service Rules, 2010 and that the premises is fit for occupancy **Class -D Assembly Building** with effect from ~~---~~ 31/12/2020 for period of three years in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules 2010, printed below.

Issued 31/12/2020 at New Delhi by.

(Atul Garg )

**DIRECTOR**

01123414000

Copy to:-

1. The Executive Engineer ( Bldg.) North , MCD ,Civic Centre New Delhi ...on line ID **10081314** dated 19/12/2020

**Condition for the validity of fire safety certificate**

1. All the fire safety arrangements provided therein shall be maintained in good working conditions at all times.
2. Any loss of life or property due to non functional fire safety measures shall be at the responsibility of the management.
3. The trained fire fighting staff should be available round the clock.
4. Any deviation w.r.t. construction etc. shall be verified by the concerned building sanctioning authority.
5. This fire safety certificate may not be treated in any case for regularization of unauthorized construction, if any.
6. The owner / occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on [www.dfs.delhigovt.nic.in](http://www.dfs.delhigovt.nic.in)
7. The means of escape shall be kept unobstructed / unlocked for unhindered evacuation in case of an emergency.
8. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in form 'J' [sub rule (I) of rule 37] along with a copy of this Certificate, six month prior to its expiry".

## INSPECTION REPORT

1. Name & address of the building **Rashtriya Seva Samithi** –located at plot No 01 , DDU Marg New Delhi
2. Type of occupancy:- **Assembly building - B, stilt & Ground + 02 Upper floors**
3. Type of case:- **New**
4. Details of previous FSC:- **NA**
5. Fire safety directives No.- **No. F6/DFS/MS/BP/2014/316 dated 26.11.14**
6. Date of inspection:- **22/12/20**
7. Name of the inspecting officer:- **Dr. S.K Tomar , Dy CFO ( NDZ)  
Sh. Rajinder Atwal (DO/CD)  
Sh. Ravinder Singh , ADO (CC)**
8. Name & designation of office **Sh.Nootan Gupta , AE ( MCD )**  
From the building & MCD side:- **Sh Sachin, JE, MCD  
Sh. Pradeep Sharma Arch**
9. Year of construction:- **2020**
10. Applicant's letter No:- **Online ID No 10081314 dated 19/12/2020.**

S.No.	Minimum Standards on fire Prevention and fire safety U/R 33	Requirement /Existing fire safety arrangements	Provided at site	Remarks MR/NMR
<b>1.</b>	<b>Access to Building</b>			
	1) Road width	36.58 mtr.	Provided	MR
	2) Gate width	4.5mtr.	Provided	MR
	3)Width of internal road	N/A	N/A	N/A
<b>2.</b>	<b>Number, Width Type &amp; Arrangement of Exits</b>			
	<b>A. Number of staircases</b>			
	1. Upper floors	02	02	MR
	2. Basements	02	02	MR
	<b>B. Width of staircase</b>			
	1. Upper floors	2.0 m& 1.5 m.	2.0m&1.5 m.	MR
	2. Basements	2.0 m & 1.5m.	2.0m&1.5 m.	MR
	<b>C. Protection of exits</b>			
	1. Fire check door	Required	Provided	MR
	2. Pressurization	N/A	N/A	N/A
	D. No. of continuous staircase to terrace	02	02	MR
	E. Width of corridor	N/A	N/A	N/A
	F. Door size	2.0mtr &1.5 mtr.	Provided	MR
<b>3.</b>	<b>Compartmentation</b>			
	1) Fire check door	Required	Provided	MR
	2) Sealing of electrical shafts	Required	Provided	MR
	3) Fire rating of shaft door	Required	Provided	MR
	4) Water curtain	N/A	N/A	N/A
	5) Fire Dampers	N/A	N/A	N/A
<b>4.</b>	<b>Smoke Management System</b>			

	1) Basements	12 a/c hour	Exhaust fan	MR
	2) Upper floors	12 a/c per hour	Natural	MR
<b>5.</b>	<b>Fire Extinguishers</b>			
	1) Total numbers	10 Nos.	10 Nos.	MR
	2) Types	ABC & CO2	ABC & CO2	MR
	3) ISI marking	Required	Provided	MR
<b>6.</b>	<b>First-Aid Hose Reel</b>			
	1) Total number of each floor	01	01	MR
	2) Length of hose reel hose	30 mtr.	30 mtr.	MR
	3) Nozzle diameter	05 mm	05 mm	MR
<b>7.</b>	<b>Automatic Fire Detection &amp; Alarming System</b>			
	1) Type of detectors( smoke)	Required	Provided	MR
	2) Location of main panel	Required	Provided at stilt floor	MR
	3) Location of repeater panel	N/A	N/A	N/A
	4) Alternate source of power	Required	Provided	MR
	5) Hooter's Location	Required	Provided at each floor	MR
<b>8.</b>	<b>MOEFA</b>	Required	Provided	MR
<b>9.</b>	<b>Public Address System</b>	Required	Provided	MR
<b>10.</b>	<b>Automatic Sprinkler System</b>			
	1) Basement	Required	Provided	MR
	2) Upper floors	N/A	Provided	NA
	3) Sprinkler above false ceiling	N/A	N/A	N/A
<b>11.</b>	<b>Internal Hydrants</b>			
	1) Size of riser/down-comer	100 mm	100 mm	MR
	2) Number of hydrants per floor	01	01	MR
	3) Hose box	01	01	MR
<b>12.</b>	<b>Yard Hydrants</b>			
	1) Total number of hydrants	N/A	Provided	N/A
	2) Hose box	N/A	Provided	N/A
<b>13.</b>	<b>Pumping Arrangement</b>			
	1) Ground level			
	a) Discharge of main pump	2280 LPM	2280 LPM	MR
	b) Head of main pump	55tr.	55 mtr.	MR
	c) Number of main pump	01	01	MR
	d) Jockey pump out put	180 LPM	180 LPM	MR
	e) Jockey pump head	55 mtr.	55 mtr.	MR
	f) Stand by pump output	2280 LPM	2280 LPM	MR
	g) Stand by pump head	55 mtr.	55 mtr.	MR
	h) Auto starting/Manual stopping	Required	Provided	MR
	2) Terrace level			
	a) Discharge of pump	900LPM	900LPM	MR

	b) Head of pump	35	35	MR
	c) Power supply	Required	Provided	MR
	d) Auto starting of pump	Required	Provided	MR
<b>14.</b>	<b>Captive Water Storage for Fire Fighting</b>			
	1) Under ground tank capacity	50,000 ltr.	Provided	MR
	a) Draw-off connection	Required	Provided	MR
	b) Fire service inlet	Required	Provided	MR
	c) Access to tank	Required	Provided	MR
	d) Over head tank capacity	10,000 ltr.	10,000 ltr.	MR
<b>15.</b>	<b>Exit Signage.</b>	Required	Provided	MR
<b>16.</b>	<b>Provision of Lifts.</b>			
	a) Pressurization of lift shaft	Required	Provided	MR
	b) Pressurization of lift lobby	N/A	N/A	N/A
	c) Communication in lift car	Required	Provided	MR
	d) Fireman's switch	Required	Provided	MR
	e) Lift signage	Required	Provided	MR
<b>17.</b>	<b>Stand by Power Supply</b>	Required	Provided	MR
<b>18.</b>	<b>Refuge Area</b>			
	Total area location	N/A	N/A	N/A
<b>19.</b>	<b>Fire Control Room</b>			
	a) Detector system panel	N/A	N/A	N/A
	b) Flow switch panel	N/A	N/A	N/A
	c) PA system panel	N/A	N/A	N/A
	d) Battery backup	N/A	N/A	N/A
	e) Building floor plan	N/A	N/A	N/A
<b>20.</b>	<b>Special Fire Protection System for Protection of special Risk, if any: Co2 &amp; DCP.</b>			


The fire protection systems provided in the building were randomly tested, checked and found functional at the time of inspection.


In view of the deemed compliance of the minimum standards of fire prevention and fire safety measures as required under the rules, if agreed, the FSC under Rule 35 of the Delhi Fire Service Rules 2010, is recommended for approval.

Signature of the Inspecting Officer      Signature of the Inspecting Officer

Signature of the Inspecting Officer

  
30/12/2020

  
24/12

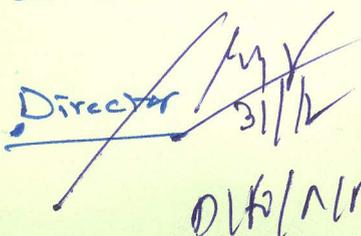
  
24/12/20

Name : Dr. S.K. Tomar  
Designation : Dy. CFO ( NDZ)

Name: - Sh. Rajinder Atwal  
Designation: - DO (CD)

Name : Sh Ravinder Singh  
Designation : ADO ( CC)

CFO (NDZ) - On leave

  
Director  
31/12  
01/1/2021  
FIPS