

**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE: NEW DELHI- 110001**

No. F.6/DFS/MS/School/2020/SZ/ 589

Dated: 30/12/2020

FIRE SAFETY CERTIFICATE

Certified that **Real View Public School** located at **F-532-533, Jaitpur Extension Part-II, Kalindi Kunj Road, Badarpur, New Delhi-110044**, comprised of **Ground plus two upper floors** was granted Fire Safety Certificate by this department vide letter No. F.6/DFS/MS/School/2017/SZ/1619 dated 13/11/2017. The premises was re-inspected by officer concerned of this department on 28/12/2020 in the presence of Mr. Sumit Chandela (Teacher) of the school and found that said school building have deemed complied with the fire prevention and fire safety requirements in accordance with Directorate of Education Circular. F.16/Estate/CC/Fire Safety/2011/3298 to 3398 dated 01/03/2011 issued by Directorate of Education, Govt. of NCT of Delhi and that the building/premises is fit for occupancy class "**Educational Building**" **Group-B**, with effect from 30/12/2020 for a period of **Three years** in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules, 2010.

Issued on 30/12/2020 at New Delhi by



(Sunil Chawdhary)
Dy. Chief Fire Officer
Delhi Fire Service

Copy to: -

1. The Chairman, Real View Public School, F-532 & 533, Jaitpur Extn-II, Badarpur, New Delhi-110044.
2. The Director of Education, Govt. of NCT of Delhi, Old Secretariat, New Delhi.

Conditions for the validity of Fire Safety Certificate

1. All the means of escape/entry/exit shall be kept free from any obstruction.
2. All the fire safety arrangements provided therein shall be maintained in good working condition at all time as seen during inspection. Any loss of life or property due to non-functional fire safety measures shall be at the responsibility of the management.
3. All the staff members must know the correct method of operation of firefighting system.
4. This Certificate cannot be treated as regularization of unauthorized construction, if any.
5. The Owner/Occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rules, 2010. The form is available on www.dfs.delhigovt.nic.in.
6. The Owner/Occupier shall apply for renewal of this Fire Safety Certificate to the Director in the form 'J' [sub rule (1) of rule 37] along with copy of this certificate, six months prior to its expiry. The form is available on www.dfs.delhigovt.nic.in.

INSPECTION REPORT

1	Name & Address of the Building	Real View Public School, F- 532 & 533, Jaitpur Extn-II, Kalindi Kunj Rd, Badarpur, New Delhi		
2	Type of Occupancy	Educational Building "Group-B" (School)		
3	Building Comprised of	Ground + Two Upper Floors		
4	Type of Case	Renewal		
5	Details of Previous NOC	F.6/DFS/MS/School/2017/SZ/1619 dated 13/11/2017		
6	Fire Safety Directives Letter No	F.16//Estate/CC/Fire Safety/2011/3298 to 3398 dated 01.03.2011		
7	Date of Inspection	28/12/2020		
8	Name of the Inspecting Officers	ADO Avtar Singh		
9	Name & Designation of Officers from the building side	Mr. Sumit Chandela (Teacher)		
10	Year of construction	2013		
11	Applicant letter No.	Email dated 02/12/2020.		
S. No	Minimum standards on Fire Prevention and Fire Safety U/R 33	Old NOC Requirement	Provided at Site	Remarks MR/NMR
1	Access to Building.			
	<ul style="list-style-type: none"> • Road width • Gate width • Width of internal road 	Required	06 m	MR
		Required	3.80 m	MR
		-N/A-	-N/A-	-N/A-
2	Number, width, type & arrangement of exits.			
	a) Number of Staircase			
	➤ Upper floors	02 nos	02 nos	MR
	➤ Basement floor	-N/A-	-N/A-	-N/A-
	b) Width of Staircase			
	➤ Upper floors	1.5 m / 0.75 m	1.40 m & 1.30 m	-MR
	➤ Basement floor	-N/A-	-N/A-	-N/A-
	c) Protection of exits			
	➤ Fire check door	-N/A-	-N/A-	-N/A-
	➤ Pressurization	-N/A-	-N/A-	-N/A-
	d) No. of continuous staircase to terrace	Required	One	MR
	e) Width of corridor	-N/A-	-N/A-	-N/A-
	f) Door size	1.0 m	1.0 m	MR
3	Compartmentation.			
	<ul style="list-style-type: none"> • Fire check door. • Sealing of electrical shafts. • Fire rating of shaft door. • Water curtain • Fire dampers. 	-N/A-	-N/A-	-N/A-
		-N/A-	-N/A-	-N/A-
		-N/A-	-N/A-	-N/A-
		-N/A-	-N/A-	-N/A-
		-N/A-	-N/A-	-N/A-
4.	Smoke Management system.			
	<ul style="list-style-type: none"> • Basement • Upper floors 	30 ACPH	-N/A-	-N/A-
		12 ACPH	-N/A-	-N/A-
5.	Fire Extinguishers.			
	<ul style="list-style-type: none"> • Total numbers • Types • ISI Marking 	08 nos	09 nos	MR
		ABC / CO ₂	ABC- 09 nos	MR
		Required	Provided	MR
6.	First Aid Hose Reels.			
	<ul style="list-style-type: none"> • Total numbers on each floor • Length of hose-reel hose. 	One	Provided	MR
		30 m	Provided	MR


7	Automatic fire detection & alarming system.			
	• Type of detectors	-N/A-	-N/A-	-N/A-
	• Location of Main Panel	-N/A-	-N/A-	-N/A-
	• Location of Repeater Panel	-N/A-	-N/A-	-N/A-
	• Alternate source of power	-N/A-	-N/A-	-N/A-
	• Hooter's location	-N/A-	-N/A-	-N/A-
8.	MOEFA			
9.	Public Address System			
10.	Automatic Sprinkler System			
	• Basement.	-N/A-	-N/A-	-N/A-
	• Upper floors	-N/A-	-N/A-	-N/A-
	• Sprinkler above false ceiling	-N/A-	-N/A-	-N/A-
11.	Internal Hydrants.			
	• Size of Riser / Down-comer	-N/A-	-N/A-	-N/A-
	• Number of Hydrant per floor	-N/A-	-N/A-	-N/A-
	• Hose box.	-N/A-	-N/A-	-N/A-
12.	Yard Hydrants.			
	• Total number of hydrants.	-NA-	-NA-	-NA-
	• Hose box.	-NA-	-NA-	-NA-
13.	Pumping arrangements.			
	• Ground Level			
	Discharge of main pump.	-N/A-	-N/A-	-N/A-
	➤ Head of main pump.	-N/A-	-N/A-	-N/A-
	➤ Number of main pumps.	-N/A-	-N/A-	-N/A-
	➤ Jockey Pump output.	-N/A-	-N/A-	-N/A-
	➤ Jockey Pump head.	-N/A-	-N/A-	-N/A-
	➤ Standby Pump output.	-N/A-	-N/A-	-N/A-
	➤ Standby Pump head.	-N/A-	-N/A-	-N/A-
	➤ Auto Starting/Manual stopping.	-N/A-	-N/A-	-N/A-
	➤ Pump house access.	-N/A-	-N/A-	-N/A-
	• Terrace Level			
	➤ Discharge of pump.	450 LPM	450 LPM	MR
	➤ Head of pump.	40 m	40 m	MR
	➤ Power supply.	Required	Provided	MR
	➤ Auto starting of pump.	Required	Provided	MR
14.	Captive water storage for firefighting.			
	• Underground tank capacity.	-N/A-	-N/A-	-N/A-
	➤ Draw-off connection.	-N/A-	-N/A-	-N/A-
	➤ Fire Service Inlet.	-N/A-	-N/A-	-N/A-
	➤ Access to tank.	-N/A-	-N/A-	-N/A-
	• Overhead tank capacity.	10,000 ltrs	10,000 ltrs	MR
15.	Exit Signage.			
		Required	Provided	MR
16.	Provision of Lifts.			
	• Pressurization of lift shaft.	-N/A-	-N/A-	-N/A-
	• Pressurization of lift lobby.	-N/A-	-N/A-	-N/A-
	• Communication in lift car.	-N/A-	-N/A-	-N/A-
	• Fireman's switch.	-N/A-	-N/A-	-N/A-
	• Lift signage.	-N/A-	-N/A-	-N/A-

17	Standby Power Supply	Required	Provided	MR
18.	Refuge Area			
	• Total area	-N/A-	-N/A-	-N/A-
	• Location	-N/A-	-N/A-	-N/A-
19.	Fire Control Room.			
	• Detector System Panel.	-N/A-	-N/A-	-N/A-
	• Flow Switch Panel.	-N/A-	-N/A-	-N/A-
	• PA system Panel.	-N/A-	-N/A-	-N/A-
	• Battery backup	-N/A-	-N/A-	-N/A-
	• Building floor plan	-N/A-	-N/A-	-N/A-
20.	Special Fire Protection System for the Protection of special Risk, if any.	Required	ABC type fire extinguisher provided near elect panel	MR

The Fire protection systems provided in the premises were checked / operated at random and found functional at the time of inspection.

In view the deemed compliance of the minimum standards on fire prevention and fire safety measures as required under Directorate of Education Circular, FSC issued vide letter no. F.6/DFS/MS/School/2017/SZ/1619 dated 13/11/2017, renewal under rule 37 of the Delhi Fire Service rules, 2010 is recommended.

Accordingly DFA is put up for approval and signature please.


28/12/2020

Signature of the Inspecting Officer

Name : Avtar Singh

Designation : ADO (M.RD)

DO (SD) — On Name

DCTD(S2)


F.T. please.



FT letter is put up for sign please.

DCTD(S2)

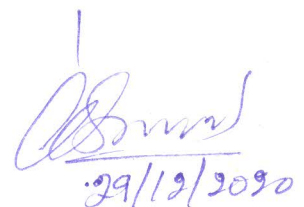


29/12/2020

M.S. cell