

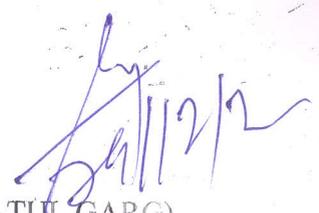
GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE, CONNAUGHT PLACE
NEW DELHI- 110001

No.F.6/DFS/MS/EH/2020/SZ/190

Dated: 29/12/2020

FIRE SAFETY CERTIFICATE

Certified that the Burger King India Pvt. Ltd. running at first floor of the building comprised of basement, stilt, ground plus two upper floors at J-1/162, Rajouri Garden, New Delhi-110027, owned/occupied by Burger King India Pvt. Ltd. have complied with the fire prevention and fire safety requirements in accordance with the NBC Part-IV and verified by the a team of officer concerned of this department on 14/12/2020 in the presence of Mr. Avneesh (Liaisoner) and found that the building is fit for occupancy 'Class D "Assembly Building"(Restaurant) ' for with effect from 29/12/2020 for a period of **three** years in accordance with the rule 36 unless renewed under rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules, 2010, printed overleaf
Issued on..... 29/12/2020 at New Delhi by


(ATUL GARG)
Director
Delhi fire Service

O/C

To,

M/s Burger King India Pvt. Ltd,
J-1/162, Rajouri Garden, New Delhi-110027

Copy to:-

The Dy. Health Officer (West Zone),
SDMC, Public Health Department,
Najafgarh Zone Dhansa Road, Najafgarh New Delhi-110043.

CONDITIONS:

- The owner /occupier shall apply for renewal of this fire safety certificate to the Director in form 'J' [sub rule (1) of rule 37] along with a copy of this certificate, six months prior to its expiry.
- All the means of escape shall be kept free of all the type of obstruction all the time.
- All the employees shall be acquainted with the use and maintenance of all fire equipments and method of smooth and speedy safe evacuation of occupants in case of emergency.
- All the fire fighting equipments shall be maintained in perfect working condition all the time and any lapse rendering non-functional of fire safety measures, management shall be responsible.
- The clarification with regards electrical installation, ventilation, structure stability set back areas, occupancy and constructional deviation in building etc .may be got verified from the authorities concerned.
- This Fire Safety Certificate can not be treated in any case for regularizations of unauthorized construction unauthorized use of land if any.
- The owner / occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rule 2010. The form is available on www.dfs.delhigovt.nic.in

INSPECTION REPORT

1. Name & address of the building : Burger King India Pvt. Ltd., J-1/162, Rajouri Garden, New Delhi-110027.
2. Building is comprised of : B,Stilt+ground+2 upper floor but Burger King running at First floor only.
3. Type of Occupancy : Assembly
4. Type of Case : New
5. Details of Previous NOC : Nil
6. Fire Safety direction letter No : Nil
7. Date of Inspection : 14/12/2020
8. Name of the Inspecting Officers: : DO D.B. Mukharjee & R.K.Yadav (ADO)
9. Name of the designation of Officer from the building side : Sh. Avneesh (Liaisoner)
10. Year of Construction : 2019-20
11. Applicant's letter No : On line application2020111808530 dated 19/11/2020

S.No	Minimum Standards on fire safety requirements	Requirement	Provided at Site	Remarks MR/NMR
1	Access to building			
	Road width	09 m	Provided	MR
	Gate width	N.A	N.A.	N.A.
	Width of internal road	N.A	N.A.	N.A.
2	Number, Width, Type and Arrangement of Exits.			
	a. Number of Staircases			
	Upper Floor	2 No.	2 No.	MR
	Basement	N.A	N.A.	N.A.
	B. Width of Staircases			
	Upper Floor	2 M&1.5 M	2 M&1.5 M	MR
	Basement	N.A	N.A.	N.A.
	c. Protection of exits			
	Fire check door	N.A	N.A.	N.A.
	Pressurization	N.A	N.A.	N.A.
	e. No. of continuous staircases to terrace	N.A	N.A.	N.A.
	g. Width of Corridor	Required	Provided	MR
h. No. of door	2 no.	2 no.	MR	
i. Door Size	2 m	2 m & 1.9 m	MR	
3	Compartmentation.			
	Fire check door	N.A	N.A.	N.A.
	Sealing of electrical shafts	N.A	N.A.	N.A.
	Fire rating of shaft door	N.A	N.A.	N.A.
	Water curtain	N.A.	N.A.	N.A.
	Fire Dampers	N.A.	N.A.	N.A.
4	Smoke Management System.			
	Basement	N.A	N.A.	N.A.
	Upper floor	Required	Provided	MR

5.	Fire Extinguisher			
	Total numbers	04 no.	04 no.	MR
	types	ABC & CO ₂	ABC & CO ₂	MR
	ISI marking	ISI marked	ISI marked	MR
6	First-aid-Hose Reels.			
	Total numbers of each floor	01 no.	01 no.	MR
	Length of hose reel hose	30 m	30 m	MR
	Nozzle diameter	5 mm	5 mm	MR
7	Automatic fire detection and alarming system.			
	Type of detectors	N.A	N.A.	N.A.
	Location of main panel	N.A	N.A.	N.A.
	Location of repeater panel	N.A	N.A.	N.A.
	Alternate source of power	N.A	N.A.	N.A.
	Hooters	N.A	N.A.	N.A.
8	MOEFA	Required	Provided	MR
9	Public address System.	N.A	N.A.	N.A.
10	Automatic Sprinkler System.			
	Basement	N.A	N.A.	N.A.
	upper floor	N.A	N.A.	N.A.
	sprinkler above false ceiling	N.A	N.A.	N.A.
11	Internal Hydrants			
	size of riser/down-comer	100 mm	100 mm	MR
	Number of hydrants each floor	1 no.	1 no.	MR
	Hose box each floor	1 no.	1no.	MR
12	Yard Hydrants.			
	Total number of hydrants	N.A	N.A	N.A
	Hose Box	N.A	N.A	N.A
13	Pumping Arrangements.			
	• Ground Level	N.A	N.A	N.A
	• Discharge of main Pump	N.A	N.A	N.A
	• Head of Main Pump	N.A	N.A	N.A
	• Number of main pumps	N.A	N.A	N.A
	• Jockey pump out put	N.A	N.A	N.A
	• Jockey pump head	N.A	N.A	N.A
	• Standby pump out put	N.A	N.A	N.A
	• Standby pump Head	N.A	N.A	N.A
	• Auto Starting /Manual stopping	N.A	N.A	N.A
	• Pump House Access	N.A	N.A	N.A
	• Terrace Level			
	• Discharge of pump	450 LPM	450 LPM	MR
	• Head of the Pump	30 M	30 M	MR.
	• Power supply	Required	Provided	MR
	• Auto Starting of pump	Required	Provided	MR

14	Captive Water Storage for Fire Fighting. for entire Mall			
	Underground tank capacity	N.A	N.A	N.A
	Draw-off connection	N.A	N.A	N.A
	Fire service inlet	Required	Provided	MR
	Access to tank	20,000 Liters	20,000 Liters	MR
	Overhead Tank capacity			
15	Exit Signage.	Required	Provided	MR
16	Provision of Lifts.			
	Pressurization of Lift Shaft	N.A	N.A.	N.A.
	Pressurization of Lift lobby	N.A	N.A.	N.A.
	Communication in lift car	N.A	N.A.	N.A.
	Firemen's grounding switch	N.A	N.A.	N.A.
	Lift Signage	N.A	N.A.	N.A.
17	Standby power supply	Required	Provided	MR
18	Refuge Area.			
	Total area	N.A.	N.A.	N.A.
	Location	N.A.	N.A.	N.A.
19	Fire Control Room			
	Detector system panel	N.A	N.A.	N.A.
	Flow switch panel	N.A	N.A.	N.A.
	PA system panel	N.A	N.A.	N.A.
	Batter backup	N.A	N.A.	N.A.
	Building Floor Plans	N.A	N.A.	N.A.
20	Special Fire Protection systems for protection of special Risks, if any:	N.A	N.A.	N.A.

The fire protection systems provided in the building were tested/checked and found functional at the time of inspection

Keeping in view the compliance of the minimum standards on fire prevention and fire safety required under the rules it is recommended to grant Fire Safety Certificate under rule 35 of the Delhi Fire Service Rule 2010.

Signature of the Inspecting Officer
Name :-D.B.Mukharjee
Designation :-DO(SW)

Signature of the Inspecting Officer
Name :-R.K.Yadav
Designation :-ADO(JKP)



DCFO (South Zone)