

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI

HEADQUARTERS: DELHI FIRE SERVICE: NEW DELHI-110001

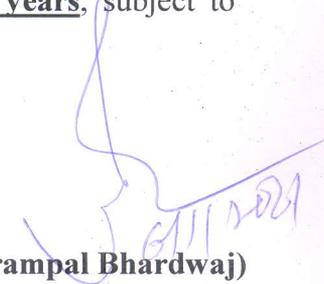
No. F6/DFS/MS/School/WZ/2020/ 16

Dated: 06/01/2021

FIRE SAFETY CERTIFICATE

Certified that **Glorious Public School, Sec-9, Rohini, Delhi-110085**, comprised of **Two Blocks, Gr. + One upper floor & Gr.+ Two upper floor** owned/occupied by **Glorious Public School** has already been issued fire safety certificate **vide letter no. F6/DFS/MS/2016/1148 dated 15.07.2016**. The premises was re-inspected by the officer from this department on dated **22.12.2020** in the presence of **Smt. Unmukta Aggarwal (Principal)** and observed that all the fire prevention and fire safety arrangement as provided in the premises found in good working condition. The premises have therefore deem complied with the requirements under rule 33 of the Delhi Fire Service Rules, 2010 and the building premise is fit for occupancy under **Group Class B (Educational)** with effect from **06 / 01 /2021** for a period of **three years**, subject to compliance of the conditions mentioned below:

Issued on 06/01/2021 at New Delhi by


(Dhrampal Bhardwaj)
Dy.Chief Fire Officer
Tel;-01123414250

012
H

Copy to:

1. The Principal, Glorious Public School, Sec-9, Rohini, Delhi-110085.
2. The Director of Education, Old Secretariat, Delhi.

Conditions for the validity of Fire Safety Certificate:

1. All the fire safety arrangement provided there-in shall be maintained in good working conditions at all times.
2. Loss of life or property due to non functional fire safety measure shall be at the responsibility of the management.
3. The trained fire fighting staff should be available round the clock.
4. Any deviation with regard to the construction etc shall be verified by the concerned building sanctioning agency.
5. This certificate cannot be treated in any case for regularizations of unauthorized construction
6. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director of Form 'J' [sub rule (1) of rule 37] along with a copy of this Certificate, six months prior to its expiry".
7. The owner / occupier shall submit a declaration every year in form "K" provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on http://www.delhi.gov.in/wps/wcm/connect/doi_fire/FIRE/Home/Fire+Safety+Acts+and+R.ules/ http://www.delhi.gov.in/wps/wcm/connect/doi_fire/FIRE/Home/Forms

1. Name & address of the building : Glorious Public School, Sec-9, Rohini, Delhi-110085,
2. Type of Occupancy : Educational
3. Type of Case : Renewal (Two blk-Gr.+02 & Gr.+01)
4. Details of previous NOC : F6/DFS/MS/2016/1148 Dated 15.07.2016
5. Fire Safety directives letter No : Direction of Education dated 17.01.2005
6. Date of inspection : 22.12.2020
7. Name of the Inspecting Officers : ADO (Rohini)
8. Name and designation of officers
from the building side : Smt.. Unmukta Aggarwal (Principal)
9. Year of Construction : 2010
10. Applicant's letter No. : Online mail dated 04.12.2020

	Minimum Standards on fire prevention and fire safety U/R 33	Dir. of Edu. Requirement	Provided at site	Remarks MR/NMR
1	Access to building			
	• Road width	Accessible	12.0 mtr	M/R
	• Gate width	Accessible	4.5 mtr	M/R
	• Width of internal road	N/A	N/A	N/A
2	Number, Width, Type & Arrangement of Exits			
	a. Number of staircases	N/A	N/A	N/A
	• Upper Floors	02	02	MR
	• Basements	N/A	N/A	N/A
	b. Width of staircases	N/A	N/A	N/A
	• Upper Floors	1.50 mtr	1.35 & 1.36 mtr	M/R (Old Case)
	• Basements	N/A	N/A	N/A
	c. Protection of exits	N/A	N/A	N/A
	• Fire check door	N/A	N/A	N/A
	• Pressurization	N/A	N/A	N/A
	e. No. of continuous staircases to terrace	N/A	N/A	N/A
	g. Width of Corridor	N/A	N/A	N/A
	h. Door Size	1.0 mtr	1.0 mtr	MR
3	Compartmentation.			
	• Fire check door	N/A	N/A	N/A
	• Sealing of electrical shafts	N/A	N/A	N/A
	• Fire Rating of shaft door	N/A	N/A	N/A
	• Water Curtain	N/A	N/A	N/A
	• Fire Dampers	N/A	N/A	N/A
4	Smoke Management System.			
	• Basements	30 a/c per hour	N/A	N/A
	• Upper floors	12 a/c per hour	Natural Ventilation	M/R

	➤ Power Supply	Required	Provided	M/R
	➤ Auto Starting of pump	Required	Provided	MR
14	Captive Water Storage for fire fighting.			
	• Underground tank capacity	N/A	N/A	N/A
	➤ Draw-off connection	N/A	N/A	N/A
	➤ Fire service inlet	N/A	N/A	N/A
	➤ Access to tank	N/A	N/A	N/A
	• Overhead Tank capacity	2500 ltr	5000 ltr	MR
15	Exit Signage.	Required	Provided	MR
16	Provision of Lifts.			
	• Pressurization of Lift Shaft	N/A	N/A	N/A
	• Pressurization of Lift lobby	N/A	N/A	N/A
	• Communication In lift Car	N/A	N/A	N/A
	• Fireman's Grounding Switch	N/A	N/A	N/A
	• Lift Signage	N/A	N/A	N/A
17	Standby power supply	N/A	N/A	N/A
18	Refuge Area.			
	➤ Total Area	N/A	N/A	N/A
	➤ Location	N/A	N/A	N/A
19	Fire Control Room			
	• Detector System Panel	N/A	N/A	N/A
	• Flow Switch Panel	N/A	N/A	N/A
	• PA System Panel	N/A	N/A	N/A
	• Batter backup	N/A	N/A	N/A
	• Building Floor Plans	N/A	N/A	N/A
20	Special Fire Protection Systems for Protection of special Risks, if any:	N/A	N/A	N/A

The fire protection systems provided in the building were test checked and found functional at the time of inspection.

In view of the deemed compliance of the minimum standards of the fire prevention and fire safety measures as required under the rules the NOC issued vide letter no. F6/DFS/MS/2016/1148 Dated 15.07.2016. Renewal under rule 37 of the Delhi Fire Service rules 2010 is recommended.

Signature of the Inspecting Officer
 Name Ajay Kumar Sharma
 Designation ADO (Rohini)

DO(NW)

28/12/2020
 Dy CEO (W2)

29/12/20