

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI  
HEADQUARTERS: DELHI FIRE SERVICE: CONNAUGHT PLACE  
NEW DELHI-110001


No. F.6 DFS/MS/School/2020/SZ /29

Dated: 12/01/2021

**FIRE SAFETY CERTIFICATE**

Certified that the Ganga Devi Public School, E-6, Om Nagar, Mithapur, Badarpur, New Delh-110044 comprised of ground floor only **Owned/Occupied** by Ganga Devi Public was issued FSC by this department vide letter No. F.6/DFS/MS/School/SZ/2014/39 dated 10/01/2014. The premises was re-inspected by officer concerned of this department on 01/12/2020 in presence of Mr. Mohan Lal (In-charge) of the school and observed that there has been addition of upper floors in existing building comprised of lower ground (repairing of road ground floor convert into lower ground floor), ground plus three uppers floors and that the school building have deemed complied with the fire prevention and fire safety arrangement in accordance with rule 33 of Delhi Fire Service Rules, 2010 and that the school building premises is fit for occupancy class "**Educational Building**" **Group-B**, with effect from 12/01/2021...2021 for a period of **Three years** in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules, 2010.

Issued on 12/01/2021 at New Delhi by

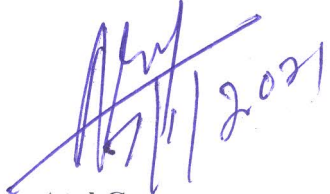  
Atul Garg  
Director  
Delhi fire service  
o/c AG

Copy to: -

1. The Principal, Ganga Devi Public School, E-6, Om Nagar, Mithapur, Badarpur, New Delhi-110044
2. The Directorate of Education, Govt. of NCT of Delhi, Old Secretariat, New Delhi.

**Conditions for the validity of Fire Safety Certificate**

1. All the fire safety and means of escape facilities shall be maintained in good working condition at all time. Any lapse rendering the fire safety or means of evacuation facilities non-functional shall be the responsibility of the management.
2. Building Sanctioning authority may verify any deviation with regard to construction/occupancy in the building. In case of any deviation, the fire safety certificate stands null & void.
3. The staff members must know the correct method of operation of firefighting system.
4. The certificate cannot be treated as regularization of unauthorized construction, if any.
5. The owner/ occupier shall submit a declaration every year in Form 'K' provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on [www.dfs.delhigovt.nic.in](http://www.dfs.delhigovt.nic.in)
6. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in Form 'J' [sub rule (1) of rule 37] along with a copy of this Certificate, six months prior to its expiry. The form is available on [www.dfs.delhigovt.nic.in](http://www.dfs.delhigovt.nic.in)



### INSPECTION REPORT

1	Name & Address of the Building	Ganga Devi Public School, E-6, Om Nagar, Meethapur, Badarpur, New Delhi-110044		
2	Type of Occupancy	Educational Building, "Group-B"		
3	Building Comprised of	LG + Ground + 3 upper floors (old building is Ground floor only & repairing of road ground floor convert into lower ground floor and building is comprised of lower ground, ground and three upper floors)		
4	Type of Case	Renewal/Addition		
5	Details of Previous NOC	F.6/DFS/MS/School/2014/SZ/39 dated 10-01-2014 for Ground floor		
6	Fire Safety Directives Letter No	Nil		
7	Date of Inspection	01/12/2020		
8	Name of the Inspecting Officers	Avtar, ADO (MR)		
9	Name & Designation of Officers from the building side	Mr. Mohan Lal (In Charge)		
10	Year of construction	2000 & 2017-2018		
11	Applicant letter No.	Outdoor dairy No. 7045 dated 02/09/2020		
<b>S. No</b>	<b>Minimum standards on Fire Prevention and Fire Safety U/R 33</b>	<b>UBBL-16 Requirements</b>	<b>Provided at Site</b>	<b>Remarks MR/NMR</b>
<b>1</b>	<b>Access to Building.</b>			
	• Road width	6 mtr	Provided	MR
	• Gate width	-NA-	-NA-	-NA-
	• Width of internal road	-NA-	NA	-NA-
<b>2</b>	<b>Number, width, type &amp; arrangement of exits.</b>			
	<b>a) Number of Staircase</b>			
	➤ Upper floors	Two	Two	MR
	➤ Basement floor/Lower Ground	Two	Two	MR
	<b>b) Width of Staircase</b>			
	➤ Upper floors	1.5m	1.53m & 1.50m	MR
	➤ Basement floor/Lower Ground	1.5m	1.53m & 1.50m	MR
	<b>c) Protection of exits</b>			
	➤ Fire check door	-NA-	-NA-	-NA-
	➤ Pressurization	-NA-	-NA-	-NA-
	<b>d) No. of continuous staircase to terrace</b>	One	One	MR
	<b>e) Width of corridor</b>	1.5m	Provided	MR
	<b>f) Door size</b>	Old Floor-1m New Floor-1.20	Old Floor-1m New Floor-1.20	MR
<b>3</b>	<b>Compartmentation.</b>			
	• Fire check door.	-NA-	-NA-	-NA-
	• Sealing of electrical shafts.	-NA-	-NA-	-NA-
	• Fire rating of shaft door.	-NA-	-NA-	-NA-
	• Water curtain	-NA-	-NA-	-NA-
	• Fire dampers.	-NA-	-NA-	-NA-
<b>4.</b>	<b>Smoke Management system.</b>			
	• Basement.	-NA-	-NA-	-NA-
	• Upper floors	-NA-	-NA-	-NA-

<b>5.</b>	<b>Fire Extinguishers.</b>			
	• Total numbers	15 Nos	15 Nos	MR
	• Types	ABC / CO <sub>2</sub>	ABC type	MR
	• ISI Marking	ISI marked	Provided	MR
<b>6.</b>	<b>First Aid Hose Reels.</b>			
	• Total numbers on each floor.	One	Provided	MR



	<ul style="list-style-type: none"> <li>Length of hose-reel hose.</li> <li>Nozzle Diameter</li> </ul>	30m	Provided	MR
		5mm	Provided	MR
7	<b>Automatic fire detection &amp; alarming system.</b>			
	<ul style="list-style-type: none"> <li>Type of detectors</li> <li>Location of Main Panel</li> <li>Location of Repeater Panel</li> <li>Alternate source of power</li> <li>Hooter's location</li> </ul>	-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
8.	<b>MOEFA</b>	-NA-	-NA-	-NA-
9.	<b>Public Address System</b>	-NA-	-NA-	-NA-
10.	<b>Automatic Sprinkler System</b>			
	<ul style="list-style-type: none"> <li>Basement.</li> <li>Upper floors</li> <li>Sprinkler above false ceiling</li> </ul>	-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
11.	<b>Internal Hydrants.</b>			
	<ul style="list-style-type: none"> <li>Size of Riser / Down-comer</li> <li>Number of Hydrant per floor</li> <li>Hose box.</li> </ul>	100 mm	Provided	MR
		01 no	Provided	MR
		01 no	Provided	MR
12.	<b>Yard Hydrants.</b>			
	<ul style="list-style-type: none"> <li>Total number of hydrants.</li> <li>Hose box.</li> </ul>	-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
13.	<b>Pumping arrangements.</b>			
	<ul style="list-style-type: none"> <li><b>Ground Level</b> <ul style="list-style-type: none"> <li>Discharge of main pump.</li> <li>Head of main pump</li> <li>Number of main pumps.</li> <li>Jockey Pump output.</li> <li>Jockey Pump head.</li> <li>Standby Pump output.</li> <li>Standby Pump head.</li> <li>Auto Starting/Manual Stopping.</li> </ul> </li> <li><b>Terrace Level</b> <ul style="list-style-type: none"> <li>Discharge of pump.</li> <li>Head of pump.</li> <li>Power supply.</li> <li>Auto starting of pump.</li> </ul> </li> </ul>	-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		450 LPM	Provided	MR
		40 mtr	Provided	MR
		Required	Provided	MR
		Required	Provided	MR
14.	<b>Captive water storage for Fire Fighting.</b>			
	<ul style="list-style-type: none"> <li>Underground tank capacity. <ul style="list-style-type: none"> <li>Draw-off connection.</li> <li>Fire Service Inlet.</li> <li>Access to tank.</li> </ul> </li> <li>Overhead tank capacity.</li> </ul>	-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		10,000 ltrs	Provided	MR
		Required	Provided	MR
15.	<b>Exit Signage.</b>			
16.	<b>Provision of Lifts.</b>			
	<ul style="list-style-type: none"> <li>Pressurization of lift shaft.</li> <li>Pressurization of lift lobby.</li> <li>Communication in lift car.</li> <li>Fireman's switch.</li> <li>Lift signage.</li> </ul>	-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
17	<b>Standby Power Supply</b>	-NA-	-NA-	-NA-
18.	<b>Refuge Area</b>			
	<ul style="list-style-type: none"> <li>Total area</li> <li>Location</li> </ul>	-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
19.	<b>Fire Control Room.</b>			
	<ul style="list-style-type: none"> <li>Detector System Panel.</li> </ul>	-NA-	-NA-	-NA-



• Flow Switch Panel.	-NA-	-NA-	-NA-
• PA system Panel.	-NA-	-NA-	-NA-
• Battery backup	-NA-	-NA-	-NA-
• Building floor plan	-NA-	-NA-	-NA-

**20. Special Fire Protection System for the Protection of special Risk, if any.**

Previously, school building comprised of ground floor only was issued FSC vide letter dated 10/01/2014(C-6). The school management added floors in existing building and building is comprised of (ground floor convert into a lower ground after repairing of road) lower ground floor, ground and three upper floors.

The school management submitted electricity bill (C-8), building plan (C-15) and MCD Tax receipt (C-16) for construction proof.

The Fire protection systems provided in the premises were checked / operated at random and found functional at the time of inspection.

The shortcoming issued by the department vide letter No F6/DFS/MS/School/2018/SZ/305 dated 05/03/2018 have been rectified


Keeping in view the substantial compliance of the minimum standards on fire prevention and fire safety measures as required under the rule, it is recommended to grant Fire Safety Certificate under rule 35 of the Delhi Fire Service Rules, 2010

Accordingly DFA is put up for approval and signature please.

*(Signature)*  
14/12/2020

Signature of the Inspecting Officer  
Name: Avtar Singh  
Designation: ADO (MR)

DO (SD) on line

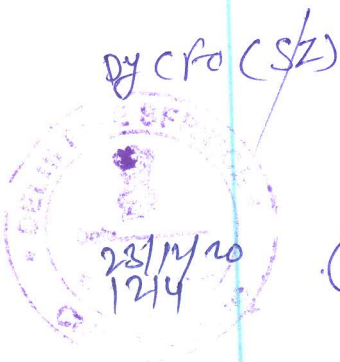

*(Signature)*  
22/12  
C.P.O.

*(Signature)*  
22/12

~~*(Signature)*~~  
20/12/2020  
(473)

फर्मा यह व दीप कि  
फ्लोर फ्लोर एंड ग्राउंड फ्लोर  
बिना फ्लोर के नहीं करवाएँ  
बिना approval के  
24/12/20

DFA 1/22