

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE: CONNAUGHT PLACE
NEW DELHI-110001

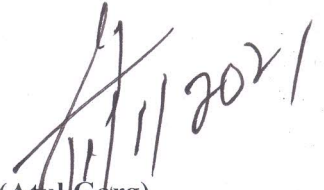
No. F.6 DFS/MS/School/2021/SZ /30

Dated: 12/01/2021

FIRE SAFETY CERTIFICATE

Certified that **Wings Academy School**, Near Arya Smaj Mandir, Bhangar Mohalla, Tughlakabad Village, New Delhi-11004 comprised of Ground plus one upper floor (**School running at Ground floor only**) was inspected by the officer concerned of this department on 28/12/2020 in presence of Ms Tabassum (Principal) of the school and found that said school building have complied with the fire prevention and fire safety arrangements in accordance with rule 33 of Delhi Fire Service, 2010 and that the school building is fit for occupancy class "**Education Building**" **Group-B**, as above with effect from ...12/01/2021 for period of Three years in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules, 2010.

Issued on 12/01/2021 at New Delhi by


(Atul Garg)
Director
Delhi Fire Service
olc Ar

Copy to: -

1. The Principal, Wings Academy School, Near Arya Smaj Mandir, Bhangar Mohalla, Tughlakabad Village, New Delhi-110044
2. The Directorate of Education, Old Secretariat, GNCT of Delhi, New Delhi-110006

Conditions for the validity of Fire Safety Certificate

1. All the means of escape/entry/exit shall be kept free from any obstruction.
2. All the fire safety arrangements provided therein shall be maintained in good working condition at all time as seen during inspection. Any loss of life or property due to non-functional fire safety measures shall be at the responsibility of the management.
3. All the staff members must know the correct method of operation of firefighting system.
4. This Certificate cannot be treated as regularization of unauthorized construction, if any.
5. The Owner/Occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rules, 2010. The form is available on www.dfs.delhigovt.nic.in.
6. The Owner/Occupier shall apply for renewal of this Fire Safety Certificate to the Director in the form 'J' [sub rule (1) of rule 37] along with copy of this certificate, six months prior to its expiry. The form is available on www.dfs.delhigovt.nic.in.

INSPECTION REPORT

1	Name & Address of the Building	Wings Academy School, Near Arya Smaj Mandir, Bhangar Mohalla, Tughlakabad Village, New Delhi-110044		
2	Type of Occupancy	Educational "Group-B" (School)		
3	Building Comprised of	Ground + 01 upper floor (School Running at Ground Floor)		
4	Type of Case	New		
5	Details of Previous NOC	Nil		
6	Fire Safety Directives Letter No	Nil		
7	Date of Inspection	28/12/2020		
8	Name of the Inspecting Officers	Avtar, ADO (MR)		
9	Name & Designation of Officers from the building side	Ms Tabassum (Principal)		
10	Year of construction			
11	Applicant letter No.	Email dated 28/08/2020		

S. No	Minimum standards on Fire Prevention and Fire Safety U/R 33	NBC/BBL Requirements	Provided at Site	Remarks MR/NMR
1	Access to Building.			
	<ul style="list-style-type: none"> • Road width • Gate width • Width of internal road 	<ul style="list-style-type: none"> Accessible N/A N/A 	<ul style="list-style-type: none"> 6 m ✓ N/A N/A 	<ul style="list-style-type: none"> MR N/A N/A
2	Number, width, type & arrangement of exits			
	a) Number of Staircase			
	➤ Upper floors	01 nos	01 nos	MR
	➤ Basement floor	N/A	N/A	N/A
	b) Width of Staircase			
	➤ Upper floors	N/A	0.95 m	N/A
	➤ Basement floor	N/A	N/A	N/A
	c) Protection of exits			
	➤ Fire check door	N/A	N/A	N/A
	➤ Pressurization	N/A	N/A	N/A
	d) No. of continuous staircase to terrace	N/A	N/A	N/A
	e) Width of corridor	N/A	N/A	N/A
	f) Door size	1m	1m	MR
3	Compartmentation.			
	<ul style="list-style-type: none"> • Fire check door. • Sealing of electrical shafts. • Fire rating of shaft door. • Water curtain • Fire dampers. 	<ul style="list-style-type: none"> N/A N/A N/A N/A N/A 	<ul style="list-style-type: none"> N/A N/A N/A N/A N/A 	<ul style="list-style-type: none"> N/A N/A N/A N/A N/A
4.	Smoke Management system.			
	<ul style="list-style-type: none"> • Basement • Upper floors 	<ul style="list-style-type: none"> 30 ACPH 12 ACPH 	<ul style="list-style-type: none"> N/A N/A 	<ul style="list-style-type: none"> N/A N/A
5.	Fire Extinguishers.			
	<ul style="list-style-type: none"> • Total numbers • Types • ISI Marking 	<ul style="list-style-type: none"> 06 no's ABC / CO₂ ISI marked 	<ul style="list-style-type: none"> 06 no's ABC & CO₂ Provided 	<ul style="list-style-type: none"> MR MR MR
6.	First Aid Hose Reels.			
	<ul style="list-style-type: none"> • Total numbers on each floor. • Length of hose-reel hose. • Nozzle Diameter 	<ul style="list-style-type: none"> N/A N/A N/A 	<ul style="list-style-type: none"> N/A N/A N/A 	<ul style="list-style-type: none"> N/A N/A N/A

7	Automatic fire detection & alarming system			
	• Type of detectors	N/A	N/A	N/A
	• Location of Main Panel	N/A	N/A	N/A
	• Location of Repeater Panel	N/A	N/A	N/A
	• Alternate source of power	N/A	N/A	N/A
	• Hooter's location	N/A	N/A	N/A
8.	MOEFA	N/A	N/A	N/A
9.	Public Address System	N/A	N/A	N/A
10.	Automatic Sprinkler System			
	• Basement	N/A	N/A	N/A
	• Upper floors	N/A	N/A	N/A
	• Sprinkler above false ceiling	N/A	N/A	N/A
11.	Internal Hydrants.			
	• Size of Riser/Down-comer	N/A	N/A	N/A
	• Number of Hydrant per floor	N/A	N/A	N/A
	• Hose box.	N/A	N/A	N/A
12.	Yard Hydrants.			
	• Total number of hydrants.	N/A	N/A	N/A
	• Hose box.	N/A	N/A	N/A
13.	Pumping arrangements.			
	• Ground Level			
	➤ Discharge of main pump.	N/A	N/A	N/A
	➤ Head of main pump.	N/A	N/A	N/A
	➤ Number of main pumps.	N/A	N/A	N/A
	➤ Jockey Pump output.	N/A	N/A	N/A
	➤ Jockey Pump head.	N/A	N/A	N/A
	➤ Standby Pump output.	N/A	N/A	N/A
	➤ Standby pump head.	N/A	N/A	N/A
	➤ Auto Starting/Manual Stopping.	N/A	N/A	N/A
	• Terrace Level			
	➤ Discharge of pump.	N/A	N/A	N/A
	➤ Head of pump.	N/A	N/A	N/A
	➤ Power supply.	N/A	N/A	N/A
	➤ Auto starting of pump.	N/A	N/A	N/A
14.	Captive water storage for Fire Fighting.			
	• Underground tank capacity.	N/A	N/A	N/A
	➤ Draw-off connection.	N/A	N/A	N/A
	➤ Fire Service Inlet.	N/A	N/A	N/A
	➤ Access to tank.	N/A	N/A	N/A
	• Overhead tank capacity.	N/A	N/A	N/A
15.	Exit Signage.	Required	Provided	NR
16.	Provisions of Lifts.			
	• Pressurization of lift shaft.	N/A	N/A	N/A
	• Pressurization of lift lobby.	N/A	N/A	N/A
	• Communication in lift car.	N/A	N/A	N/A
	• Fireman's switch.	N/A	N/A	N/A
	• Lift signage.	N/A	N/A	N/A
17	Standby Power Supply	N/A	N/A	N/A
18.	Refuge Area			
	• Total area	N/A	N/A	N/A
	• Location	N/A	N/A	N/A
19.	Fire Control Room.			
	• Detector System Panel.	N/A	N/A	N/A
		N/A	N/A	N/A

	• Flow Switch Panel.	N/A	N/A	N/A
	• PA system Panel.	N/A	N/A	N/A
	• Battery backup	N/A	N/A	N/A
	• Building floor plan	N/A	N/A	N/A
20.	Special Fire Protection System for the Protection of special Risk, if any.	Required	ABC type extinguisher provided near elect. panel	MR

The Fire protection systems provided in the premises were checked / operated at random and found functional at the time of inspection.

Keeping in view the substantial compliance of the minimum standards on fire prevention and fire safety required under the rules it is recommended to grant Fire Safety Certificate under rule 37 of the Delhi Fire Service Rules 2010.

Accordingly DFA is put up for approval and signature please.

(Signature)
01/01/2021

Signature of the Inspecting Officer
Name : Avtar Singh
Designation: ADO (MR)

~~DO (SD)~~

What is the use of 1st floor?

(Handwritten note)
दिवाली

~~ADO (MR)~~

1st floor is used as residence, file is re submitted please.

(Signature)
06/01/2021

DO(SD) - On leave + off

~~DCP(S2)~~



(Handwritten notes)
C.F.O. - 20/1/21

(Handwritten notes)
20/1/21

HTB