

**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEAD QUARTERS: DELHI FIRE SERVICE: CONNAUGHT PLACE
NEW DELHI-110001**


No.F.6 DFS/MS/School/2021/SZ/ 69

Dated: 28/01/2021

FIRE SAFETY CERTIFICATE

Certified that the **Sarvodaya Kanya Vidyalaya, Aya Nagar New Delhi 110047** comprised of Two blocks, ground plus One upper floors & One New Blocks Ground plus Three upper floors was granted Fire Safety Certificate by this department vide letter No. F6/DFS/MS/School/2011/SZ/1172 Dt. 04/08/2017. The said premises was re-inspected by officer concerned of this department on 11/12/2020 in presence of Sh. Beehan Pandit (Vice Principal) of the school and found that **GBSSS Aya Nagar (ID-1923354) running in two old blocks only** and said school building have deemed complied with the fire prevention and fire safety requirements in accordance with DOE Circular dated 01/03/2011 and that the building is fit for occupancy class "**Educational Building Group – B**" with effect from 28/01/2021 for a period of **Three years** in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under rule 38 of Delhi Fire Service Rules 2010.

Issued on 28/01/2021 at New Delhi by



(Sunil Chawdhary)
Dy. Chief Fire Officer (SZ)
Delhi Fire Service

Copy to: -

1. The Principal, Govt. boys Sr. Secondary School, Aya Nagar, New Delhi, 110047
2. The Director of Education, Govt. of NCT of Delhi, Old Secretariat, New Delhi.

Conditions for the validity of Fire Safety Certificate

1. All the means of escape/entry/exit shall be kept free from any obstruction.
2. All the fire safety arrangements provided therein shall be maintained in good working condition at all time as seen during inspection. Any loss of life or property due to non-functional fire safety measures shall be at the responsibility of the management.
3. All the staff members must know the correct method of operation of firefighting system.
4. This certificate cannot be treated as regularization of unauthorized construction, if any.
5. The owner/ occupier shall submit a declaration every year in Form 'K' provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on www.dfs.delhigovt.nic.in
6. This fire safety certificate may not in any way be treated as regularization (Clause 2.8 of UBBL-2016) of unauthorized construction or Alteration (Clause 1.4.3 of UBBL-2016), if any.
7. "The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in Form 'J' [sub rule (1) of rule 37] along with a copy of this Certificate, six months prior to its expiry."

275

INSPECTION REPORT

1	Name & Address of the Building	Govt. Boys Senior Secondary School, Aya Nagar New Delhi 110047 (ID-1923354)		
2	Type of Occupancy	Educational		
3	Building Comprised of	Two Blocks, Ground plus one upper floor		
4	Type of Case	Renewal		
5	Details of Previous NOC	F6/DFS/MS/School/2011/SZ/1172 Dt. 04/08/2017 (for Two old block- Ground + One Upper floors & One New Block Ground + Three Upper Floor) Now Two Blocks, Ground + One Upper floors are GBSS School, Aya Nagar, & New Block, SKV Aya Nagar, Delhi are separately		
6	Fire Safety Directives Letter No	F.16//Estate/CC/Fire Safety/2011/3298 to 3398 dated 01.03.2011		
7	Date of Inspection	15/01/2021		
8	Name of the Inspecting Officers	Sh. Rajesh Kumar ADO (BCP)		
9	Name & Designation of Officers from the building side	Sh. Beehan Pandit (Vice Principal)		
10	Year of construction	1949		
11	Applicant letter No.	Gmail ID Dated 06/01/2021		
S. No	Minimum standards on Fire Prevention and Fire Safety U/R 33	Old NOC requirements	Provided at Site	Remarks MR/NMR
1	Access to Building.			
	• Road width	6mtr	7 mtr	MR
	• Gate width	4.5 m	5 x 2 mtr	MR
	• Width of internal road	-NA-	-NA-	-NA-
2	Number, width, type & arrangement of exits.			
	a) Number of Staircase			
	➤ Upper floors.	Old Block 01 – 02	Old Block 01 – 02	MR
	➤ Basement floor.	Old Block 02 – 02	Old Block 02 – 02	
		-NA-	-NA-	-NA-
	b) Width of Staircase			
	➤ Upper floors	1.5 m/ 0.75 m	Old Block 01 – 1.70 & 1.50 m Old Block 02 – 1.65 mtr each	MR
	➤ Basement floor	-NA-	-NA-	-NA-
	c) Protection of exits			
	➤ Fire check door	-NA-	-NA-	-NA-
	➤ Pressurization	-NA-	-NA-	-NA-
	d) No. of continuous staircase to terrace	One	One in each block	MR
	e) Width of corridor	-NA-	-NA-	-NA-
	f) Door size	1 mtr	1 mtr	MR
3	Compartmentation.			
	• Fire check door.	-NA-	-NA-	-NA-
	• Sealing of electrical shafts.	-NA-	-NA-	-NA-
	• Fire rating of shaft door.	-NA-	-NA-	-NA-
	• Water curtain	-NA-	-NA-	-NA-
	• Fire dampers.	-NA-	-NA-	-NA-
4.	Smoke Management system.			
	• Basement	30a/c per hour	-NA-	-NA-
	• Upper floors	12a/c per hour	-NA-	-NA-
5.	Fire Extinguishers.			
	• Total numbers	Required	35 Nos	MR
	• Types	CO ² &ABC	CO ² & ABC	MR
	• ISI Marking	ISI mark	Provided	MR


1

26

6.	First Aid Hose Reels.			
	<ul style="list-style-type: none"> Total numbers on each floor. 	-NA-	-NA-	-NA-
	<ul style="list-style-type: none"> Length of hose-reel hose. 	-NA-	-NA-	-NA-
	<ul style="list-style-type: none"> Nozzle Diameter 	-NA-	-NA-	-NA-
7	Automatic fire detection & alarming system.			
	<ul style="list-style-type: none"> Type of detectors 	-NA-	-NA-	-NA-
	<ul style="list-style-type: none"> Location of Main Panel 	-NA-	-NA-	-NA-
	<ul style="list-style-type: none"> Location of Repeater Panel 	-NA-	-NA-	-NA-
	<ul style="list-style-type: none"> Alternate source of power 	-NA-	-NA-	-NA-
	<ul style="list-style-type: none"> Hooter's location 	-NA-	-NA-	-NA-
8.	MOEFA	-NA-	-NA-	-NA-
9.	Public Address System	-NA-	-NA-	-NA-
10.	Automatic Sprinkler System			
	<ul style="list-style-type: none"> Basement 	-NA-	-NA-	-NA-
	<ul style="list-style-type: none"> Upper floors 	-NA-	-NA-	-NA-
	<ul style="list-style-type: none"> Sprinkler above false ceiling 	-NA-	-NA-	-NA-
11.	Internal Hydrants.			
	<ul style="list-style-type: none"> Size of Riser/Down-comer 	-NA-	-NA-	-NA-
	<ul style="list-style-type: none"> Number of Hydrant per floor 	-NA-	-NA-	-NA-
	<ul style="list-style-type: none"> Hose box. 	-NA-	-NA-	-NA-
12.	Yard Hydrants.			
	<ul style="list-style-type: none"> Total number of hydrants. 	-NA-	-NA-	-NA-
	<ul style="list-style-type: none"> Hose box. 	-NA-	-NA-	-NA-
13.	Pumping arrangements.			
	<ul style="list-style-type: none"> Ground Level 			
	<ul style="list-style-type: none"> ➤ Discharge of main pump. 	-NA-	-NA-	-NA-
	<ul style="list-style-type: none"> ➤ Head of main pump. 	-NA-	-NA-	-NA-
	<ul style="list-style-type: none"> ➤ Number of main pumps. 	-NA-	-NA-	-NA-
	<ul style="list-style-type: none"> ➤ Jockey Pump output. 	-NA-	-NA-	-NA-
	<ul style="list-style-type: none"> ➤ Jockey Pump head. 	-NA-	-NA-	-NA-
	<ul style="list-style-type: none"> ➤ Standby Pump output. 	-NA-	-NA-	-NA-
	<ul style="list-style-type: none"> ➤ Standby Pump head. 	-NA-	-NA-	-NA-
	<ul style="list-style-type: none"> ➤ Auto Starting / Manual Stopping. 	-NA-	-NA-	-NA-
	<ul style="list-style-type: none"> ➤ Pump house access. 	-NA-	-NA-	-NA-
	<ul style="list-style-type: none"> Terrace Level 			
	<ul style="list-style-type: none"> ➤ Discharge of pump. 	-NA-	-NA-	-NA-
	<ul style="list-style-type: none"> ➤ Head of pump. 	-NA-	-NA-	-NA-
	<ul style="list-style-type: none"> ➤ Power supply. 	-NA-	-NA-	-NA-
	<ul style="list-style-type: none"> ➤ Auto starting of pump. 	-NA-	-NA-	-NA-
14.	Captive water storage for fire fighting.			
	<ul style="list-style-type: none"> Underground tank capacity. 	-NA-	-NA-	-NA-
	<ul style="list-style-type: none"> ➤ Draw-off connection. 	-NA-	-NA-	-NA-
	<ul style="list-style-type: none"> ➤ Fire Service Inlet. 	-NA-	-NA-	-NA-
	<ul style="list-style-type: none"> ➤ Access to tank. 	-NA-	-NA-	-NA-
	<ul style="list-style-type: none"> Overhead tank capacity. 	-NA-	-NA-	-NA-
15.	Exit Signage.	-NA-	-NA-	-NA-
16.	Provision of Lifts.			
	<ul style="list-style-type: none"> Pressurization of lift shaft. 	-NA-	-NA-	-NA-
	<ul style="list-style-type: none"> Pressurization of lift lobby. 	-NA-	-NA-	-NA-
	<ul style="list-style-type: none"> Communication in lift car. 	-NA-	-NA-	-NA-
	<ul style="list-style-type: none"> Fireman's switch. 	-NA-	-NA-	-NA-
	<ul style="list-style-type: none"> Lift signage. 	-NA-	-NA-	-NA-
17.	Standby Power Supply	-NA-	-NA-	-NA-


2

27/7

18.	Refuge Area			
	• Total area	-NA-	-NA-	-NA-
	• Location	-NA-	-NA-	-NA-
19.	Fire Control Room.			
	• Detector system panel.	-NA-	-NA-	-NA-
	• Flow switch panel.	-NA-	-NA-	-NA-
	• PA system panel.	-NA-	-NA-	-NA-
	• Battery backup.	-NA-	-NA-	-NA-
	• Building floor plan.	-NA-	-NA-	-NA-
20.	Special Fire Protection System for the Protection of special Risk, if any.	-NA-	-NA-	-NA-
<p>The fire protection system provided in the building were randomly checked and found functional at the time of inspection.</p> <p>Keeping in view of the deemed compliance of the minimum standard on fire prevention and fire safety measures as required under the rules, the FSC issued vide letter no F6/DFS/MS/School/2011/SZ/1172 Dt. 04/08/2017 (for Two old block- Ground + One Upper floors & One New Block Ground + Three Upper Floor), renewal under rule 37 of the Delhi Fire Service rules, 2010 is recommended.</p> <p>Accordingly, DFA is put up for approval and signature please.</p> <p style="text-align: right;">  Signature of the Inspecting Officer Name: Sh. Rajesh Kumar Design: ADO (BCP) </p>				

Dolso on leave


Dy. CPO/S2

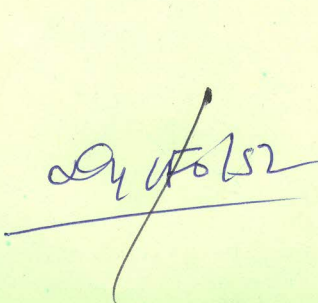
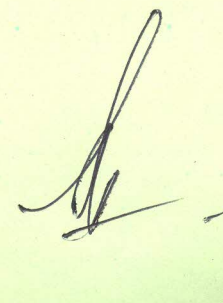


F.T. please.

~~ADO BCP~~

As approved, F.T. letter is put up for your signature pl


22/11/2017

M.S. (S)