

**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI**  
**HEADQUARTERS: DELHI FIRE SERVICE, NEW DELHI-110001**

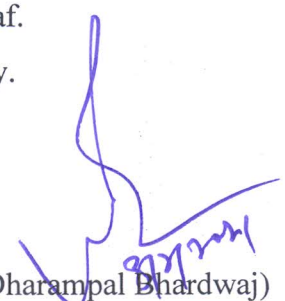
No.F.6/DFS/MS/WZ/2021/ 88

Dated: 03/02/2021

**FIRE SAFETY CERTIFICATE**

Certified that M/s. Asian Paints Ltd. Located at Khasra No. 111/6 & 111/15, Phirni Road, Mundka, New Delhi- 110041, comprised of Ground Floor only owned / occupied by M/s. Asian Paints Ltd., was granted Fire Safety Certificate vide letter No. F.6/DFS/MS/WZ/1513 dated 23.10.2017. The building was re-inspected by the officer concerned of this department on 16/01/2021 in the presence of Sh. Surender Singh (Manager) and found that the management have deemed complied with the fire prevention and fire safety requirements in accordance with rule 33 of the Delhi Fire Service Rules, 2010 and that the premises is fit for occupancy class Storage (Group- H) with effect from 03/02/2021 for a period of Three years in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules 2010, printed overleaf.

Issued on 03/02/2021 at New Delhi by.

  
(Dharampal Bhardwaj)  
Dy. Chief Fire Officer  
West Zone



Copy to :-

1. The authorized signatory, M/s Asian Paints Ltd. At Khasra No. 111/6 & 111/15, Phirni Road, Mundka, New Delhi- 110041.

## Conditions for the Validity of Fire Safety Certificate

1. All the fire safety arrangements provided therein shall be maintained in good working conditions at all times.
2. Any loss of life or property due to non-functional of fire safety measures shall be at the risk & responsibility of the management.
3. The trained firefighting staffs should be available round the clock.
4. Any deviation w.r.t. construction etc. shall be verified by the concerned building sanctioning authority.
5. This fire safety certificate may not be treated in any case for regularization of unauthorized construction, if any.
6. All the means of escapes /exits shall not be locked/bolted/blocked at any time for safe evacuation of the occupants in case of any emergency.
7. The owner / occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on [www.dfs.delhigovt.nic.in](http://www.dfs.delhigovt.nic.in)
8. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in Form "J" [ sub rule (1) of rule 37] along with a copy of this certificate, six months prior to its expiry. The form is available on [www.dfs.delhigovt.nic.in](http://www.dfs.delhigovt.nic.in)

1. Name & address of the building : Asian Paints, Khasra No. 111/6,111/15,Phirmi Road, Mundka, New Delhi- 110041.
2. Type of Occupancy : Storage (Group- H)
3. Type of Case : Renewal
4. Details of previous NOC : F6/DFS/MS/WZ/1513 Dated-23/10/2017
5. Fire Safety directives letter No : NBC (Part-IV)
6. Date of inspection : 16-01-2021
7. Name of the Inspecting Officers : Aman Kumar Lathar (Jwalapuri)
8. Name and designation of officers from the building side : Mr. Sanjit Kumar, Dy. Manager
9. Year of Construction : 2011
10. Applicant's letter No. : E-mail [anantkumar.sharma@asianpaints.com](mailto:anantkumar.sharma@asianpaints.com) dated 07.01.2021

S. No.	Minimum Standards on fire prevention and fire safety U/R 33	Fire safety requirements as per NBC/BBL	Provided at site	Remarks MR/NMR
1	<b>Access to building</b>			
	• Road width	06 mtr.	12 mtr.	MR
	• Gate width	05 mtr	05 mtr	MR
	• Width of internal road	03 mtr	03 mtr	MR
2	<b>Number, Width, Type &amp; Arrangement of Exits</b>			
	a. Number of staircases	-	-	-
	• Upper Floors	N/R	N/R	N/R
	• Basements	N/R	N/R	N/R
	b. Width of staircases	N/R	N/R	N/R
	• Upper Floors	N/R	N/R	N/R
	• Basements	N/R	N/R	N/R
	c. Protection of exits	N/R	N/R	N/R
	• Fire check door	N/R	N/R	N/R
	• Pressurization	N/R	N/R	N/R
	e. No. of continuous staircases to terrace	N/A	N/A	N/A
	g. Width of Corridor	N/A	N/A	N/A
	h. Door Size	1.50 mtr.	3.00 mtr.	MR
3	<b>Compartmentation.</b>			
	• Fire check door	N/R	N/R	N/R
	• Sealing of electrical shafts	N/R	N/R	N/R
	• Fire Rating of shaft door	N/R	N/R	N/R
	• Water Curtain	N/R	N/R	N/R
	• Fire Dampers	N/R	N/R	N/R
4	<b>Smoke Management System.</b>			
	• Basements	No Basement	N/A	N/A
	• Upper floors	Required	Exhaust fan Provided	MR
5	<b>Fire Extinguishers</b>			
	• Total numbers	12	25	MR
	• Types	ABC/Co <sub>2</sub> /Foam	Provided	MR
	• IS marking	ISI marked	Provided	MR


6	<b>First-Aid Hose Reels.</b>			MR
	<ul style="list-style-type: none"> <li>Total numbers on each floor</li> <li>Length of hose reel hose</li> <li>Nozzle diameter</li> </ul>	3	10	MR
		30 mtr.	30 mtr.	MR
		5 mm	5 mm	MR
7	<b>Automatic fire detection and alarming system.</b>			
	<ul style="list-style-type: none"> <li>Type of detectors</li> <li>Location of Main Panel</li> <li>Location of Repeater Panel</li> <li>Alternate source of power</li> <li>Hooters' Location</li> </ul>	Smoke / Beam	Beam	MR
		Ground Floor	Provided	MR
		Ground Floor	Provided	MR
		Required	Provided	MR
		Ground Floor	Provided	MR
8	<b>MOEFA</b>	N/R	N/R	N/R
9	<b>Public Address System.</b>	Required	Provided	MR
10	<b>Automatic Sprinkler System.</b>			
	<ul style="list-style-type: none"> <li>Basement</li> <li>Upper Floor /GF</li> <li>Sprinkler above false ceiling</li> </ul>	N/A	N/A	N/A
		Required	Provided	MR
		N/R	NP	NR
11	<b>Internal Hydrants</b>			
	<ul style="list-style-type: none"> <li>Size of riser/down-comer</li> <li>Number of hydrants per floor</li> <li>Hose Box</li> </ul>	150mm	150mm	MR
		5	5	MR
		5	5	MR
12	<b>Yard Hydrants.</b>			
	<ul style="list-style-type: none"> <li>Total number of hydrants</li> <li>Hose Box</li> </ul>	5	10	MR
		5	10	MR
13	<b>Pumping Arrangements.</b>			
	<ul style="list-style-type: none"> <li>Ground Level <ul style="list-style-type: none"> <li>Discharge of main Pump</li> <li>Head of Main pump</li> <li>Number of main pumps</li> <li>Jockey Pump out put</li> <li>Jockey pump head</li> <li>Standby Pump out put</li> <li>Standby Pump Head</li> <li>Auto Starting/ Manual stopping</li> <li>Pump House Access</li> </ul> </li> <li>Terrace level <ul style="list-style-type: none"> <li>Discharge of pump</li> <li>Head of the pump</li> <li>Power Supply</li> <li>Auto Starting of pump</li> </ul> </li> </ul>	---	---	---
		2280LPM	2280LPM	MR
		65MH	65MH	MR
		1	1	MR
		220LPM	220LPM	MR
		65MH	65MH	MR
		2280LPM	2280LPM	MR
		65MH	65MH	MR
		Required	Provided	MR
		Required	Provided	MR
		-----	-----	-----
		NR	NR	NR
		NR	NR	NR
		NR	NR	NR
		NR	NR	NR
14		<b>Captive Water Storage for fire fighting.</b>		
	<ul style="list-style-type: none"> <li>Underground tank capacity</li> <li>Draw-off connection</li> <li>Fire service inlet</li> <li>Access to tank</li> </ul>	50000Ltr	50000Ltr	MR
		NR	NP	NR
		NR	N/A	NR
		Required	Provided	MR

		Required	Provided	MR
15	<b>Exit Signage.</b>			
16	<b>Provision of Lifts.</b>			
	• Pressurization of Lift Shaft	NR	NR	NR
	• Pressurization of Lift lobby	NR	NR	NR
	• Communication In lift Car	NR	NR	NR
	• Fireman's Grounding Switch	NR	NR	NR
	• Lift Signage	NR	NR	NR
17	<b>Standby power supply</b>	Required	Provided	MR
18	<b>Refuge Area.</b>			
	➤ Total Area	NR	NR	NR
	➤ Location	NR	NR	NR
19	<b>Fire Control Room</b>			
	• Detector System Panel	NR	NR	NR
	• Flow Switch Panel	NR	NR	NR
	• PA System Panel	NR	NR	NR
	• Batter backup	NR	NR	NR
	• Building Floor Plans	NR	NR	NR
20	Special Fire Protection Systems for Protection of special Risks, if any:	NR	NR	NR


The fire protection systems provided in the building were checked and found functional at the time of inspection.

In view of the deemed compliance of the minimum standards on fire prevention and fire safety measures as required under the rules, the NOC issued vide letter No. F6/DFS/MS/WZ/1513 dated 23/10/2017, renewal under rule 35 of the Delhi Fire Service rules 2010 is recommended.

DFA is put up for approval & signature please.


  
Asst. Div. Officer (JWP)

~~D.O. (West)~~

 22/1/2021

D.O. (WEST) 16  
DATED 22/01/21

~~DCFO (W2)~~


 22/1/2021

~~ADP/Sup~~

F.T. letter is put-up for signature pl.

~~DCFO (W2)~~

22/1/2021

  
22/02/21  
Asst. Div. Officer (JWP)