

**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE NEW DELHI-110001**


No. F6/DFS/MS/2021/School/WZ /123

Dated: 17/02/2021

FIRE SAFETY CERTIFICATE

Certified that the Building situated at **Govt. Girls Sr. Sec. School, Begampur, Delhi-110086**, comprised of **02 blocks, One block Ground + One upper floor & 2nd block, Ground + Three upper floors** owned/occupied by **Govt. Girls Sr. Sec. School**, has already been issued FSC by this department vide letter No. **F.6/DFS/MS/2017/School/WZ/1045 dated 17.07.2017**. The premises was re-inspected by the officer concerned of this department on **05.02.2021** in the presence of **Mr. Sunil Kumar (Estate Manager)** and observed that all the fire prevention and fire safety arrangements as provided in the premise found in good working condition. The premises have therefore deemed complied with the requirements under Rule 33 of the Delhi Fire Service Rules, 2010 and that the premises fit for occupancy under Educational "Group B" with effect from **17/02/2021** for a period of three years in accordance with Rule 36 unless renewed under Rule 37 or sooner cancelled under Rule 40 and subjected to compliance of the conditions under Rule 38 of the Delhi Fire Service Rules, 2010.

Issued on **17/02/2021** at New Delhi by


(Dhrampal Bhardwaj)
Dy.Chief Fire Officer
Tel:-01123414250

Copy to :-

1. The Principal, Govt. Girls Sr. Sec. School, Begampur, Delhi-110086.
2. The Director of Education, Old Secretariat, Delhi

Conditions for validity of Fire Safety Certificate;

1. All the fire safety arrangement provided there-in shall be maintained in good working conditions at all times.
2. Loss of life or property due to non functional fire safety measure shall be at the responsibility of the management.
3. The trained fire fighting staff should be available round the clock.
4. Any deviation with regard to the construction etc shall be verified by the concerned building sanctioning agency.
5. This certificate cannot be treated in any case for regularizations of unauthorized construction.
6. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director along with a copy of this Certificate, six months prior to its expiry".
7. The owner / occupier shall submit a declaration every year in form "K" provided in the first schedule of Delhi Fire Service Rules 2010. The form "K" is available on

http://www.delhi.gov.in/wps/wcm/connect/doiit_fire/FIRE/Home/Fire+Safety+Acts+and+Rules/
http://www.delhi.gov.in/wps/wcm/connect/doiit_fire/FIRE/Home/Forms


1. Name & address of the building : Govt. Girls Sr. Sec. School, Begampur, Delhi- 110086.
2. Type of Occupancy : Educational
3. Type of Case : Renewal(Two blk-one blk-Gr.+01, & 02Blk-Gr.+03)
4. Details of previous NOC : F.6/DFS/MS/2017/School/WZ/1045 dated 17.07.2017
5. Fire Safety directives letter No : NBC Part-IV
6. Date of inspection : 05.02.2021
7. Name of the Inspecting Officers : ADO (Rohini)
8. Name and designation of officers
from the building side : Mr. Sunil Kumar(Estate Manager)
9. Year of Construction : 2013 & 2014
10. Applicant's letter No. : Online mail dated 20.01.2021


	Minimum Standards on fire prevention and fire safety U/R 33	NBC Requirement	Provided at site	Remarks MR/NMR
1	Access to building			
	• Road width	Accessible	Accessible	M/R
	• Gate width	Accessible	4.5 mtr	M/R
	• Width of internal road	N/A	N/A	N/A
2	Number, Width, Type & Arrangement of Exits			
	a. Number of staircases	N/A	N/A	N/A
	• Upper Floors	Blk-I-02	Blk-I-02	MR
	• Basements	Blk-II-03	Blk-II-03	
		N/A	N/A	N/A
	b. Width of staircases	1.50 mtr	Blk-I-1.5 m each Blk-II-1.7 m x 03	MR
	• Upper Floors			
	• Basements	N/A	N/A	N/A
	c. Protection of exits	N/A	N/A	N/A
	• Fire check door	N/A	N/A	N/A
	• Pressurization	N/A	N/A	N/A
	e. No. of continuous staircases to terrace	01	02	MR
	g. Width of Corridor	Required	Provided	MR
	h. Door Size	1.0 mtr	1.10 mtr	MR
3	Compartmentation.			
	• Fire check door	N/A	N/A	N/A
	• Sealing of electrical shafts	N/A	N/A	N/A
	• Fire Rating of shaft door	N/A	N/A	N/A
	• Water Curtain	N/A	N/A	N/A
	• Fire Dampers	N/A	N/A	N/A
4	Smoke Management System.			
	• Basements	30 a/c per hour	N/A	N/A
	• Upper floors	12 a/c per hour	Natural ventilated	MR

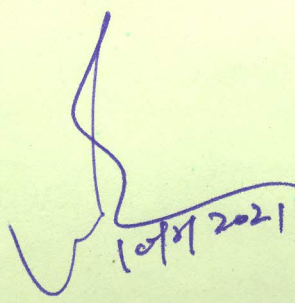
	➤ Head of the pump	Required	Provided	MR
	➤ Power Supply	Required	Provided	MR
	➤ Auto Starting of pump			
14	Captive Water Storage for fire fighting.			
	• Underground tank capacity	N/A	N/A	N/A
	➤ Draw-off connection	N/A	N/A	N/A
	➤ Fire service inlet	N/A	N/A	N/A
	➤ Access to tank	N/A	N/A	N/A
	• Overhead Tank capacity	10,000 ltr	10,000 ltr	MR
15	Exit Signage.	Required	Provided	MR
16	Provision of Lifts.			
	• Pressurization of Lift Shaft	N/A	N/A	N/A
	• Pressurization of Lift lobby	N/A	N/A	N/A
	• Communication In lift Car	N/A	N/A	N/A
	• Fireman's Grounding Switch	N/A	N/A	N/A
	• Lift Signage	N/A	N/A	N/A
17	Standby power supply	N/A	N/A	N/A
18	Refuge Area.			
	➤ Total Area	N/A	N/A	N/A
	➤ Location	N/A	N/A	N/A
19	Fire Control Room			
	• Detector System Panel	N/A	N/A	N/A
	• Flow Switch Panel	N/A	N/A	N/A
	• PA System Panel	N/A	N/A	N/A
	• Batter backup	N/A	N/A	N/A
	• Building Floor Plans	N/A	N/A	N/A
20	Special Fire Protection Systems for Protection of special Risks, if any:	N/A	N/A	N/A

The fire protection systems provided in the building were tested/ checked randomly and found in working condition at the time of inspection.

In view of the deemed compliance of the minimum standards of the fire prevention and fire safety measures as required under the rules the NOC issued vide letter no. F.6/DFS/MS/2017/School/WZ/1045 dated 17.07.2017 is recommended for renewal under rule 37 of the Delhi Fire Service rules 2010


 Signature of the Inspecting Officer
 Name Ajay Kumar Sharma
 Designation ADO (Rohini)

DO (NW)

 10/02/2021
 Dy. CTO, WZ


 10/02/2021

FT letter is put up for kind perusal and signature ps