

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE: CANNAUGHT PLACE
NEW DELHI- 110 001


No. F6/DFS/MS/Assembly/2021/ 131

Dated: 19/02/2021

FIRE SAFETY CERTIFICATE

Certified that the M/s Auditorium at Swaminarayan Akshardham Temple, N. H.-24, opp. Nizamuddin Bridge, Delhi-110092 comprised of ground floor only owned/occupied by BAPS Swaminarayan Sanstha was issued FSC vide letter No. F6/DFS/MS/Auditorium/2018/NDZ/451 dated 19/03/18. The auditorium building was re-inspected by the officer concerned of this department in presence of Sh. D. V. Swamiji and found that the auditorium building have deemed complied with the fire prevention and fire safety requirements in accordance with rule 33 of the Delhi Fire Service Rules, 2010 and observed that the auditorium building is fit for occupancy Group D "Assembly Building" with effect from 19.02.2021 for a period of **three** years in accordance with the rule 36 unless renewed under rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules, 2010, subject to conditions printed below.

Issued on.....19/02/2021.....at New Delhi by


19/02/21

(Dr. S. K. Tomar)
Dy. Chief Fire Officer

To,

Sh. D.V. Swamiji
BAPS Swaminarayan Sanstha
Swaminarayan Akshardham Temple, N. H.-24
Opp. Nizamuddin Bridge, Delhi-110092

Copy to:-

The Joint Commissioner of Police(Lic.)
First Floor, Police Station Defence Colony
New Delhi

Conditions for the validity of Fire Safety Certificate

1. All the means of escape shall be kept free of all type of obstruction all the time.
2. All the employees shall be acquainted with the use and maintenance of all fire equipments and method of smooth and speedy safe evacuation of occupants in case of emergency.
3. All the fire fighting equipment shall be maintained in perfect working condition all the time and any lapse rendering non-functional of fire safety measures, management shall be responsible.
4. Any deviation, with regards to construction, ventilation, occupancy, electric installation etc. may be got verified from the concerned authorities.
5. This Fire Safety Certificate may not be treated in any case for regularizations of unauthorized construction /unauthorized use of land if any.
6. The owner / occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rule 2010. The form is available on www.dfs.delhigovt.nic.in
7. The owner / occupier shall apply for renewal of this Fire Safety Certificate of the Director in Form 'J' [sub rule (1) of rule (37)] along with a copy of this Certificate, Six Months prior to its expiry.

1. Name & address of the building : Auditorium at Swaminarayan Akshardham Temple, N. H.-24, opp. Nizammuddin Bridge, Delhi-110092
2. Building is comprised of : Ground floor only
3. Type of Occupancy : Assembly Building
4. Type of Case : Renewal
5. Details of Previous NOC letter : F6/DFS/MS/Auditorium/2018/NDZ/451 dt 19/03/18
6. Fire Safety directive letter No : NBC Part IV
7. Date of Inspection : 19/02/2021
8. Name of the Inspecting officers : DO F. Brown
9. Name and designation of officer from the building side : Sh. D. V. Swamiji
10. Year of construction : 2005
11. Applicant's letter No : 72-76/Joint C.P./Lic.(Amst.), Dated-10/02/2021


Sr. No.	Minimum Standards on Fire Prevention and Fire Safety U/R33	Requirement	Provided at Site	Remarks MR/NMR
01	Access to Building.			
	• Road width	06 mtr.	20 mtr.	MR
	• Gate width	4.50 mtr.	06 mtr.	MR
	• Width of internal road	N/A	N/A	N/A
02	Number, Width, Type and Arrangement of Exits.			
	a. Number of Staircases			
	• Upper floor	02 nos	02 nos	MR
	• Basement	N/A	N/A	N/A
	B. Width of Staircases			
	• Upper floor	02 nos	02 nos	MR
	• Basement	N/A	N/A	N/A
	c. Protection of Exits			
	• Fire check door	N/A	N/A	N/A
	• Pressurization	N/A	N/A	N/A
	d. No. of Continuous Staircases to Terrace	N/A	N/A	N/A
	e. Width of Corridor	N/A	N/A	N/A
	f. Door Size	02 nos	02 nos	MR
03	Compartmentation.			
	• Fire check door	N/A	N/A	N/A
	• Sealing of electrical shafts	Required	Sealed	MR
	• Fire rating of shaft door	N/A	N/A	N/A
	• Water curtain	N/A	N/A	N/A
	• Fire dampers	N/A	N/A	N/A
04	Smoke Management System./			
	• Basement	N/A	N/A	N/A
	• Upper floor	Required	Provided	MR
05.	Fire Extinguishers.			
	• Total numbers	10 nos.	10 nos.	MR
	• Types	ABC /CO ₂	ABC /CO ₂	MR
	• IS marking	ISI marked	ISI marked	MR

06	First-Aid-Hose Reels.			
	• Total numbers on each floor	02 no.	02 no.	MR
	• Length of hose reel hose	30 mtr.	30 mtr.	MR
	• Nozzle diameter	05 mm	05 mm	MR
07	Automatic Fire Detection and Alarming System.			
	• Type of detectors	Smoke	Provided	MR
	• Location of main panel	Control Room	Provided	MR
	• Location of repeater panel	Security Room	Provided	MR
	• Alternate source of power	Batter & DG Set	Provided	MR
	• Hooter's location	Hall	Provided	MR
08	MOEFA	Required	Provided	MR
09	Public Address System.	Required	Provided	MR
10	Automatic Sprinkler System.			
	• Basement	N/A	N/A	N/A
	• upper floor	N/A	N/A	N/A
	• sprinkler above false ceiling	N/A	N/A	N/A
11	Internal Hydrants			
	• size of riser/down-comer	100 mm	100 mm	MR
	• Number of hydrants per floor	01 nos.	01 nos.	MR
	• Hose box	01 nos.	01 nos.	MR
12	Yard Hydrants.			
	• Total number of hydrants	02 nos.	02 nos..	MR
	• Hose box	02 nos.	02 nos.	MR
13	Pumping Arrangements.			
	➤ Ground Level			
	• Discharge of main pump	2850 Lpm	2850 Lpm	MR
	• Head of main pump	70 mtr	70 mtr	MR
	• Number of main pumps	01 no.	01 no.	MR
	• Jockey pump out put	225 Lpm	225 Lpm	MR
	• Jockey pump head	70 mtr	70 mtr	MR
	• Standby pump out put	2850 Lpm.	2850 Lpm.	MR
	• Standby pump head	70 mtr	70 mtr	MR
	• Auto starting /manual stopping	Required	Provided	MR
	• Pump house access	Required	Provided	MR
	➤ Terrace Level			
	• Discharge of pump	N/A	N/A	N/A
	• Head of the pump	N/A	N/A	N/A
	• Power supply	N/A	N/A	N/A
	• Auto starting of pump	N/A	N/A	N/A
14	Captive Water Storage for Fire Fighting.			
	• Underground tank capacity	2,00,000 Ltr.	4,00,000 Ltr..	MR
	• Draw-off connection	N/A	Provided	MR
	• Fire service inlet	N/A	Provided	MR
	• Access to tank	N/A	Provided	MR
	• Overhead tank capacity	N/A	N/A	N/A
15	Exit Signage.	Required	Provided	MR

16	Provision of Lifts.			
	• Pressurization of lift shaft	N/A	N/A	N/A
	• Pressurization of lift lobby	N/A	N/A	N/A
	• Communication in lift car	N/A	N/A	N/A
	• Firemen's grounding switch	N/A	N/A	N/A
	• Lift signage	N/A	N/A	N/A
17	Standby Power Supply	Required	Provided	MR
18	Refuge Area.			
	• Total area	N/A	N/A	N/A
	• Location	N/A	N/A	N/A
19	Fire Control Room			
	• Detector system panel	Required	Provided	MR
	• Flow switch panel	N/A	N/A	N/A
	• PA system panel	N/A	Provided	MR
	• Battery backup	Required	Provided	MR
	• Building floor plans	N/A	Provided	MR
20	Special Fire Protection systems for protection of special Risks, if Any:	N/A	N/A	N/A

The fire protection systems provided in the building were tested/checked and found functional at the time of inspection.

Keeping in view the substantial deemed compliance of the minimum standards on fire prevention and fire safety required under the rule, it is recommended to renew Fire Safety Certificate.

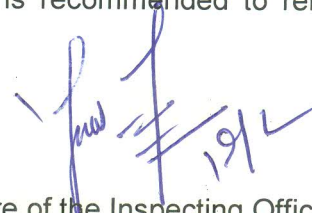

Signature of the Inspecting Officer

Name :- F. Brown

Designation :- D.O (E.D.)

DY. CPO/HD-21

Q. Tombo
19/2/21

M.S. (E)