

**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE: CONNAUGHT PLACE
NEW DELHI-110001**


No. F.6/DFS/MS/Assembly/SZ/2021/ 133

Dated. 19/02/2021

FIRE SAFETY CERTIFICATE

Certified that Science of Soul Research Centre, located at Kishangarh, Near Sector- A, Vasant Kunj, New Delhi Comprised of Basement, Stilt, Ground + One Upper floors owned/ occupied by Science of the Soul Research Centre was issued Fire Safety Certificate by this department vide letter no. F.6/DFS/MS/Assembly/SZ/2017/717 dated 18/05/2017. The premise was re-inspected by the officer concerned of this department on 09/02/2021 in the presence of Sh. Sat Narayan and found that the said premise have deemed complied with the fire prevention and fire safety requirements in accordance with rule 33 of the Delhi Fire Service Rules, 2010 and that the premises is fit for occupancy **Class D "Assembly Building" Religious** as above with effect from 19/02/2021 for a period of three years in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules, 2010.

Issued on 19/02/2021 at New Delhi by


(Sunil Chawdhary)
Dy. Chief Fire Officer (SZ)
Delhi Fire Service



Copy to: -

1. The Authorized Signatory, Science of Soul Research Centre, Guru Ravi Dass Marg, Pusa Road, New Delhi -110005.
2. The Ex. Engineer (Bldg) Building Department, SDMC, Civic Center, Minto Road, New Delhi.

Conditions for the validity of Fire Safety Certificate: -

1. All the means of escape/entry/exit shall be kept free from any obstruction.
2. All the fire safety arrangement provided therein shall be maintained in good working condition at all time as seen during inspection. Any loss of life property due to non-functional fire safety measures shall be at the responsibility of the management.
3. All the staff members must know the correct method of operation of fire fighting system.
4. Any deviation w.r.t construction etc. shall be verified by the concerned building sanctioning authority.
5. The basement shall be used as per the provisions of BBL.
6. The owner/occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on www.dfs.delhigovt.nic.in
7. This fire safety certificate may not in any way be treated as regularization (Clause 2.8 of UBBL-2016) of unauthorized construction or alteration (Clause 1.4.3 of UBBL-2016), if any.
8. "The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in form 'J' [sub rule (I) of rule 37] along with a copy of this Certificate, six month prior to its expiry."

INSPECTION REPORT

1	Name & Address of the Building	M/s Science of the Soul Research Centre, Kishangarh, Near Sector-A, Pocket A, Vasant Kunj, New Delhi.		
2	Type of Occupancy	Assembly Building "Group-D" (Religious)		
3	Building Comprised of	Basement, Stilt, Ground + One Upper Floor		
4	Type of Case	Renewal		
5	Details of Previous NOC	F.6/DFS/MS/Assembly/SZ/2017/717 Dated 18/05/2017		
6	Fire Safety Directives Letter No	F6/DFS/MS/2014/128 dated 12/05/2014		
7	Date of Inspection	09/02/2021		
8	Name of the Inspecting Officers	Sh. Rajesh Kumar		
9	Name & Designation of Officers from the building side	Sh. Sat Narayan		
10	Year of construction	2015		
11	Applicant letter No.	E-mail Dated 28/01/2021		
S. No	Minimum standards on Fire Prevention and Fire Safety U/R 33	BBL/NBC Requirement	Provided at Site	Remarks MR/NMR
1	Access to Building.			
	<ul style="list-style-type: none"> • Road width • Gate width • Width of internal road 	<ul style="list-style-type: none"> 9m 5m N/A 	<ul style="list-style-type: none"> 9m 5m N/A 	<ul style="list-style-type: none"> MR MR N/A
2	Number, width, type and arrangements of exits.			
	a. Number of Staircase			
	<ul style="list-style-type: none"> • Upper floors • Basement floor 	<ul style="list-style-type: none"> 02 Nos. 02 Nos. 	<ul style="list-style-type: none"> 02 Nos. 02 Nos. 	<ul style="list-style-type: none"> MR MR
	b. Width of Staircase			
	<ul style="list-style-type: none"> • Upper floors • Basement floor 	<ul style="list-style-type: none"> 2m & 1.5m 2m & 1.5m 	<ul style="list-style-type: none"> 2m & 1.59m 2m & 1.50m 	<ul style="list-style-type: none"> MR MR
	c. Protection of exits			
	<ul style="list-style-type: none"> • Fire check door • Pressurization 	<ul style="list-style-type: none"> Required N/A 	<ul style="list-style-type: none"> Provided N/A 	<ul style="list-style-type: none"> MR N/A
	d. No. of continuous staircase to terrace	Two	Two	MR
	e. Width of corridor	N/A	N/A	N/A
	f. Door size	1.25m	1.25m	MR
3	Compartmentation.			
	<ul style="list-style-type: none"> • Fire check door. • Sealing of electrical shafts. • Fire rating of shaft door. • Water curtain • Fire dampers. 	<ul style="list-style-type: none"> N/A Required N/A N/A Required 	<ul style="list-style-type: none"> N/A Provided N/A N/A Provided 	<ul style="list-style-type: none"> N/A MR N/A N/A MR
4	Smoke Management system.			
	<ul style="list-style-type: none"> • Basement • Upper floors 	<ul style="list-style-type: none"> 30 ACPH 12 ACPH 	<ul style="list-style-type: none"> Exhaust Fan Provided Natural Ventilation 	<ul style="list-style-type: none"> MR MR
5	Fire Extinguishers.			
	<ul style="list-style-type: none"> • Total numbers • Types • ISI Marking 	<ul style="list-style-type: none"> 06 Nos. ABC/CO₂ ISI marked 	<ul style="list-style-type: none"> 06 Nos. ABC & CO₂ Provided 	<ul style="list-style-type: none"> MR MR MR
6	First Aid Hose Reels.			
	<ul style="list-style-type: none"> • Total numbers on each floor. • Length of hose-reel hose. • Nozzle Diameter 	<ul style="list-style-type: none"> One 30m 5mm 	<ul style="list-style-type: none"> One 30m 5mm 	<ul style="list-style-type: none"> MR MR MR


19.	Fire Control Room.			
	• Detector System Panel.	N/A	N/A	N/A
	• Flow Switch Panel.	N/A	N/A	N/A
	• PA system Panel.	N/A	N/A	N/A
	• Battery backup	N/A	N/A	N/A
	• Building floor plan	N/A	N/A	N/A
20.	Special Fire Protection System for the Protection of special Risk, if any :	N/A	N/A	N/A





The Fire protection systems provided in the building were test checked at random and found functional at the time of inspection.

Further, the party has complied all the observation / Shortcoming already issued & communicated by this department vide letter of even no 103 dated 14/01/2020.

Keeping in view of the deemed compliance of the minimum standard on fire prevention and fire safety measures as required under the rules, the FSC issued vide letter no F.6/DFS/MS/Assembly/SZ/2017/717 dated 18/05/2017, renewal under rule 37 of the Delhi Fire Service rules, 2010 is recommended.


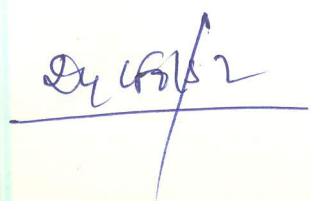

Accordingly, DFA is put up for approval and signature please.


 Signature of the Inspecting Officer
 Name: Sh. Rajesh Kumar
 Designation: ADO (BCP)



 F. F. please



A D O B C P

As approved, F.T. letter is put up for your signature pl

M S R