

**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI**  
**HEAD QUARTERS: DELHI FIRE SERVICE: NEW DELHI - 110001**

No. F6 / DFS / MS / 2021 / W2/School/163

Dated: 01 / 03 / 2021

**FIRE SAFETY CERTIFICATE**

Certified that the **Bright Star Convent Public School** located at **A-153, Phool Bagh Road, Shastri Park Ext Burari, Delhi-110084** comprised of **ground and 02 upper floors (School is running on Ground + 01 upper floor only)** owned/ occupied by the **Bright Star Convent Public School** was issued fire safety certificate vide this office letter no. **F.6/DFS/MS/2017/School/WZ/129** dated **02.02.2017**. The premises was re-inspected by the officer concerned of this department on **22.02.2021** in presence of **Mr. Ashwani Kumar (Principal)** and observed that all the fire safety arrangements as provided in the premises found in good working condition. The premises have deemed complied with requirements of circular issued by **Director of Education vide letter no 3298-3398 dated 01.03.2011** and the building/ premise is fit for occupancy class **Group B Educational for ground and first floor only** with effect from **01/03/2021**... for a period of **three years**, subject to compliance of the conditions mentioned below:

Issued on **01/03/2021** at New Delhi

(DharampalBhardwaj)  
Dy.Chief Fire Officer  
Ph:-011-25156707

o/c

Copy to :-

1. The Director, Education, Government of N.C.T of Delhi. Old Sectt. Delhi - 54.
2. The Principal, Bright Star Convent Public School located at A-153, Phool Bagh Road, Shastri Park Ext Burari, Delhi-110084.

**Conditions for the validity of Fire Safety Certificate:**

- 1 All the means of escape/entry/exit shall be kept free from any obstruction.
- 2 All the fire safety arrangements provided therein shall be maintained in good working condition at all time as seen during inspection. Any loss of life or property due to non-functional fire safety measures shall be at the responsibility of the management.
- 3 All the staff members must know the correct method of operation of firefighting system.
- 4 The owner / occupier shall submit a declaration **every year** in **Form "K"** provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on <http://delhi.gov.in/wps/wcm/connect/doit fire/FIRE/Home/Forms>.
- 5 This fire safety certificate may not in any way be treated as regularization ( Clause 2.8 of UBBL-2016) of unauthorized construction or Alteration ( Clause 1.4.3 of UBBL-2016), if any.
- 6 "The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in **Form 'J'** [sub rule (1) of rule 37] along with a copy of this Certificate, **six months** prior to its expiry".

- 1 Name & address of the building : Bright Star Convent Public School, A-155, Phool Bagh Road, Shastri Park Ext Burari, Delhi-110084.
- 2.Type of Occupancy : Educational- Ground + 02(School is running on G+1floor)
- 3 Type of Case : Renewal
- 4 Details of previous NOC :F6/DFS/MS/2017/School/WZ129 Dated: 02.02.2017
- 5 Fire Safety directives letter No : Director of Education Letter dated 01.03.2011
- 6 Date of inspection : 22.02.2021
- 7 Name of the Inspecting Officers : ADO (RN)
- 8 Name and designation of officers  
from the building side : Mr. Ashwani Kumar/ Principal
9. Year of Construction : 2003
10. Applicant's letter No. : Online E-mail I.D dated: 08.02.2021

Plot Area-350sqY Covered area ----280sqY , No of student—350 nos, Total class room --17nos

	Minimum Standards on fire prevention and fire safety U/R 33	Dir. Of Education	Provided at site	Remarks MR/NMR
1	<b>Access to building</b>			
	• Road width	6m	6m	MR
	• Gate width	2.5m(Old case)	2.5m(Old Case)	MR
	• Width of internal road	NA	NA	NA
2	<b>Number, Width, Type &amp; Arrangement of Exits</b>			
	a. Number of staircases			
	• Upper Floors	02	02	MR
	• Basements	NA	NA	NA
	b. Width of staircases			
	• Upper Floors	1.50 m	1.5m & 1.2m	MR(Old Case)
	• Basements	NA	NA	NA
	c. Protection of exits			
	• Fire check door	NA	NA	NA
	• Pressurization	NA	NA	NA
	d. No. of continuous staircases to terrace	1	1	MR
e. Width of Corridor	Required	1.15m	MR	
f. Door Size	1.0m	1m	MR	
3	<b>Compartmentation.</b>			
	• Fire check door	NA	NA	NA
	• Sealing of electrical shafts	NA	NA	NA
	• Fire Rating of shaft door	NA	NA	NA
	• Water Curtain	NA	NA	NA
	• Fire Dampers	NA	NA	NA
4	<b>Smoke Management System.</b>			
	• Basements	30 a/c per hour	NA	NA
	• Upper floors	12 a/c per hour	Natural Ventilation	MR
5	<b>Fire Extinguishers</b>			








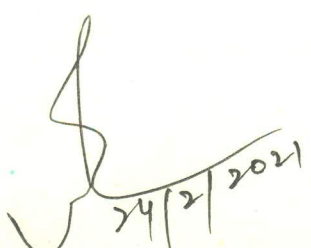

	<ul style="list-style-type: none"> <li>Total numbers</li> <li>Types</li> <li>ISI marking</li> </ul>	06nos	07 nos	MR
		ABC/Co2	ABC--07	MR
		Yes	Yes	MR
6	<b>First-Aid Hose Reels.</b>			
	<ul style="list-style-type: none"> <li>Total numbers on each floor</li> <li>Length of hose reel hose</li> <li>Nozzle diameter</li> </ul>	NA	NA	NA
		NA	NA	NA
		NA	NA	NA
7	<b>Automatic fire detection and alarming system</b>			
	<ul style="list-style-type: none"> <li>Type of detectors</li> <li>Location of Main Panel</li> <li>Location of Repeater Panel</li> <li>Alternate source of power</li> <li>Hooters' Location</li> </ul>	NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA
8	<b>MOEFA</b>	NA	NA	NA
9	<b>Public Address System.</b>	NA	NA	NA
10	<b>Automatic Sprinkler System.</b>			
	<ul style="list-style-type: none"> <li>Basement</li> <li>Upper Floor</li> <li>Sprinkler above false ceiling</li> </ul>	NA	NA	NA
		NA	NA	NA
		NA	NA	NA
11	<b>Internal Hydrants</b>			
	<ul style="list-style-type: none"> <li>Size of riser/down-comer</li> <li>Number of hydrants per floor</li> <li>Hose Box</li> </ul>	NA	NA	NA
		NA	NA	NA
		NA	NA	NA
12	<b>Yard Hydrants.</b>			
	<ul style="list-style-type: none"> <li>Total number of hydrants</li> <li>Hose Box</li> </ul>	NA	NA	NA
		NA	NA	NA
13	<b>Pumping Arrangements.</b>			
	<ul style="list-style-type: none"> <li>Ground Level <ul style="list-style-type: none"> <li>Discharge of main Pump</li> <li>Head of Main pump</li> <li>Number of main pumps</li> <li>Jockey Pump out put</li> <li>Jockey pump head</li> <li>Standby Pump out put</li> <li>Standby Pump Head</li> <li>Auto Starting/ Manual stopping</li> <li>Pump House Access</li> </ul> </li> <li>Terrace level <ul style="list-style-type: none"> <li>Discharge of pump</li> <li>Head of the pump</li> <li>Power Supply</li> <li>Auto Starting of pump</li> </ul> </li> </ul>	N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA
14	<b>Captive Water Storage for fire fighting.</b>			



	➤ Draw-off connection	NA	NA	NA
	➤ Fire service inlet	NA	NA	NA
	➤ Access to tank	NA	NA	NA
	• Overhead Tank capacity			
15	<b>Exit Signage.</b>	Required	Provided	MR
16	<b>Provision of Lifts.</b>			
	• Pressurization of Lift Shaft	N/A	N/A	N/A
	• Pressurization of Lift lobby	N/A	N/A	N/A
	• Communication In lift Car	N/A	N/A	N/A
	• Fireman's Grounding Switch	N/A	N/A	N/A
	• Lift Signage	N/A	N/A	N/A
17	<b>Standby power supply</b>	N/A	N/A	N/A
18	<b>Refuge Area.</b>			
	➤ Total Area	N/A	N/A	N/A
	➤ Location	N/A	N/A	N/A
19	<b>Fire Control Room</b>			
	• Detector System Panel	N/A	N/A	N/A
	• Flow Switch Panel	N/A	N/A	N/A
	• PA System Panel	N/A	N/A	N/A
	• Batter backup	N/A	N/A	N/A
	• Building Floor Plans	N/A	N/A	N/A
20	Special Fire Protection Systems for Protection of special Risks, if any:	N/A	N/A	N/A

The fire protection systems provided in the building were tested/ checked randomly and found in working condition at the time of inspection.

Keeping in view the satisfactory compliance of the minimum standards on fire prevention and fire safety required as stipulated in Director of Education Circular dated 17.01.2005 the FSC issued vide letter of even no 129 dated 02.02.2017 renewal under rule 37 of the Delhi Fire Service Rules, 2010 is recommended

Signature of the Inspecting Officer  
Name :- C.L. Meena  
Designation:- ADO/RN

As approved, F.T. letter is put up for your signature pl.