

FORM 'H'  
FORM FOR ISSUING FIRE SAFETY CERTIFICATE  
[Refer sub - rule (1) of rule 35]  
**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI**  
**HEAD QUARTERS: DELHI FIRE SERVICE, CONNAUGHT PLACE**  
**NEW DELHI**

No. F6/DFS/MS/Club/2021/SZ/ 176

Dated: 16/03/2021

**FIRE SAFETY CERTIFICATE**

Certified that the Safdarjung Club located at Safdarjung Enclave, New Delhi-110029 comprised of Basement, Ground & Two Upper Floor owned / Occupied Safdarjung Club, has already been issued Fire Safety certificate vide letter no. F6/DFS/MS/Club/2017/SZ/1481 dated 10/10/2017. The premises was re-inspected by the officers from this department on dated 12/02/2021 in the presence of Sh. Pradeep Verma and observed that all the Fire prevention & Fire Safety arrangements as provided in the premises found in good working condition. The premises have therefore deemed complied with rule 33 of the Delhi Fire Service Rule, 2010 and that the building/premises is fit for occupancy class "Educational" Group-B, with effect from 16 /03 /2021 for a period of three years in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules, 2010.

Issued on 16/03/2021 ..... at New Delhi.



(SUNIL CHAUDHARY)

DY. CHIEF FIRE OFFICER (S.Z.).

Copy to :-

1. The Dy. Admn officer, M/s Safdarjung Club, Safdarjung Enclave, New Delhi-110029.
2. The DEO, Office of the commissioner of Excise, Govt. of NCTD, L & N Block, I.P. Estate, Vikas Bhawan, New Delhi-110002

**Conditions for the validity of Fire Safety Certificate:**

1. All the fire safety arrangement provided their in shall be maintained in good working conditions at all times.
2. Loss of life or property due to non functional fire safety measure shall be at the responsibility of the management.
3. The trained fire fighting staff should be available round the clock.
4. Any deviation with regard to the construction etc shall be verified by the concerned building sanctioning agency.
5. The basement shall be used strictly as per the provision of building bye laws.
6. This certificate cannot be treated in any case for regularizations of unauthorized construction.
7. "The owner / Occupier shall apply for renewal of this Fire Safety Certificate to the Director in Form 'J' [sub rule (1) of rule37] along with a copy of this Certificate, six months prior to its expiry".
8. The owner / occupier shall submit a declaration every year in form "K" provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on [WWW.dfs.Delhigovt.nic.in](http://WWW.dfs.Delhigovt.nic.in)

**INSPECTION REPORT**

1. Name & address of the building: **Safdarjung Club, Safdarjung Enclave, New Delhi-110029.**
2. Type of Occupancy : **Assembly (Club)**
3. Type of Case : **Renewal**
4. Details of previous NOC : **F6/DFS/MS/Club/2017/SZ/1481 dated 10/10/2017**
5. Fire Safety directives Letter No. : **F6/DFS/MS/BP/90/258 dated 27/02/1990**
6. Date of inspection : **12/02/2021**
7. Name of the Inspecting Officer : **D.O. (S.D.) & A.D.O. (S.J.)**
8. Name and designation of Officer  
from the building side : **Mr. Pradeep Verma**
9. Year of Construction : **1973**
10. Applicant's letter No. : **E-mail dated 29/01/2021**


S. No	Minimum standards on fire prevention and fire safety U/R 33	Old NOC Requirements	Provided at site	Remarks MR/NMR
1.	Access of building			
	• Road width	Required	9 mtr	MR
	• Gate width	Required	4.20, 367.3.78 & 1.94m	MR
	• Width of internal road	NA	NA	NA
2.	Number, width, Type & Arrangements of exits			
	a. Number of staircases			
	• Upper floors	Required	2 Nos	MR
	• Basements	Required	2 Nos	MR
	b. Width of staircases			
	• Upper floors	Required	1.36m & 0.90m Mtr	MR(old case)
	• Basements	Required	1.36m & 0.90m	MR(old case)
	c. Protection of exits			
	• Fire check door	Required	Provided	MR
	• Pressurization	NA	NA	NA
	d. No of continuous staircase to terrace	Required	2 Nos	MR
	e. Width Of Corridor	NA	NA	NA
	f. Door Size	NA	NA	NA
3.	Compartmentation			
	• Fire check door	Required	Provided	MR
	• Sealing of electrical shafts	N/A	N/A	N/A
	• Fire Rating of shaft door	N/A	N/A	N/A
	• Water Curtain	N/A	N/A	N/A
	• Fire Dampers	NA	NA	NA
4.	Smoke managements System			
	• Basements	Required	Exhaust fan provided	MR
	• Upper floors	NA	NA	NA
5.	Fire Extinguishers			
	• Total numbers	25 Nos	25 Nos	M/R
	• Types	ABC/CO <sub>2</sub>	ABC-20, Co2-05	M/R
	• ISI marking	Required	Provided	M/R


	• Total numbers on each floor	1	1	MR
	• Length of hose reel hose	30m	30 m	MR
	• Nozzle diameter	5mm	5mm	MR
7.	Automatic fire detection and alarming system			
	• Type of detector	NA	NA	NA
	• Location of Main Panel	NA	NA	NA
	• Location of Repeater Panel	NA	NA	NA
	• Alternate source of power	NA	NA	NA
	• Hooters' Location	NA	NA	NA
8.	MOEFA	NA	Provided	NA
9.	Public Address System	NA	Provided	NA
10.	Automatic Sprinkler System			
	• Basements	Required	Provided	MR
	• Upper Floor	Required	Provided	MR
	• Sprinkler above false ceiling	NA	NA	NA
11.	Internal Hydrants			
	• Size of riser/down-comer	NA	NA	NA
	• Number of hydrants per floor	NA	NA	NA
	• Hose Box	NA	NA	NA
12.	Yard Hydrants			
	• Total number of hydrants	NR	NR	NR
	• Hose Box	NR	NR	NR
13.	Pumping Arrangements			
	• Ground Level			
	• Discharge of main pump	NA	NA	NA
	➤ Head of main pump	NA	NA	NA
	➤ Number of main pumps	NA	NA	NA
	➤ Jockey pump out put	NA	NA	NA
	➤ Jockey pump head	NA	NA	NA
	➤ Standby Pump out put	NA	NA	NA
	➤ Standby Pump Head	NA	NA	NA
	➤ Auto Starting/Manual stopping	NA	NA	NA
	➤ Pump House Access	NA	NA	NA
	• Terrace level			
	➤ Discharge of pump	Required	900 LPM	MR
	➤ Head of the pump	Required	40 mtr	MR
	➤ Power supply	Required	DG set provided	MR
	➤ Auto starting of pump	Required	Provided	MR
14.	Captive water Storage for fire fighting			
	• Underground tank capacity	NA	NA	NA
	➤ Draw of connection	NA	NA	NA
	➤ Fire service inlet	NA	NA	NA

15	Exit Signage	Required	Provided	MR
16.	Provision of Lifts			
	➤ Pressurization of Lift Shaft	NA	NA	NA
	➤ Pressurization of lift lobby	NA	NA	NA
	➤ Communication in lift Car	NA	NA	NA
	➤ Fireman's Grounding Switch	NA	NA	NA
	➤ Lift Signage	NA	NA	NA
17.	Standby power supply	Required	Provided	MR
18.	Refuge Area	N/A	N/A	
	➤ Total area	N/A	N/A	N/A
	➤ Location	N/A	N/A	N/A
19.	Fire control room			
	➤ Detector system panel	N/A	N/A	N/A
	➤ Flow Switch Panel	N/A	N/A	N/A
	➤ PA System Panel	N/A	N/A	N/A
	➤ Battery backup	N/A	N/A	N/A
	➤ Building Floor Plans	N/A	N/A	N/A
20.	Special Fire Protection Systems for Protection of special Risks, if any;			

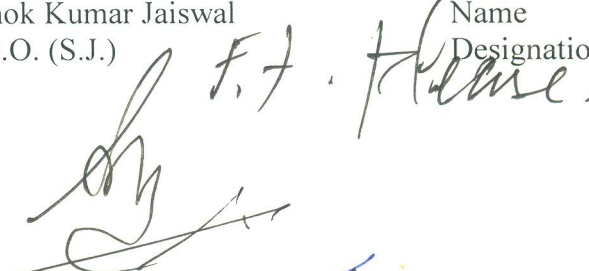
The fire protection systems provided in the building were tested, checked and found functional at the time of inspection.

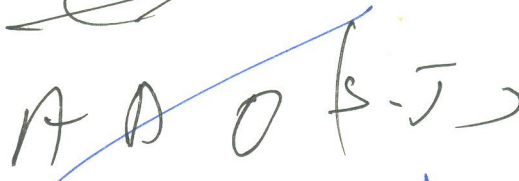
In view of the deemed compliance of the minimum standards of fire prevention and fire safety measures as required under the rules the NOC issued vide letter No. F6/DFS/MS/Club/2017/SZ/1481 dated 10/10/2017 renewal under rule 35 of the Delhi Fire Service rules 2010 is recommended.

  
 Signature of the Inspecting Officer  
 Name : Ashok Kumar Jaiswal  
 Designation: A.D.O. (S.J.)

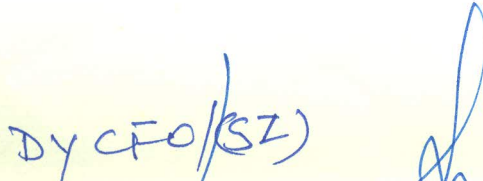
  
 Signature of the Inspecting Officer  
 Name : S.K. Dua  
 Designation: D.O. (SD)

  
 DCFO(SZ)

  
 F.T. House

  
 A.A.O. (S.J.)

F.T. is added for sign. pl.

  
 DYCFO(SZ)

  
 8/3/2021