

**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE NEW DELHI-110001**

No. F6/DFS/MS/School/WZ/2021/ 272

Dated: 30/3/21

FIRE SAFETY CERTIFICATE

Certified that the **B.M.Bharti Model School, Majri, Delhi-110081**, comprised of **02 Blocks, Ground + Two upper floors** owned/occupied by **B.M.Bharti Model School** was issued fire safety certificate by this department vide letter no **F.6/DFS/MS/School/2018/WZ/373 dated 07.03.2018**. The premises was re-inspected by the officer concerned of this department on **08.03.2021** in the presence of and observed that all the fire prevention and fire safety arrangements as provided in the premise found in good working condition. The premise have deemed complied with the requirements of circular issued by Director of Education vide letter no 3298-3398 dated 01.03.2011 and the building/ premise is fit for occupancy **class "B" Educational Buildings** with effect from **30/3/2021** for a period of **three years** subject to compliance of the conditions mentioned below.

Issued on **30/3/21** at New Delhi by


(Dhrampal Bhardwaj)
Dy.Chief Fire Officer
Tel;-01123414250

Copy to:

1. The Principal, B.M.Bharti Model School, Majri, Delhi-110081.
2. The Director of Education, GNCT of Delhi Old Secretariat, Delhi-110054.

Conditions for validity of Fire Safety Certificate;

1. All the fire safety arrangement provided there-in shall be maintained in good working conditions at all times.
2. Loss of life or property due to non functional fire safety measure shall be at the responsibility of the management.
3. The trained fire fighting staff should be available round the clock.
4. Any deviation with regard to the construction etc shall be verified by the concerned building sanctioning agency.
5. This certificate cannot be treated in any case for regularizations of unauthorized construction.
6. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director of Form 'j' [sub rule (1) of rule 37] along with a copy of this Certificate, six months prior to its expiry".
7. The owner / occupier shall submit a declaration every year in form "K" provided in the first schedule of Delhi Fire Service Rules 2010. The form "K" is available on [http://www.delhi.gov.in/wps/wcm/connect/doit_fire/FIRE/Home/Fire+Safety+Acts+and+Ru](http://www.delhi.gov.in/wps/wcm/connect/doit_fire/FIRE/Home/Fire+Safety+Acts+and+Rules/) les/ http://www.delhi.gov.in/wps/wcm/connect/doit_fire/FIRE/Home/Forms

INSPECTION REPORT

1. Name & address of the building : B.M.Bharti Model School, Majri, Delhi-110081.
2. Type of Occupancy : Educational (**2Blk-Ground + 2 upper floors**)
3. Type of Case : Renewal
4. Details of Previous NOC : F.6/DFS/MS/School/2018/WZ/373 dated 07.03.2018
5. Fire Safety directives letter No : DOE Circular dated 01.03.2011
6. Date of inspection : 08.03.2021
7. Name of Inspecting Officer : A.K.Sharma ADO(Rohini)
8. Name and designation of officers
From the building side : Sh. Jagdish Singh Mathur (Owner)
9. Year of Construction : 1994
10. Applicant's letter No. : Online e-mail dated 14.02.2021

S. No.	Minimum Standards on fire prevention and fire safety U/R 33	DOE Circular dated 01.03.2011 Requirement	Provided at site	Remarks MR/NMR
1.	Access to building			
	• Road width	Accessible	Accessible	MR
	• Gate width	Accessible	4.5m	MR
	• Width of internal road	NA	NA	NA
2.	Number, Width, Type & Arrangement of Exits			
	a. Number of staircases			
	• Upper Floors	02	04	MR
	• Basements	NA	NA	NA
	b. Width of staircases			
	• Upper Floor	1.5m	1.5, 1.6 & 2 X 1.2m	MR
	• Basements	NA	NA	NA
	c. Protection of exits			
	Fire check door	NA	NA	NA
	• Pressurization	NA	NA	NA
	d. No. of continuous staircases to terrace	02	04	MR
	e. Width of Corridor	1.5m	2.0m	MR
	f. Door Size	1.0m	1.07m	MR
3.	Compartmentation			
	• Fire check door	NA	NA	NA
	• Sealing of electrical shafts	NA	NA	NA
	• Fire Rating of shaft door	NA	NA	NA
	• Water Curtain	NA	NA	NA
	• Fire Dampers	NA	NA	NA
4.	Smoke Management System			
	• Basements	30 a/c per hour	NA	NA
	• Upper floors	12 a/c per hour	Natural ventilation	MR
5.	Fire Extinguishers			
	• Total numbers	10	10	MR
	• Types	ABC/CO2	ABC	MR
	• IS marking	ISI marked	Yes	MR
6.	First-Aid Hose Reels			
	• Total numbers on each floor	01	01	MR
	• Length of hose reel hose	30mm	30mm	MR
	• Nozzle diameter	5m	5m	MR
7.	Automatic fire detection and alarming system			
	• Type of detectors	NA	NA	NA
	• Location of Main Panel	NA	NA	NA
	• Location of Repeater Panel	NA	NA	NA
	• Alternate source of power	NA	NA	NA


	• Hooters' Location	NA	NA	NA
8.	MOEFA	Required	Provided	MR
9.	Public Address System	Required	Provided	MR
10.	Automatic Sprinkler System			
	• Basement	NA	NA	NA
	• Ground & Upper Floors	NA	NA	NA
	• Sprinkler above false ceiling	NA	NA	NA
11.	Internal Hydrants			
	• Size of riser/down-comer	NA	NA	NA
	• Number of hydrants per floor	NA	NA	NA
	• Hose Box	NA	NA	NA
12.	Yard Hydrants			
	• Total number of hydrants	NA	NA	NA
	• Hose Box	NA	NA	NA
13.	Pumping Arrangements			
	• Ground Level	NA	NA	NA
	➤ Discharge of main Pump	NA	NA	NA
	➤ Head of Main pump	NA	NA	NA
	➤ Number of main pumps	NA	NA	NA
	➤ Jockey Pump out put	NA	NA	NA
	➤ Jockey pump head	NA	NA	NA
	➤ Standby Pump out put	NA	NA	NA
	➤ Standby Pump Head	NA	NA	NA
	➤ Auto Starting/Manual Stopping	NA	NA	NA
	➤ Pump House Access	NA	NA	NA
	• Terrace level			
	➤ Discharge of pump	450lpm	2 X 450lpm	MR
	➤ Head of the pump	40m	40m	MR
	➤ Power Supply	Required	Provided	MR
	➤ Auto Starting of pump	Required	Provided	MR
14.	Captive Water Storage for fire fighting			
	• Underground tank capacity	NR	20,000ltr	NR
	➤ Draw-off connection	NA	NA	NA
	➤ Fire service inlet	NA	NA	NA
	➤ Access to tank	NA	NA	NA
	• Overhead Tank capacity	10,000ltr	10,000ltr	MR
15.	Exit Signage.	Required	Provided	MR
16.	Provision of Lifts.			
	• Pressurization of Lift Shaft	NA	NA	NA
	• Pressurization of Lift lobby	NA	NA	NA
	• Communication In lift Car	NA	NA	NA
	• Fireman's Grounding Switch	NA	NA	NA
	• Lift Signage	NA	NA	NA
17.	Standby power supply	Required	Provided	MR
18.	Refuge Area.			
	➤ Total Area	NA	NA	NA
	➤ Location	NA	NA	NA
19.	Fire Control Room			
	• Detector System Panel	NA	NA	NA
	• Flow Switch Panel	NA	NA	NA
	• PA System Panel	NA	NA	NA
		NA	NA	NA

N-18


	<ul style="list-style-type: none">Battery backupBuilding Floor Plans	NA	NA	NA
20.	Special Fire Protection System for Protection of special Risks, if any:	NA	NA	NA

The fire protection systems provided in the building were test checked and found functional at the time of inspection.

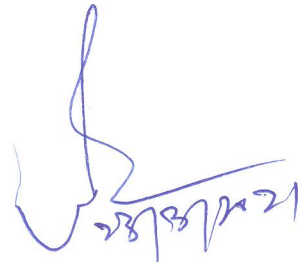
In view of the deemed compliance of the minimum standards of the fire prevention and fire safety measures as required under the rules the NOC issued vide letter no. F.6/DFS/MS/School/2018/WZ/373 dated 07.03.2018 is recommended for renewal under rule 37 of the Delhi Fire Service rules 2010.


19/3/21

Signature of the Inspecting Officer
Name Ajay Kumar Sharma
Designation ADO(Rohini)

DO (NW) 
19/03/2021

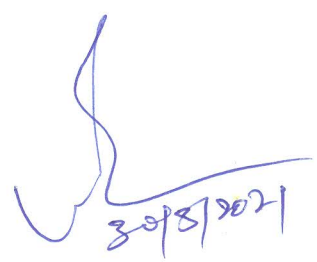
~~DFO (W2)~~



28/3/21

~~ADO Rohini~~

FT letter is put up for kind
perusal and signature please.

~~DFO (W2)~~


30/3/21


26/3/21

MS/cell