

c/26

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE: NEW DELHI-110001

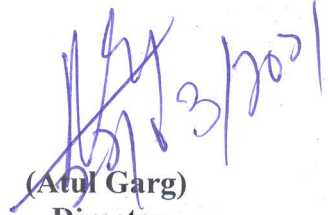
No. F.6/DFS/MS/EH/2021/WZ/ 73

Dated: 23/03/2021

FIRE SAFETY CERTIFICATE

Certified that the M/s. **Rajbhog Food India** running at **Ground Floor** of a building **comprised of basement, ground plus two upper floors**, located at no. 12, Inder Enclave, Main Rohtak Road, New Delhi. The premises was inspected by the officer concerned of this department on 05.03.2021, in the presence of Sh. Puneet and found that the management have complied with the fire prevention and fire safety requirements in accordance with rule 33 of the Delhi Fire Service Rule, 2010 and that the premises is fit for occupancy class "Assembly" Group D (Eating House) at **Ground Floor only** with effect from 23/03/2021 for a period of **three years** in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules, 2010, printed below.

Issued on 23/03/2021 at New Delhi by.


(Atul Garg)
Director
Delhi Fire Service

Copy to: -

1. The Joint Commissioner of Police, (LIC.), 1st floor P.S. Defence Colony, New Delhi- 49.
2. Mr. Puneet Agrarian, M/s Rajbhog Food India located at no. 12, Inder Enclave, Main Rohtak Road, New Delhi.

Conditions for the validity of Fire Safety Certificate:

1. All the fire safety arrangements provided therein shall be maintained in good working condition at all times.
2. Any loss of life or property due to non-functional fire safety measures shall be at the risk and responsibility of the management.
3. The trained staff should be available round the clock.
4. Any deviations w.r.t. construction shall be verified by the concerned building sanctioning agency.
5. The certificate may not be treated in any case for the regularization of the unauthorized construction, if any.
6. Basement shall be used as per building bye laws.
7. The owner/ occupier shall apply for renewal of this Fire Safety Certificate to the Director in Form 'J' [sub rule (1) of rule 37] along with a copy of this certificate, six months prior to its expiry.
8. The owner/occupier shall submit a declaration every year in the form 'K' provided in the first schedule of Delhi Fire Service Rules 2010, form is available on www.dfs.delhigovt.nic.in.
9. **The owner of the sweet shop has submitted an affidavit for not to use basement, 1st floor & 2nd floor. If basement or 1st or 2nd floor is used for sweet shop in future FSC will be null & void.**

1	Name & Address of the Building	M/s Rajbhog Food India, situated at no. 12, Inder Enclave, Main Rohtak Road, New Delhi-110087.		
2	Type of Occupancy	Assembly, "Group-D"		
3	Building Comprised of	Basement (Vacant), Ground (Sweet shop) + FF (Vacant) + SF (Vacant), restaurant is running at Ground Floor only		
4	Type of Case	New		
5	Details of Previous NOC	Nil		
6	Fire Safety Directives Letter No	NBC Part-IV		
7	Date of Inspection	05/03/2021		
8	Name of the Inspecting Officers	ADO Aman Kumar Lathar		
9	Name & Designation of Officers from the building side	Mr. Puneet		
10	Year of construction	1998-2000		
11	Applicant letter No.	Email dated 16/02/2021		
S. No	Minimum standards on Fire Prevention and Fire Safety U/R 33	NBC Requirements	Provided at Site	Remarks NR/NMR
1	Access to Building.			
	<ul style="list-style-type: none"> Road width 	06 m	Provided	MR
	<ul style="list-style-type: none"> Gate width 	-N/A-	-N/A-	-N/A-
	<ul style="list-style-type: none"> Width of internal road 	-N/A-	-N/A-	-N/A-
2	Number, width, type & arrangement of exits.			
	a) Number of Staircase			
	<ul style="list-style-type: none"> ➤ Upper floors. 	Running at GF	-N/A-	-N/A-
	<ul style="list-style-type: none"> ➤ Basement floor. 	-N/A-	-N/A-	-N/A-
	b) Width of Staircase			
	<ul style="list-style-type: none"> ➤ Upper floors 	Running at GF	-N/A-	-N/A-
	<ul style="list-style-type: none"> ➤ Basement floor 	-N/A-	-N/A-	-N/A-
	c) Protection of exits			
	<ul style="list-style-type: none"> ➤ Fire check door 	Required	Provided	MR
	<ul style="list-style-type: none"> ➤ Pressurization 	-N/A-	-N/A-	-N/A-
	d) No. of continuous staircase to terrace	Running at GF	-N/A-	-N/A-
	e) Width of corridor	-N/A-	-N/A-	-N/A-
	f) Door size	2.0 m & 1.5 m	2.0 m & 1.5 m	MR
3	Compartmentation.			
	<ul style="list-style-type: none"> Fire check door. 	-N/A-	-N/A-	-N/A-
	<ul style="list-style-type: none"> Sealing of electrical shafts. 	-N/A-	-N/A-	-N/A-
	<ul style="list-style-type: none"> Fire rating of shaft door. 	-N/A-	-N/A-	-N/A-
	<ul style="list-style-type: none"> Water curtain 	-N/A-	-N/A-	-N/A-
	<ul style="list-style-type: none"> Fire dampers. 	-N/A-	-N/A-	-N/A-
4.	Smoke Management system.			
	<ul style="list-style-type: none"> Basement 	-N/A-	-N/A-	-N/A-
	<ul style="list-style-type: none"> Upper floors 	-N/A-	-N/A-	-N/A-
5.	Fire Extinguishers.			
	<ul style="list-style-type: none"> Total numbers 	05 nos	05 nos	MR
	<ul style="list-style-type: none"> Types 	ABC / CO ₂	Provided	MR
	<ul style="list-style-type: none"> ISI Marking 	ISI marked	Provided	MR
6.	First Aid Hose Reels.			
	<ul style="list-style-type: none"> Total numbers on each floor 	One	Provided	MR
	<ul style="list-style-type: none"> Length of hose-reel hose. 	30m	Provided	MR
	<ul style="list-style-type: none"> Nozzle Diameter 	5mm	Provided	MR

	<ul style="list-style-type: none"> Location of Main Panel Location of Repeater Panel Alternate source of power Hooter's location 	-N/A-	-N/A-	-N/A-
		-N/A-	-N/A-	-N/A-
		-N/A-	-N/A-	-N/A-
		-N/A-	-N/A-	-N/A-
8.	MOEFA	Required	Provided	MR
9.	Public Address System	-N/A-	-N/A-	-N/A-
10.	Automatic Sprinkler System			
	<ul style="list-style-type: none"> Basement. Upper floors Sprinkler above false ceiling 	-N/A-	-N/A-	-N/A-
		-N/A-	-N/A-	-N/A-
		-NA-	-NA-	-NA-
11.	Internal Hydrants.			
	<ul style="list-style-type: none"> Size of Riser / Down-comer Number of Hydrant per floor Hose box. 	100mm	100mm	MR
		01 No.	01 No.	MR
		01 No.	01 No.	MR
12.	Yard Hydrants.			
	<ul style="list-style-type: none"> Total number of hydrants. Hose box. 	-N/A-	-N/A-	-N/A-
		-N/A-	-N/A-	-N/A-
13.	Pumping arrangements.			
	<ul style="list-style-type: none"> Ground Level 			
	Discharge of main pump.	-N/A-	-N/A-	-N/A-
	➤ Head of main pump.	-N/A-	-N/A-	-N/A-
	➤ Number of main pumps.	-N/A-	-N/A-	-N/A-
	➤ Jockey Pump output.	-N/A-	-N/A-	-N/A-
	➤ Jockey Pump head.	-N/A-	-N/A-	-N/A-
	➤ Standby Pump output.	-N/A-	-N/A-	-N/A-
	➤ Standby Pump head.	-N/A-	-N/A-	-N/A-
	➤ Auto Starting/Manual stopping.	-N/A-	-N/A-	-N/A-
	➤ Pump house access.	-N/A-	-N/A-	-N/A-
	<ul style="list-style-type: none"> Terrace Level 			
	➤ Discharge of pump.	450 LPM	450 LPM	MR
	➤ Head of pump.	40 m	40 m	MR
	➤ Power supply.	Required	Provided	MR
	➤ Auto starting of pump.	Required	Provided	MR
14.	Captive water storage for firefighting.			
	<ul style="list-style-type: none"> Underground tank capacity. ➤ Draw-off connection. ➤ Fire Service Inlet. ➤ Access to tank. Overhead tank capacity. 	-NA-	-NA-	-NA-
		-N/A-	-N/A-	-N/A-
		-N/A-	-N/A-	-N/A-
		-N/A-	-N/A-	-N/A-
		20,000 ltrs	20,000 ltrs	MR
15.	Exit Signage.	Required	Provided	MR
16.	Provision of Lifts.			
	<ul style="list-style-type: none"> Pressurization of lift shaft. Pressurization of lift lobby. Communication in lift car. Fireman's switch. Lift signage. 	-N/A-	-N/A-	-N/A-
		-N/A-	-N/A-	-N/A-
		-N/A-	-N/A-	-N/A-
		-N/A-	-N/A-	-N/A-
		-N/A-	-N/A-	-N/A-
17.	Standby Power Supply	-NA-	-NA-	-NA-
18.	Refuge Area			
	<ul style="list-style-type: none"> Total area 	-N/A-	-N/A-	-N/A-

	• Location	-N/A-	-N/A-	-N/A-
19.	Fire Control Room.			
	• Detector System Panel.	-N/A-	-N/A-	-N/A-
	• Flow Switch Panel.	-N/A-	-N/A-	-N/A-
	• PA system Panel.	-N/A-	-N/A-	-N/A-
	• Battery backup	-N/A-	-N/A-	-N/A-
	• Building floor plan	-N/A-	-N/A-	-N/A-
20.	Special Fire Protection System for the Protection of special Risk, if any.	-N/A-	-N/A-	-N/A-

The Fire protection systems provided in the premises were checked / operated at random and found functional at the time of inspection.

The shortcoming issued by this department vide letter No. F/6/DFS/MS/EH/2020/925 dated 22/12/2020 has been compliance by the eating house management.

Keeping in view the substantial compliance of the minimum standards on fire prevention and fire safety required under the rules it is recommended to grant Fire Safety Certificate under rule 35 of the Delhi Fire Service Rules 2010.

Note – The owner of the eating house has submitted an affidavit for not to use basement, 1st floor & 2nd floor for eating house purpose.

Accordingly DFA is put up for approval and signature please.

Aman Kumar Lathar

Signature of the Inspecting Officer
Name : Aman Kumar Lathar
Designation: ADO (JWP)

O. (WEST) / 44
DATED.. 15/3/2021

~~DO (WD)~~

[Signature]
15/03/2021

Spoken. reg DFA

~~DCFO (WZ)~~

~~Wheyer H ...~~



~~Doj Merli~~

[Signature]
17/3/2021

Spoken. Accordingly DFA is Corrected.
Submitted for approval please.

~~DCFO (WZ)~~

[Signature]
18/3/2021

[Signature]
18/3/2021