


C-22

**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI**  
**HEADQUARTERS: DELHI FIRE SERVICE: NEW DELHI-110001**  
NO. F.6/DFS/MS/WZ/School/2021/ 293 Dated: 1 / 4 /2021

**FIRE SAFETY CERTIFICATE**

Certified that Govt. Co-ed Sarvodaya Vidyalaya, Sector- 2, Rohini, Delhi-85 comprised of Four Blocks, A, C & D- Blocks, Ground + One upper floor & B-Block Ground floor only owned/occupied by that Govt. Co-ed Sarvodaya Vidyalaya was issued fire safety certificate. The premises was re-inspected by the officer from this department on dated 15.03.2021 in the presence of Dr. Ram Jee Singh (Principal) and observed that all the fire prevention & fire safety arrangements as provided in the premises found in good working condition. The premises have therefore deem complied with the requirements of Circular No F.16/Estate/CC/Fire Safety/2011/3298-3398 dated 01/03/2011 issued by Director of Education and the building / premise is fit for occupancy of Group Class B (Educational) with effect from 1/4/2021 for a period of three years, subject to compliance of the conditions mentioned below:

Issued on 1/4/21 at New Delhi by

  
(Dhrampal Bhardwaj)  
Dy.Chief Fire Officer  
Tel:-01123414250

**Copy to:**

1. The Principal, The Principal, Govt. Co-ed Sarvodaya Vidyalaya, Sector- 2, Rohini, Delhi-85.
2. The Director of Education, GNCT of Delhi Old Secretariat, Delhi-110054.

**Conditions for validity of Fire Safety Certificate;**

1. All the fire safety arrangement provided there-in shall be maintained in good working conditions at all times.
2. Loss of life or property due to non functional fire safety measure shall be at the responsibility of the management.
3. The trained fire fighting staff should be available round the clock.
4. Any deviation with regard to the construction etc shall be verified by the concerned building sanctioning agency.
5. This certificate cannot be treated in any case for regularizations of unauthorized construction.
6. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director of Form 'j' [sub rule (1) of rule 37] along with a copy of this Certificate, six months prior to its expiry".
7. The owner / occupier shall submit a declaration every year in form "K" provided in the first schedule of Delhi Fire Service Rules 2010. The form "K" is available on

[http://www.delhi.gov.in/wps/wcm/connect/doi\\_t\\_fire/FIRE/Home/Fire+Safety+Acts+and+Rules/](http://www.delhi.gov.in/wps/wcm/connect/doi_t_fire/FIRE/Home/Fire+Safety+Acts+and+Rules/)  
[http://www.delhi.gov.in/wps/wcm/connect/doi\\_t\\_fire/FIRE/Home/Forms](http://www.delhi.gov.in/wps/wcm/connect/doi_t_fire/FIRE/Home/Forms)

1. Name & address of the building : Govt. Co-ed Sarvodaya Vidyalaya, Sector- 2, Rohini, Delhi-110085.
2. Type of Occupancy : Education
3. Type of Case : Renewal
4. Details of previous NOC : F.6/DFS/MS/2017/School/1736 dated: 01.12.2017
5. Fire Safety directives letter No : Dir of Edu. Cir 01/03/2011
6. Date of inspection : 15.03.2017
7. Name of the Inspecting Officers : A.K.Sharma (ADO Rohini)
8. Name and designation of officers from the building side : Dr. Ram Jee Singh (Principal)
9. Year of Construction : 1988 ,2013 & 14
10. Applicant's letter No. : 343/G/S-2 Rohini dated 23.02.2021


S. No.	Minimum Standards on fire prevention and fire safety U/R 33	Dir. Of Edu. Requirement	Provided at site	Remarks MR/NMR
1	<b>Access to building</b>			
	• Road width	Accessible	Accessible	M/R
	• Gate width	Accessible	4.5 mtr	M/R
	• Width of internal road	N/A	N/A	N/A
2	<b>Number, Width, Type &amp; Arrangement of Exits</b>			
	a. Number of staircases	N/A	N/A	N/A
	• Upper Floors	A-One C- Two D- one	Provided	M/R
	• Basements	N/A	N/A	N/A
	b. Width of staircases	N/A	N/A	N/A
	• Upper Floors	1.5 mtr each	A- 1.5 mtr, C- 1.5 x 2 D - 1.5 mtr	M/R
	• Basements	N/A	N/A	N/A
	c. Protection of exits	N/A	N/A	N/A
	• Fire check door	N/A	N/A	N/A
	• Pressurization	N/A	N/A	N/A
	d. No. of continuous staircases to terrace	N/A	N/A	N/A
	e. Width of Corridor	N/A	N/A	N/A
	f. Door Size	1.0mtr	1.0 mtr double door	M/R
3	<b>Compartmentation.</b>			
	• Fire check door	N.A.	N.A.	N.A.
	• Sealing of electrical shafts	N.A.	N.A.	N.A.
	• Fire Rating of shaft door	N.A.	N.A.	N.A.
	• Water Curtain	N.A.	N.A.	N.A.
	• Fire Dampers	N.A.	N.A.	N.A.
4	<b>Smoke Management System.</b>			
	• Basements	30 a/c per hour	N.A.	N.A.

	• Upper floors	12 a/c per hour	N.A.	N.A.
5	<b>Fire Extinguishers</b>			
	• Total numbers	17	10      10	M.R
	• Types	ABC/Co2	ABC + Co2	M.R
	• IS marking	ISI marked	Yes	M.R
6	<b>First-Aid Hose Reels.</b>			
	• Total numbers on each floor		N.A.	N.A.
	• Length of hose reel hose	30 m	N.A.	N.A.
	• Nozzle diameter	5 mm	N.A.	N.A.
7	<b>Automatic fire detection and alarming system.</b>			
	• Type of detectors	N.A.	N.A.	N.A.
	• Location of Main Panel	N.A.	N.A.	N.A.
	• Location of Repeater Panel	N.A.	N.A.	N.A.
	• Alternate source of power	N.A.	N.A.	N.A.
	• Hooters' Location	N.A.	N.A.	N.A.
8	<b>MOEFA</b>			
9	<b>Public Address System.</b>			
		N.A.	N.A.	N.A.
10	<b>Automatic Sprinkler System.</b>			
	• Basement	N.A.	N.A.	N.A.
	• Upper Floor	N.A.	N.A.	N.A.
	• Sprinkler above false ceiling	N.A.	N.A.	N.A.
11	<b>Internal Hydrants</b>			
	• Size of riser/down-comer	N.A.	N.A.	N.A.
	• Number of hydrants per floor	N.A.	N.A.	N.A.
	• Hose Box	N.A.	N.A.	N.A.
12	<b>Yard Hydrants.</b>			
	• Total number of hydrants	N.A.	N.A.	N.A.
	• Hose Box	N.A.	N.A.	N.A.
13	<b>Pumping Arrangements.</b>			
	• Ground Level			
	➤ Discharge of main Pump	N.A.	N.A.	N.A.
	➤ Head of Main pump	N.A.	N.A.	N.A.
	➤ Number of main pumps	N.A.	N.A.	N.A.
	➤ Jockey Pump out put	N.A.	N.A.	N.A.
	➤ Jockey pump head	N.A.	N.A.	N.A.
	➤ Standby Pump out put	N.A.	N.A.	N.A.
	➤ Standby Pump Head	N.A.	N.A.	N.A.
	➤ Auto Starting/ Manual stopping	N.A.	N.A.	N.A.
		N.A.	N.A.	N.A.


	<ul style="list-style-type: none"> <li>➤ Pump House Access</li> <li>• Terrace level</li> <li>➤ Discharge of pump</li> <li>➤ Head of the pump</li> <li>➤ Power Supply</li> <li>➤ Auto Starting of pump</li> </ul>	N.A.	N.A.	N.A.
14	<b>Captive Water Storage for fire fighting.</b>			
	<ul style="list-style-type: none"> <li>• Underground tank capacity</li> <li>➤ Draw-off connection</li> <li>➤ Fire service inlet</li> <li>➤ Access to tank</li> <li>• Overhead Tank capacity</li> </ul>	N.A.	N.A.	N.A.
15	<b>Exit Signage.</b>	N.A.	N.A.	N.A.
16	<b>Provision of Lifts.</b>			
	<ul style="list-style-type: none"> <li>• Pressurization of Lift Shaft</li> <li>• Pressurization of Lift lobby</li> <li>• Communication In lift Car</li> <li>• Fireman's Grounding Switch</li> <li>• Lift Signage</li> </ul>	N.A.	N.A.	N.A.
17	<b>Standby power supply</b>	N.A.	N.A.	N.A.
18	<b>Refuge Area.</b>			
	<ul style="list-style-type: none"> <li>➤ Total Area</li> <li>➤ Location</li> </ul>	N.A.	N.A.	N.A.
19	<b>Fire Control Room</b>			
	<ul style="list-style-type: none"> <li>• Detector System Panel</li> <li>• Flow Switch Panel</li> <li>• PA System Panel</li> <li>• Batter backup</li> <li>• Building Floor Plans</li> </ul>	N.A.	N.A.	N.A.
20	Special Fire Protection Systems for Protection of special Risks, if any:	N.A.	N.A.	N.A.

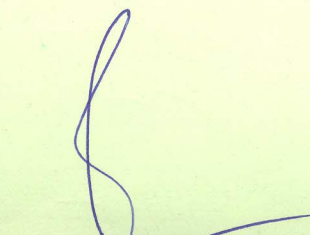
The fire protection systems provided in the building were test checked and found functional at the time of inspection.

In view of the deemed compliance of the minimum standards of the fire prevention and fire safety measures as required under the rules the NOC issued vide letter no. F.6/DFS/MS/2017/School/1736 dated: 01.12.2017 is recommended for renewal under rule 37 of the Delhi Fire Service rules 2010.

  
 Signature of the Inspecting Officer  
 Name Ajay Kumar Sharma  
 Designation ADO (Rohini)

DO (NW)

  
 24/02/2021  
 By CFO, W2

  
 28/02/2021