

C-55

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE, NEW DELHI-110001

No. F6/DFS/MS/2021/School/WZ / 312

Dated: 7/4/21

FIRE SAFETY CERTIFICATE

Certified that the Building situated at Sachdeva Public School, Sector-13 Rohini, Delhi-110085, comprised of Basement + Ground + 03 upper floors owned/occupied by Sachdeva Public School has already been issued FSC by this department vide letter No. F6/DFS/MS/2017/School/876 dated 19.06.2017. The premises was re-inspected by the officer concerned of this department on 27.02.2021 in the presence of Mr. Raj Parkash Gupta and observed that all the fire prevention and fire safety arrangements as provided in the premise found in good working condition. The premise have therefore deemed complied with the requirements under Rule 33 of the Delhi Fire Service Rules, 2010 and the building premises is fit for occupancy under Educational "Group B" with effect from 7/4/21 for a period of **03 years** in accordance with Rule 36 unless renewed under Rule 37 or sooner cancelled under Rule 40 and subjected to compliance of the conditions under Rule 38 of the Delhi Fire Service Rules, 2010.

Issued on ...7/4/21... at New Delhi by


(Dhrampal Bhardwaj)
Dy. Chief Fire Officer
Tel:-01123414250

Copy to :-

1. The Principal, Sachdeva Public School, Sector-13 Rohini, Delhi-110085.
2. The Director of Education, GNCT of Delhi Old Secretariat, Delhi-110054.

Conditions for the validity of fire safety certificate:

1. All the means of escape/entry/exit shall be kept free from any obstruction.
2. All the fire safety arrangements provided therein shall be maintained in good working condition at all time as seen during inspection. Any loss of life or property due to non-functional fire safety measures shall be at the responsibility of the management.
3. All the staff members must know the correct method of operation of firefighting system.
4. The owner/ occupier shall submit a declaration **every year in Form 'K'** [sub rule (2) of Rule 38] provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on http://delhi.gov.in/wps/wcm/connect/doit_fire/FIRE/Home/Forms
5. This fire safety certificate may not in any way be treated as regularization (Clause 2.8 of UBBL-2016) of unauthorized construction (Clause 2.9.2 of UBBL-2016) or Alteration (Clause 1.4.3 of UBBL-2016), if any.
6. "The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in **Form 'J'** [sub rule (1) of Rule 37] along with a copy of this Certificate, **six months** prior to its expiry."

N-22

INSPECTION REPORT

1. Name & address of the building : Sachdeva Public School, Sector-13 Rohini, Delhi-110085
 2. Type of Occupancy : Educational (Basement + G+3)
 3. Type of Case : Renewal
 4. Details of previous NOC ; F6/DFS/MS/2017/School/876 dated 19.06.2017
 5. Fire Safety directives letter No : NBC Part-IV
 6. Date of inspection : 27.02.2021
 9. Name of the Inspecting Officers : A.K.Sharma (ADO Rohini)
 10. Name and designation of officers from the building side : Mr. Raj Parkash Gupta
 9. Year of Construction : 1992&1999
 10. Applicant's letter No. : Online e-mail dated 08.02.2021

	Minimum Standards on fire prevention and fire safety U/R 33	NBC Part-IV	Provided at site	Remarks MR/NMR
1	Access to building			
	• Road width	Accessible	Accessible	M/R
	• Gate width	Accessible	4.5 mtr	M/R
	• Width of internal road	N/A	N/A	N/A
2	Number, Width, Type & Arrangement of Exits			
	a. Number of staircases	N/A	N/A	N/A
	• Upper Floors	03	03	M/R
	• Basements	03	03	M/R
	b. Width of staircases	N/A	N/A	N/A
	• Upper Floors	1.50 m	1.5 X 1, 1.25 X 2	M/R (Old case)
	• Basements	1.50 m	1.5 X 1, 1.25 X 2 & One ramp	M/R (Old case)
	c. Protection of exits	N/A	N/A	N/A
	• Fire check door	N/A	N/A	N/A
	• Pressurization	N/A	N/A	N/A
	e. No. of continuous staircases to terrace	N/A	N/A	N/A
	g. Width of Corridor	N/A	N/A	N/A
	h. Door Size	01 mtr	01 mtr	M/R
3	Compartmentation.			
	• Fire check door	N/A	N/A	N/A
	• Sealing of electrical shafts	N/A	N/A	N/A
	• Fire Rating of shaft door	N/A	N/A	N/A
	• Water Curtain	N/A	N/A	N/A
	• Fire Dampers	N/A	N/A	N/A
4	Smoke Management System.			


	<ul style="list-style-type: none"> • Basements • Upper floors 	30 a/c per hour 12 a/c per hour	Exhaust Fan Natural ventilated	MR MR
5	Fire Extinguishers			
	<ul style="list-style-type: none"> • Total numbers • Types • IS marking 	Required ABC/co2 type ISI marked	45 ABC-30 Co2-15 Yes	M/R M/R M/R
6	First-Aid Hose Reels.			
	<ul style="list-style-type: none"> • Total numbers on each floor • Length of hose reel hose • Nozzle diameter 	Required 30 m 5 mm	Provided Provided Provided	M/R M/R M/R
7	Automatic fire detection and alarming system.			
	<ul style="list-style-type: none"> • Type of detectors • Location of Main Panel • Location of Repeater Panel • Alternate source of power • Hooters' Location 	N/A N/A N/A N/A N/A	N/A N/A N/A N/A N/A	N/A N/A N/A N/A N/A
8	MOEFA	Required	Provided	M/R
9	Public Address System.	Required	Provided	M/R
10	Automatic Sprinkler System.			
	<ul style="list-style-type: none"> • Basement • Upper Floor • Sprinkler above false ceiling 	Required N/A N/A	Provided N/A N/A	M/R N/A N/A
11	Internal Hydrants			
	<ul style="list-style-type: none"> • Size of riser/down-comer • Number of hydrants per floor • Hose Box 	4" 04 04	Provided Provided Provided	M/R M/R M/R
12	Yard Hydrants.			
	<ul style="list-style-type: none"> • Total number of hydrants • Hose Box 	N/A N/A	N/A N/A	N/A N/A
13	Pumping Arrangements.			
	<ul style="list-style-type: none"> • Ground Level <ul style="list-style-type: none"> ➤ Discharge of main Pump ➤ Head of Main pump ➤ Number of main pumps ➤ Jockey Pump out put ➤ Jockey pump head ➤ Standby Pump out put 	N/A N/A N/A N/A N/A N/A N/A	N/A N/A N/A N/A N/A N/A N/A	N/A N/A N/A N/A N/A N/A N/A

	➤ Standby Pump Head	N/A	N/A	N/A
	➤ Auto Starting/ Manual stopping	N/A	N/A	N/A
	➤ Pump House Access			
	• Terrace level	900 LPM	900lpm	MR
	➤ Discharge of pump	40 M	Provided	MR
	➤ Head of the pump	Required	Provided	M/R
	➤ Power Supply	Required	Provided	M/R
	➤ Auto Starting of pump	Required	Provided	M/R
14	Captive Water Storage for fire fighting.			
	• Underground tank capacity	N/A	N/A	N/A
	➤ Draw-off connection	N/A	N/A	N/A
	➤ Fire service inlet	N/A	N/A	N/A
	➤ Access to tank	N/A	N/A	N/A
	• Overhead Tank capacity	10000 ltr	10000 ltr	M/R
15	Exit Signage.	Required	Provided	M/R
16	Provision of Lifts.			
	• Pressurization of Lift Shaft	N/A	N/A	N/A
	• Pressurization of Lift lobby	N/A	N/A	N/A
	• Communication In lift Car	N/A	N/A	N/A
	• Fireman's Grounding Switch	N/A	N/A	N/A
	• Lift Signage	N/A	N/A	N/A
17	Standby power supply	N/A	N/A	N/A
18	Refuge Area.			
	➤ Total Area	N/A	N/A	N/A
	➤ Location	N/A	N/A	N/A
19	Fire Control Room			
	• Detector System Panel	N/A	N/A	N/A
	• Flow Switch Panel	N/A	N/A	N/A
	• PA System Panel	N/A	N/A	N/A
	• Batter backup	N/A	N/A	N/A
	• Building Floor Plans	N/A	N/A	N/A
20	Special Fire Protection Systems for Protection of special Risks, if any:	N/A	N/A	N/A

The fire protection systems provided in the building were test checked and found functional at the time of inspection.


In view of the deemed compliance of the minimum standards of the fire prevention and fire safety measures as required under the rules the NOC issued vide letter no. F6/DFS/MS/2017/School/876 dated 19.06.2017 is recommended for renewal under rule 37 of the Delhi Fire Service rules 2010.

- Nr 25


9/3/21


Signature of the Inspecting Officer
Name Ajay Kumar Sharma
Designation ADO(Rohini)

DO (NW) What about the compliance
of Shortcomings issued on 03/08/2020?


10/03/2021

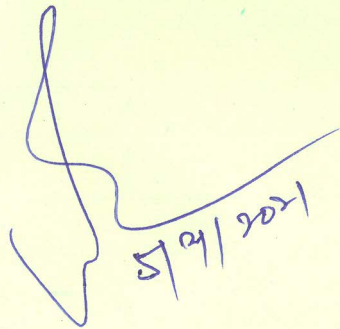
ADO (R)

Sir, Shortcomings issued on 03/08/2020 found
rectified at the time of inspection and
accordingly recommended for renewal of fsc.


31/3/21


Do (NW)


01/04/2021
~~By CFO (W2)~~

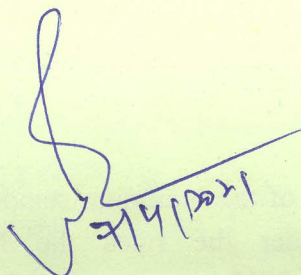

5/4/2021

~~ADO Rohini~~

FT letter is put up for kind
perusal and signature please.


6/4/21

~~ADO (W2)~~


7/4/2021