

c/42

**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE: NEW DELHI-110001**

No. F6/DFS/MS/School/WZ/2021/ 321

Dated: 13/04/2021

FIRE SAFETY CERTIFICATE

Certified that the **Heera Lal Public School, Bhagya Vihar, Jain Colony, Madan Pur Dabas, Delhi-110081**, comprised of **02 Block, Ground and Gr. + Three upper floors** owned/occupied by **Heera Lal Public School** have complied with the fire prevention and fire safety requirements in accordance with rule 33 of the Delhi Fire Service Rules, 2010 and verified by the officer concerned of fire service on dated **08.03.2021** in the presence of **Mr. Ramesh Chand (Manager)** and that the building/ premise is fit for occupancy Group B Educational with effect from **13/04/2021** for a period of **three years, in accordance with the rule 36 unless renewed under rule 37 or sooner cancelled under rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules, 2010.**

Issued on **13/04/2021** at New Delhi by


(Atul Garg)
DIRECTOR

Ph; 011-23414000

Copy to:

1. The Principal, Heera Lal Public School, Bhagya Vihar, Jain Colony, Madan Pur Dabas, Delhi-110081.
 2. The Director of Education, GNCT of Delhi Old Secretariat, Delhi-110054
- Conditions for validity of Fire Safety Certificate;**

1. All the fire safety arrangement provided there-in shall be maintained in good working conditions at all times.
2. Loss of life or property due to non functional fire safety measure shall be at the responsibility of the management.
3. The trained fire fighting staff should be available round the clock.
4. Any deviation with regard to the construction etc shall be verified by the concerned building sanctioning agency.
5. This certificate cannot be treated in any case for regularizations of unauthorized construction.
6. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director along with a copy of this Certificate, six months prior to its expiry”.
7. The owner / occupier shall submit a declaration every year in form “K” provided in the first schedule of Delhi Fire Service Rules 2010. The form ”K” is available on

http://www.delhi.gov.in/wps/wcm/connect/doiit_fire/FIRE/Home/Fire+Safety+Acts+and+Rules/
http://www.delhi.gov.in/wps/wcm/connect/doiit_fire/FIRE/Home/Forms

INSPECTION REPORT

1. Name & address of the building : Heera Lal Public School, Bhagya Vihar, Jain Colony, Madan Pur Dabas, Delhi-110081.
2. Type of Occupancy : Educational (02Blk- A-Blk-Ground+03 & B-Blk-Gr.)
3. Type of Case : New Case
4. Details of previous NOC : (OLD NOC-F6/DFS/MS/2017/School/766 dated: 29.05.2017 School is running G+01 upper floor)
5. Fire Safety directives letter No : NBC Part-IV
6. Date of inspection : 08.03.2021
7. Name of the Inspecting Officers : A.K.Sharma ADO (Rohini)
8. Name and designation of officers
from the building side : Mr. Ramesh Chand (Manager)
9. Year of Construction : 2003 & 2018
10. Applicant's letter No. : Online e-mail dated 24.02.2021

Plot Area-5110 Sq m Covered Area-1400 mtr No. of Class rooms-42 + 03 labs No. of Students-936

	Minimum Standards on fire prevention and fire safety U/R 33	NBC PART-IV	Provided at site	Remarks MR/NMR
1	Access to building			
	• Road width	6m	6m	MR
	• Gate width	4.5m	4.5m	MR
	• Width of internal road	NA	NA	NA
2	Number, Width, Type & Arrangement of Exits			
	a. Number of staircases			
	• Upper Floors	02	02	MR
	• Basements	NA	NA	NA
	b. Width of staircases			
	• Upper Floors	1.5 m	1.5m & 1.07	MR
	• Basements	NA	NA	NA
	c. Protection of exits			
	• Fire check door	NA	NA	NA
	• Pressurization	NA	NA	NA
	d. No. of continuous staircases to terrace	01	01	MR
	e. Width of Corridor	NA	NA	NA
	f. Door Size	1.2m	provided	MR


3	Compartmentation.			
	• Fire check door	NA	NA	NA
	• Sealing of electrical shafts	NA	NA	NA
	• Fire Rating of shaft door	NA	NA	NA
	• Water Curtain	NA	NA	NA
• Fire Dampers	NA	NA	NA	
4	Smoke Management System.			
	• Basements	30 a/c per hour	NA	NA
	• Upper floors	12 a/c per hour	Natural Ventilated	MR
5	Fire Extinguishers			
	• Total numbers	10nos	12 nos	MR
	• Types	ABC/Co2	ABC--12	MR
	• ISI marking	Yes	Yes	MR
6	First-Aid Hose Reels.			
	• Total numbers on each floor	03	04	MR
	• Length of hose reel hose	20m	Provided	MR
	• Nozzle diameter	5m	Provided	MR
7	Automatic fire detection and alarming system			
	• Type of detectors	NA	NA	NA
	• Location of Main Panel	NA	NA	NA
	• Location of Repeater Panel	NA	NA	NA
	• Alternate source of power	NA	NA	NA
	• Hooters' Location	NA	NA	NA
8	MOEFA			
9	Public Address System.			
		NA	NA	NA
10	Automatic Sprinkler System.			
	• Basement	NA	NA	NA
	• Upper Floor	NA	NA	NA
	• Sprinkler above false ceiling	NA	NA	NA
11	Internal Hydrants			
	• Size of riser/down-comer	NA	NA	NA
	• Number of hydrants per floor	NA	NA	NA

	<ul style="list-style-type: none"> Hose Box 	NA	NA	NA
12	Yard Hydrants.			
	<ul style="list-style-type: none"> Total number of hydrants 	NA	NA	NA
	<ul style="list-style-type: none"> Hose Box 	NA	NA	NA
13	Pumping Arrangements.			
	<ul style="list-style-type: none"> Ground Level <ul style="list-style-type: none"> Discharge of main Pump Head of Main pump Number of main pumps Jockey Pump out put Jockey pump head Standby Pump out put Standby Pump Head Auto Starting/ Manual stopping Pump House Access Terrace level <ul style="list-style-type: none"> Discharge of pump Head of the pump Power Supply Auto Starting of pump 			
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		450lpm	450lpm	MR
		40m	40m	MR
		Required	Provided	MR
		Required	Provided	MR
14	Captive Water Storage for fire fighting.			
	<ul style="list-style-type: none"> Underground tank capacity Draw-off connection Fire service inlet Access to tank Overhead Tank capacity 	NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		10,000ltr	10,000ltr	MR
15	Exit Signage.	Required	Provided	MR
16	Provision of Lifts.			
	<ul style="list-style-type: none"> Pressurization of Lift Shaft Pressurization of Lift lobby Communication In lift Car Fireman's Grounding Switch Lift Signage 	N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A

17	Standby power supply	N/A	N/A	N/A
18	Refuge Area.			
	<ul style="list-style-type: none"> ➤ Total Area ➤ Location 	N/A	N/A	N/A
19	Fire Control Room			
	• Detector System Panel	N/A	N/A	N/A
	• Flow Switch Panel	N/A	N/A	N/A
	• PA System Panel	N/A	N/A	N/A
	• Batter backup	N/A	N/A	N/A
	• Building Floor Plans	N/A	N/A	N/A
20	Special Fire Protection Systems for Protection of special Risks, if any:	N/A	N/A	N/A

The fire protection systems provided in the building were test checked and found functional at the time of inspection.


Keeping in view the substantial compliance of the minimum standards on fire prevention and fire safety required under the rules it is recommended to grant Fire Safety Certificate under rule 35 of the Delhi Fire Service Rule 2010


 Signature of the Inspecting Officer
 Name Ajay Kumar Sharma
 Designation ADO(Rohini)



DO (NW)





 19/03/2021
 Dy cfo (W2)



 23/07/2021




 23

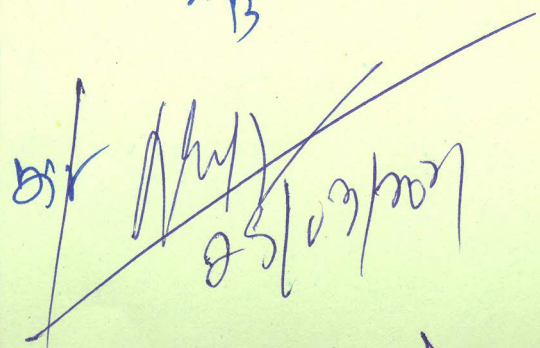
 23/03/2021




 23/03/2021