

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEAD QUARTERS: DELHI FIRE SERVICE, CONNAUGHT PLACE
NEW DELHI

No: F6/DFS/MS/MN/ *2021/hospital/253* Dated: *10/05/2021*
FIRE SAFETY CERTIFICATE

Certified that the **Guru Gobind Singh Hospital**, located at **Raghubir Nagar, New Delhi – 110027** comprised of Basement + Ground + 2 Upper Floors owned/Occupied by Guru Gobind Singh Hospital, was issued FSC by this department vide Letter no. F6/DFS/MS/Hospital/WZ/2017/1370 dated 15/09/2017. The premises was re inspected by the officer concerned of this department on 05/04/2021 in the presence of Sh. Md. Iqbal (JE)Electrical and found that the Fire prevention and fire safety arrangements provided in the premises, found in good working condition. The premises have deemed complied with the fire prevention and fire safety requirements in accordance with rule 33 of the Delhi Fire Service Rule, 2010 and that the premises is fit for occupancy class Group C (Institutional) with effect from *10/05/2021* for a period of three years in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules, 2010.

Issued on *10/05/2021* at New Delhi.

10/05/2021
(Dharampal Bhardwaj
DY. Chief Fire Officer,
West Zone

Copy to:-

1. The Medical Superintendent, Guru Gobind Singh Hospital, located at Raghubir Nagar, New Delhi-110027.
2. Assistant Engineer (E)-5, PWD HMESSD South West, Guru Gobind Singh, Hospital, Raghubir Nagar New Delhi-11027.

Following fire safety directives must be adhered to:-

1. All the fire safety arrangements provided therein shall be maintained in good working condition at all times.
2. Any loss of life or property due to non-functional fire safety measures shall be at the risk and responsibility of the management.
3. The trained staff should be available round the clock.
4. Any deviations w.r.t. construction shall be verified by the concerned building sanctioning agency.
5. The certificate may not be treated in any case for the regularization of the unauthorized construction, if any.
6. The basement shall be used as per building bye laws.
7. The owner/occupier shall submit a declaration every year in the form 'K' provided in the first schedule of Delhi Fire Service Rules 2010, form is available on www.dfs.delhigovt.nic.in.
8. The owner/ occupier shall apply for renewal of this Fire Safety Certificate to the Director in Form 'J' [sub rule (1) of rule 37] along with a copy of this certificate, six months prior to its expiry.

INSPECTION REPORT

1. Name & address of the building : Guru Gobind Singh Hospital, Raghubir Nagar, New Delhi-110027.
2. Type of Occupancy : Class-C(Institutional/Hospital)
3. Type of Case : Renewal
4. Details of previous NOC : F6/DFS/MS/Hospital/WZ/2017/1370 dated 15/09/2017
5. Fire Safety directives letter No : F6/DFS/MS/Hospital/2013/WZ/505 dated 01/07/2013
6. Date of inspection : 05/04/2021
7. Name of the Inspecting Officers : Sarabjeet Singh, Asst. Divisional Officer (MN)
8. Name and designation of officers from the building side : Sh. Md. Iqbal (JE)
9. Year of Construction : 1993
10. Applicant's letter No. : F.N.9(2)...2020-21/198 dated 16/09/2020

| S. No | Minimum Standards on fire prevention and fire safety U/R 33 | NBC/ BBL Requirement | Provided at site | Remarks MR/NMR |
|-------|--|----------------------|--|----------------|
| 1 | Access to building | | | |
| | <ul style="list-style-type: none"> • Road width | 12 mts | Provided | MR |
| | <ul style="list-style-type: none"> • Gate width | 5 mts | Provided | MR |
| | <ul style="list-style-type: none"> • Width of internal road | 6 mts | Provided(Accessible from 3 sides) | MR |
| 2 | Number, Width, Type & Arrangement of Exits | | | |
| | a. Number of staircases | | | |
| | <ul style="list-style-type: none"> • Upper Floors | 5 | 5 | MR(Old Casse) |
| | <ul style="list-style-type: none"> • Basements | 4 | 4 | MR(Old Casse) |
| | b. Width of staircases | | | |
| | <ul style="list-style-type: none"> • Upper Floors | 2mts | 1.68 mts x 2, 1.38 mts x 2, 0.94x1 | MR(Old Casse) |
| | <ul style="list-style-type: none"> • Basements | 2mts | 1.68 mtsx1, 1.38x3, 2 ramps(5.90 mts x 1, 5.50 mts x 1) | MR(Old Casse) |
| | c. Protection of exits | | | |
| | <ul style="list-style-type: none"> • Fire check door | Required | Provided | MR |
| | <ul style="list-style-type: none"> • Pressurization | Required | Provided | MR |
| | e. No. of continuous staircases to terrace | 01 | Provided | MR |
| | g. Width of Corridor | 2.40 mts | 2.70 mts Provided | MR |
| | h. Door Size | 1.0 mts | 1.0 mts(Old Casse) | MR |
| 3 | Compartmentation. | | | |
| | <ul style="list-style-type: none"> • Fire check door | Required | Provided | MR |
| | <ul style="list-style-type: none"> • Sealing of electrical shafts | Required | Provided | MR |
| | <ul style="list-style-type: none"> • Fire Rating of shaft door | NR | NR | NR |
| | <ul style="list-style-type: none"> • Water Curtain | | Provided | |
| | <ul style="list-style-type: none"> • Fire Dampers | NR | NR | NR |
| 4 | Smoke Management System. | | | |
| | <ul style="list-style-type: none"> • Basements | Required | Provided | MR |
| | <ul style="list-style-type: none"> • Upper floors | Required | Provided | MR |

| Fire Extinguishers | | | | |
|--------------------|---|--------------------------------|-------------------|----------|
| | <ul style="list-style-type: none"> Total numbers Types IS marking | 50 | 150 Provided | MR |
| | | ISI Marked ABC/CO ₂ | Provided | MR |
| | | Required | Provided | MR |
| 6 | First-Aid Hose Reels. | | | |
| | <ul style="list-style-type: none"> Total numbers on each floor Length of hose reel hose Nozzle diameter | 6 | 12 Provided | MR |
| | | 30 mts | 30mts Provided | MR |
| | | 5mm | 5mm Provided | MR |
| 7 | Automatic fire detection and alarming system | | | |
| | <ul style="list-style-type: none"> Type of detectors Location of Main Panel Location of Repeater Panel Alternate source of power Hooters' Location | Smoke | Provided | MR |
| | | G.F. | Provided | MR |
| | | G.F. | Provided | MR |
| | | Required | Provided | MR |
| | | Required | Provided | MR |
| 8 | MOEFA | Required | Provided | MR |
| 9 | Public Address System. | Required | Provided | MR |
| 10 | Automatic Sprinkler System | | | |
| | <ul style="list-style-type: none"> Basement Upper Floor Sprinkler above false ceiling | Required | Provided | MR |
| | | NR | Provided | NR |
| | | NR | NR | NR |
| 11 | Internal Hydrants | | | |
| | <ul style="list-style-type: none"> Size of riser/down-comer Number of hydrants per floor Hose Box | 150 mm | Provided | NR |
| | | Required | Provided | MR |
| | | Required | Provided | MR |
| 12 | Yard Hydrants. | | | |
| | <ul style="list-style-type: none"> Total number of hydrants Hose Box | Required | Provided | MR |
| | | Required | Provided | MR |
| 13 | Pumping Arrangements | | | |
| | <ul style="list-style-type: none"> Ground Level <ul style="list-style-type: none"> Discharge of main Pump Head of Main pump Number of main pumps Jockey Pump out put Jockey pump head Standby Pump out put Standby Pump Head Auto Starting/ Manual stopping Pump House Access Terrace level <ul style="list-style-type: none"> Discharge of pump Head of the pump Power Supply Auto Starting of pump | 2280 lpm | 2280 lpm Provided | MR |
| | | 70 MH | 70 MH Provided | MR |
| | | 2 | 2 Provided | MR |
| | | 180 lpm | 180 lpm Provided | MR |
| | | 70 MH | 70 MH Provided | MR |
| | | 2280 lpm | 2280 lpm Provided | MR |
| | | 70 MH | 70 MH Provided | MR |
| | | Required | Provided | MR |
| | | Required | Provided | MR |
| | | | | |
| | | NR | NR | NR |
| | | NR | NR | NR |
| | | NR | NR | NR |
| | | NR | NR | NR |
| 14 | Captive Water Storage for fire fighting | | | |
| | <ul style="list-style-type: none"> Underground tank capacity Draw-off connection Fire service inlet | 1,50,000 ltrs | 2,50,000 ltrs | Provided |
| | | Required | Provided | MR |
| | | Required | Provided | MR |
| | | Required | Provided | MR |

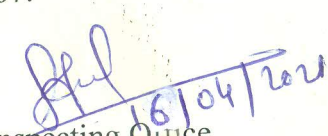
| | | | | |
|----|--|-------------|-------------|----|
| | • Overhead Tank capacity | 10.000 ltrs | 10,000 ltrs | MR |
| 15 | Exit Signage. | Required | Provided | MR |
| 16 | Provision of Lifts. | | | |
| | • Pressurization of Lift Shaft | Required | Provided | MR |
| | • Pressurization of Lift lobby | Required | Provided | MR |
| | • Communication In lift Car | Required | Provided | MR |
| | • Fireman's Grounding Switch | Required | Provided | MR |
| | • Lift Signage | Required | Provided | MR |
| 17 | Standby power supply | Required | Provided | MR |
| 18 | Refuge Area. | | | |
| | ➤ Total Area | NR | NR | NR |
| | ➤ Location | NR | NR | NR |
| 19 | Fire Control Room | | | |
| | • Detector System Panel | Required | Provided | MR |
| | • Flow Switch Panel | Required | Provided | MR |
| | • PA System Panel | Required | Provided | MR |
| | • Batter backup | Required | Provided | MR |
| | • Building Floor Plans | Required | Provided | MR |
| 20 | Special Fire Protection Systems for Protection of special Risks, if any: | NR | NR | NR |

The fire protection systems provided in the building were checked and found functional at the time of inspection.

The shortcomings pointed by this deptt. Vide letter No. F6/DFS/MS/2021/243 dated 01/02/2021 have complied by the management.


In view the substantial compliance of the minimum standards on fire prevention and fire safety required under the rules, it is recommended to grant fire safety certificate as per as per the Delhi Fire Service Rules 2010 under Delhi Fire Service Act- 2007.
Accordingly, DFA is put up please

17
04/ADO/MN
16/04/2021


Signature of the Inspecting Officer
Name: Sarabjeet Singh
Designation: ADO (MN)


DO (West Division)


D.O. (WEST)/117
DATED: 19/4/2021


DCP (WZ) 28/5/2021

ADSI M.N Sir, F. is put up for your sig. pls,

DCP (WZ)


19/5/2021


06/05/2021