

**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEAD QUARTERS: DELHI FIRE SERVICE: NEW DELHI-110001**

No. F6/DFS/MS/EH/SZ/2021/ 108

Dated: 27/4/21

FIRE SAFETY CERTIFICATE

Certified that the M/s. M/s. **Delly Belly Restaurant (a unit of Delhi Kinghters Restaurant and caters Pvt. Ltd.)**, BP- 7, 8, 10, Bunglow No. 2, Ground Floor, West Patel Nagar, New Delhi, **running at Ground Floor** of a building comprised of ground plus three upper floors was inspected by the officers concerned of this department on 09.04.2021 in presence of Sh. Sh. Atul Bansal, owner and found that the restaurant have complied with the fire prevention and fire safety requirements in accordance with rule 33 of the Delhi Fire Service Rules, 2010 and that the premises is fit for occupancy class assembly (restaurant) at **ground floor only** with effect from 27/4/21 for a period of three years in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules 2010, printed below.

Issued on 27/4/21 at New Delhi by.


(Atul Garg)
Director

Delhi Fire Service

Copy to:-

1. Sh. Atul Bansal,
M/s. Delly Belly Restaurant (A unit of Delhi Kinghters Restaurant and caters Pvt. Ltd.), B.P. 7, 8, 10, Bunglow No. 2, GF, West Patel Nagar, New Delhi- 08.
2. The Deputy Health Officer, North Delhi Municipal Corporation, Karol Bagh Zone, New Delhi- 110005.
3. The Joint Commissioner of Police (Lic), 1st Floor, Police Station Defence Colony, New Delhi- 110024.

Conditions for the validity of Fire Safety Certificate: -

1. All the fire safety arrangements provided therein shall be maintained in good working conditions at all times.
2. Any loss of life or property due to non-functional of fire safety measures shall be at the risk & responsibility of the management.
3. The trained firefighting staffs should be available round the clock.
4. Any deviation w.r.t. construction etc. shall be verified by the concerned building sanctioning authority.
5. This fire safety certificate may not be treated in any case for regularization of unauthorized construction, if any.
6. All the means of escapes /exits shall not be locked/bolted/blocked at any time for safe evacuation of the occupants in case of any emergency.
7. The owner / occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on www.dfs.delhigovt.nic.in
8. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in Form "J" [sub rule (1) of rule 37] along with a copy of this certificate, six months prior to its expiry. The form is available on www.dfs.delhigovt.nic.in

INSPECTION REPORT

1. Name & address of the building : M/s. Delly Belly Restaurant, BP- 7, 8, 10, Bunglow No. 2, Ground Floor, West Patel Nagar, New Delhi.
2. Type of Occupancy : Assembly (Restaurant)
3. Type of Case : New Case
4. Details of previous NOC : N/A
5. Fire Safety directives letter No : N/A
6. Date of inspection : 09.04.2021
7. Name of the Inspecting Officers : D.B. Mukerjee, Div. Officer (SWD) & P.V. Rathee, Asstt. Div. Officer (SRD)
8. Name and designation of officers from the building side : Sh. Atul Bansal, owner
9. Year of Construction : Before 2004
10. Applicant's letter No. : Online Application Id No. 2020100907509

The said restaurant is running at ground floor of a building comprised of ground plus three upper floors.

S. No.	Minimum Standards on fire prevention and fire safety U/R 33	Requirement as per NBC/UBBL	Provided at site	Remarks MR/NMR
1	Access to building			
	• Road width	06 mts	Provided	MR
	• Gate width	4.5 mts	Provided	MR
	• Width of internal road	N/A	N/A	N/A
2	Number, Width, Type & Arrangement of Exits			
	a. Number of staircases	-	-	-
	• Upper Floors	N/A	N/A	Restaurant running at GF only
	• Basements	N/A	N/A	Restaurant running at GF only
	b. Width of staircases	-	-	-
	• Upper Floors	N/A	N/A	Restaurant running at GF only
	• Basements	N/A	N/A	Restaurant running at GF only
	c. Protection of exits	-	-	-
	• Fire check door	N/A	N/A	N/A
	• Pressurization	N/A	N/A	N/A
	e. No. of continuous staircases to terrace	N/A	N/A	N/A
	g. Width of Corridor	N/A	N/A	N/A
	h. Door Size	2.0 mts & 1.95 mts. (02 nos.)	2.0 mts & 1.95 mts	MR
3	Compartmentation.			
	• Fire check door	N/A	N/A	N/A
	• Sealing of electrical shafts	N/A	N/A	N/A
	• Fire Rating of shaft door	N/A	N/A	N/A
	• Water Curtain	N/A	N/A	N/A
	• Fire Dampers	N/A	N/A	N/A
4	Smoke Management System.			
	• Basements	30 a/c per hour	N/A	N/A
	• Upper floors	12 a/c per hour	Natural ventilation	MR
5	Fire Extinguishers			
	• Total numbers	06	Provided	MR
	• Types	CO ₂ , ABC type	Provided	MR
	• IS marking	ISI marked	Provided	MR

6	First-Aid Hose Reels.			
	• Total numbers on each floor	01	Provided	MR
	• Length of hose reel hose	30 m	Provided	MR
	• Nozzle diameter	5 mm	Provided	MR
7	Automatic fire detection and alarming system.			
	• Type of detectors	N/A	N/A	N/A
	• Location of Main Panel	N/A	N/A	N/A
	• Location of Repeater Panel	N/A	N/A	N/A
	• Alternate source of power	N/A	N/A	N/A
	• Hooters' Location	N/A	N/A	N/A
8	MOEFA	Required	Provided	MR
9	Public Address System.	N/A	N/A	N/A
10	Automatic Sprinkler System.			
	• Basement	N/A	N/A	N/A
	• Entire Restaurant	N/A	N/A	N/A
	• Sprinkler above false ceiling	N/A	N/A	N/A
11	Internal Hydrants			
	• Size of riser/down-comer	N/A	N/A	N/A
	• Number of hydrants per floor	N/A	N/A	N/A
	• Hose Box	N/A	N/A	N/A
12	Yard Hydrants.			
	• Total number of hydrants	N/A	N/A	N/A
	• Hose Box	N/A	N/A	N/A
13	Pumping Arrangements.			
	• Ground Level	---	---	---
	➤ Discharge of main Pump	N/A	N/A	N/A
	➤ Head of Main pump	N/A	N/A	N/A
	➤ Number of main pumps	N/A	N/A	N/A
	➤ Jockey Pump out put	N/A	N/A	N/A
	➤ Jockey pump head	N/A	N/A	N/A
	➤ Standby Pump out put	N/A	N/A	N/A
	➤ Standby Pump Head	N/A	N/A	N/A
	➤ Auto Starting/ Manual stopping	N/A	N/A	N/A
	➤ Pump House Access	N/A	N/A	N/A
	• Terrace level	-----	-----	-----
	➤ Discharge of pump	450 LPM	Provided	MR
	➤ Head of the pump	30 mts	Provided	MR
	➤ Power Supply	Required	Provided	MR
	➤ Auto Starting of pump	Required	Provided	MR
14	Captive Water Storage for fire fighting.			
	• Underground tank capacity	N/A	N/A	N/A
	➤ Draw-off connection	N/A	N/A	N/A
	➤ Fire service inlet	N/A	N/A	N/A
	➤ Access to tank	N/A	N/A	N/A
	• Overhead Tank capacity	20000 lts	Provided	MR
15	Exit Signage	Required	Provided	MR


16	Provision of Lifts.			
	• Pressurization of Lift Shaft	N/A	N/A	N/A
	• Pressurization of Lift lobby	N/A	N/A	N/A
	• Communication In lift Car	N/A	N/A	N/A
	• Fireman's Grounding Switch	N/A	N/A	N/A
	• Lift Signage	N/A	N/A	N/A
17	Standby power supply	Required	Provided	MR
18	Refuge Area.			
	➤ Total Area	N/A	N/A	N/A
	➤ Location	N/A	N/A	N/A
19	Fire Control Room			
	• Detector System Panel	N/A	N/A	N/A
	• Flow Switch Panel	N/A	N/A	N/A
	• PA System Panel	N/A	N/A	N/A
	• Batter backup	N/A	N/A	N/A
	• Building Floor Plans	N/A	N/A	N/A
20	Special Fire Protection Systems for Protection of special Risks, if any:	Required	Two ABC type fire extinguisher found provided near elect. panel	MR

The fire protection systems provided in the building were checked and found functional at the time of inspection.


In view the substantial compliance of the minimum standards on fire prevention and fire safety required under the rules, it is recommended to grant fire safety certificate under Delhi Fire Service Act-2007 & Rules- 2010.

DFA is put up for approval & signature please.


 D.B. Mukharjee
 Divisional Officer (SW)



 P.V. Rathee
 Asstt. Div. Officer (SRD)

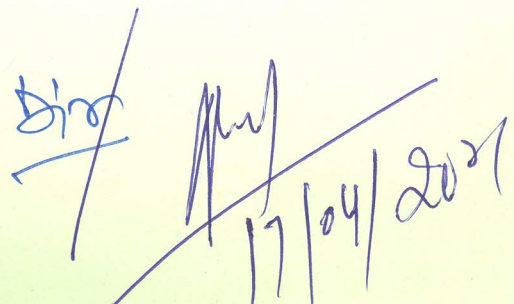
Dy cfo (S2)


 13/4


 C.F.O.

Recd to dy


 18/4


 17/04/2021

FI P4

