

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE: CANNAUGHT PLACE

NEW DELHI- 110001


No.F6/DFS/MS/School/SZ/2021/ 322

Dated: 15/4/21

FIRE SAFETY CERTIFICATE

Certified that the P.M School, B-10, Madhu Vihar , Som Bazar road, Uttam Nagar, New Delhi-110059, Comprised of ground plus two upper floor owned/occupied P.M School was issued FSC vide letter no. F6/DFS/MS/School/2017/SZ/55 dated 13/01/2017(for G+1).The school building was re-inspected by the officer concerned of this department on dated 25/03/2021 in the presence of Sh. Birender Solanki (Manager) and found that the school building have deemed complied with the fire prevention and fire safety requirements in accordance with rule 27 of the Delhi Fire Service Rules 2010 and found that the building is fit for occupancy class B 'Educational Building' with effect from ...15.7.21... for a period of three years, in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under rule-38 of the Delhi Fire Service Rules, 2010 printed overleaf.

Issued on.....15/4/21..... at New Delhi by

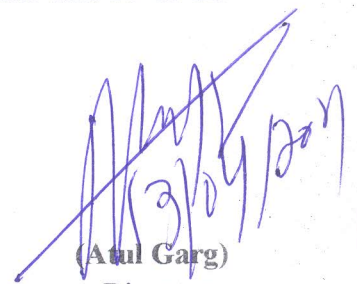

(Atul Garg)
Director

Delhi Fire Service



To,

The Principal,
P.M School,B-10, Madhu Vihar , Som Bazar road,
Uttam Nagar, New Delhi-110059 ,

Copy to:-

Director of Education
Govt. of NCT of Delhi, Old Secretariat,
New Delhi-110054.

CONDITIONS:

1. All the means of escape shall be kept free of all type of obstruction all the time.
2. All the employees shall be acquainted with the use and maintenance of all fire equipments and method of smooth and speedy safe evacuation of occupants in case of emergency.
3. All the fire fighting equipments shall be maintained in perfect working condition all the time and any lapse rendering non-functional of fire safety measures, management shall be responsible.
4. Any deviation, with regards to construction, ventilation, occupancy, electric installation etc. may be got verified from the concerned authorities.
5. This Fire Safety Certificate may not be treated in any case for regularizations of unauthorized construction unauthorized use of land if any.
6. The owner / occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rule 2010. The form is available on www.dfs.delhigovt.nic.in

N/15

INSPECTION REPORT

- 1 Name & address of the building : P.M School, B-10, MadhuVihar, Som Bazar road, Uttam Nagar, New Delhi- 110059.
- 2. Building is comprised of : **Ground plus Two upper floor**
- 3. Type of Occupancy : Educational
- 4. Type of Case : New (addition of one floor)
- 5. Details of Previous NOC : F.6/DFS/MS/school/2017/SZ/55 Dt.- 13/01/2017(G+1)
- 6. Fire Safety direction letter No : N/A
- 7. Date of Inspection : 25/03/2021
- 8. Name of the Inspecting Officers: : ADO R.K. YADAV
- 9. Name of the designation of Officer from the building side : Sh. Birender Solanki (Manager)
- 10. Year of Construction : 2012
- 11. Applicant's letter No : Nil Dated -09/03/2021

S.No	Minimum Standards on fire prevention and fire safety requirements U/R 33	Requirement UBBL/NBC-IV	Provided at Site	Remarks MR/NMR
1	Access to building			MR
	Road width	6 mtrs.	06 mtrs.	MR
	Gate width	4.5	Direct accessible from road	MR
	Width of internal road	N.A.	N.A.	N.A.
2	Number, Width, Type and Arrangement of Exits			
	a. Number of Staircases			
	Upper Floor	2 nos.	2 nos.	MR
	Basement	N.A.	N.A.	N.A.
	B. Width of Staircases			
	Upper Floor	1.5 m each	1.5 m each	MR
	Basement	N.A.	N.A.	N.A.
	c. Protection of exits			
	Fire check door	N.A.	N.A.	N.A.
	Pressurization	N.A.	N.A.	N.A.
	e. No. of continuous staircases to terrace	Required	Provided	MR
	g. Width of Corridor	1.5	1.5 m	MR
h. Door Size	1 m	1 m	MR	
3	Compartmentation.			
	Fire check door	N.A.	N.A.	N.A.
	Sealing of electrical shafts	N.A.	N.A.	N.A.
	Fire rating of shaft door	N.A.	N.A.	N.A.
	Water curtain	N.A.	N.A.	N.A.
	Fire Dampers	N.A.	N.A.	N.A.
4	Smoke Management System.			
	Basement	N.A.	N.A.	N.A.
	Upper floor	Required	Natural ventilation	MR

5.	Fire Extinguisher			
	Total numbers	06 Nos.	06 Nos.	MR
	types	CO ₂ & ABC	CO ₂ & ABC	MR
	IS marking	ISI marked	ISI marked	MR
6	First-aid-Hose Reels.			
	Total numbers of each floor	One	Provided	MR
	Length of hose reel hose	30 m	Provided	MR
	Nozzle diameter	5 mm	Provided	MR
7	Automatic fire detection and alarming system.			
	Type of detectors	N.A.	N.A.	N.A.
	Location of main panel	N.A.	N.A.	N.A.
	Location of repeater panel	N.A.	N.A.	N.A.
	Alternate source of power	N.A.	N.A.	N.A.
	Hooters	N.A.	N.A.	N.A.
8	MOEFA	N.A.	N.A.	N.A.
9	Public address System.	N.A.	N.A.	N.A.
10	Automatic Sprinkler System.			
	basement	N.A.	N.A.	N.A.
	upper floor	N.A.	N.A.	N.A.
	sprinkler above false ceiling	N.A.	N.A.	N.A.
11	Internal Hydrants			
	size of riser/down-comer	N.A.	N.A.	N.A.
	Number of hydrants per floor	N.A.	N.A.	N.A.
	Hose Box	N.A.	N.A.	N.A.
12	Yard Hydrants.			
	Total number of hydrants	N.A.	N.A.	N.A.
	Hose Box	N.A.	N.A.	N.A.
13	Pumping Arrangements.			
	• Ground Level	N.A.	N.A.	N.A.
	➤ Discharge of main Pump	N.A.	N.A.	N.A.
	➤ Head of Main Pump	N.A.	N.A.	N.A.
	➤ Number of main pumps	N.A.	N.A.	N.A.
	➤ Jockey pump out put	N.A.	N.A.	N.A.
	➤ Jockey pump head	N.A.	N.A.	N.A.
	➤ Standby pump out put	N.A.	N.A.	N.A.
	➤ Standby pump Head	N.A.	N.A.	N.A.
	➤ Auto Starting /Manual stopping	N.A.	N.A.	N.A.
	➤ Pump House Access	N.A.	N.A.	N.A.
	• Terrace Level			
	➤ Discharge of pump	450 LPM	Provided	MR
	➤ Head of the Pump	30m	Provided	MR
	➤ Power supply	Required	Provided	MR
	➤ Auto Starting of pump	Required	Provided	MR

14	Captive Water Storage for Fire Fighting.			
	Underground tank capacity	N.A.	N.A.	N.A.
	Draw-off connection	N.A.	N.A.	N.A.
	Fire service inlet	N.A.	N.A.	N.A.
	Access to tank	N.A.	N.A.	N.A.
	Overhead Tank capacity	10,000 ltrs	10,000 ltrs	MR
15	Exit Signage.	Required	Provided	MR
16	Provision of Lifts.			
	Pressurization of Lift Shaft	N.A.	N.A.	N.A.
	Pressurization of Lift lobby	N.A.	N.A.	N.A.
	Communication in lift car	N.A.	N.A.	N.A.
	Firemen's grounding switch	N.A.	N.A.	N.A.
	Lift Signage	N.A.	N.A.	N.A.
17	Standby power supply	N.A.	N.A.	N.A.
18	Refuge Area.			
	Total area	N.A.	N.A.	N.A.
	Location	N.A.	N.A.	N.A.
19	Fire Control Room			
	Detector system panel	N.A.	N.A.	N.A.
	Flow switch panel	N.A.	N.A.	N.A.
	PA system panel	N.A.	N.A.	N.A.
	Batter backup	N.A.	N.A.	N.A.
	Building Floor Plans	N.A.	N.A.	N.A.
20	Special Fire Protection systems for protection of special Risks, if any:	N.A.	N.A.	N.A.

The fire protection systems provided in the building were test checked and found functional at the time of inspection. The shortcomings issued vide letter no. F6/DFS/MS/School/2019/SZ/5599 dated 13/09/19 has been rectified.

Keeping in view the substantial compliance of the minimum standards on fire prevention and fire safety measures under the rule 27 of the Delhi Fire Service Rules 2010 it is recommended to issue Fire Safety Certificate.

Signature of the Inspecting Officer

Name R K YADAV

Designation ADO (JKP)

DO (South West)

on leave
by
STN
CF.O. (on day off)
Directed by
11/04/2021
to only see the
Shankar (Brow)
to school