

FORM 'H'
FORM FOR ISSUING FIRE SAFETY CERTIFICATE
[Refer sub - rule (1) of rule 35]
GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEAD QUARTERS: DELHI FIRE SERVICE, CONNAUGHT PLACE
NEW DELHI

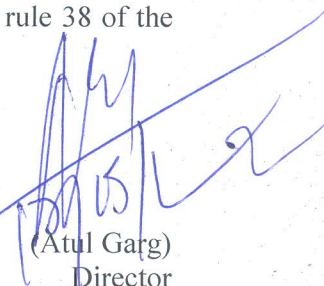
No.F6/DFS/MS/School/2021/ 376

Dated: 10/04/2021

FIRE SAFETY CERTIFICATE

Certified that the Building at Shiksha Bharti Educational Society, Senior School Building Located at Sector-8, Dwarka, New Delhi-110075, comprised of Basement + Ground + 4 Upper Floor was issued FSC vide Letter No. F6/DFS/MS/School/2018/SZ/514 Dated 27/03/2018. The premises was re inspected by the officers concerned of this department on 12/04/2021 in the presence of Mr. Hitesh Bhardwaj (Manager) and found that the said building have deemed complied with the fire prevention and fire safety requirements in accordance with rule 33 of the Delhi Fire Service Rule, 2010 and that the premises is fit for occupancy class-B "Educational building" with effect from 10/5/21 for a period of three years in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules, 2010.

Issued on 10/5/21 at New Delhi by.


(Atul Garg)
Director
Delhi Fire Service.

Copy to:

1. The Assistant Director (Building) DDA,Vikas Sadan INA, Delhi-23
2. The Commissioner, North Delhi Municipal Corporation, Civic Centre, Minto Road, New Delhi -110002
3. The Principal, Shiksha Bharti Educational Society, Senior School Building Located at Sector-8, Dwarka, New Delhi-110075,.
4. Directorate of Education Old Secretariat Delhi – 110054

Following fire safety directives must be adhered to:-

- 1 All the fire safety arrangements provided therein shall be maintained in good working condition at all times.
- 2 Any loss of life or property due to non-functional fire safety measures shall be at the risk and responsibility of the management.
- 3 The trained staff should be available round the clock.
- 4 Any deviations w.r.t. construction shall be verified by the concerned building sanctioning agency.
- 5 The certificate may not be treated in any case for the regularization of the unauthorized construction, if any.
- 6 The owner/ occupier shall apply for renewal of this Fire Safety Certificate to the Director in Form 'J' [sub rule (1) of rule 37] along with a copy of this certificate, six months prior to its expiry.
- 7 Basement shall be used strictly as per building bye laws.
- 8 The owner/occupier shall submit a declaration every year in the form 'K' provided in the first schedule of Delhi Fire Service Rules 2010 form is available on www.dfs.delhi.govt.nic.in

N/21

Re inspection to see the compliance of shortcomings communicated vide letter no. F6/DFS/MS/School/SZ/2021/186 dated 05/04/2021 are complied

INSPECTION REPORT

1. Name & address of the building: Shiksha Bharti Educational Society, Senior School Building Located at Sector-8, Dwarka, New Delhi-110075
2. Type of Occupancy : Educational (Basement + Ground+ 4 Upper Floors)
3. Type of Case : Renewal
4. Details of previous NOC : F6/DFS/MS/School/2018/SZ/514 Dated 27/03/2018
5. Fire Safety directives Letter No. : F6/DFS/MS/BP/2013/323 Dated 29/10/2013
6. Date of inspection : 12-04-2021
7. Name of the Inspecting Officer : Udai vir singh, ADO (DWK)
8. Name and designation of Officer
from the building side : Mr. Hitesh Bhardwaj (Manager)
9. Year of Construction : 2018
10. Applicant's letter No. : Email Dated 31/03/2021

S No	Minimum standards on fire prevention and fire safety U/R 33	As per N/2	Provided at site	Remarks MR/NMR
1.	Access of building			
	• Road width	09 mtr	30 m	MR
	• Gate width	4.5 mtr	06 m	MR
	• Width of internal road	06 mtr	Old case	MR
2.	Number, width, Type & Arrangements of exits			
	a. Number of staircases			
	• Upper floors	4 Nos.+1 Ramp	4 Nos.+1 Ramp	MR (Old case)
	• Basements	3 Nos.+2 Ramp	3 Nos.+2 Ramp	MR (Old case)
	b. Width of staircases			
	• Upper floors	1.5 m	4x150cm Provided	MR (Old case)
	• Basements	1.5 m	3x150cm Provided	MR (Old case)
	c. Protection of exits			
	• Fire check door	Required	Provided at basement	MR
	• Pressurization	NA	Open to air	NA
	d. No of continuous staircase to terrace	03 Nos.	Provided	MR
	e. Width Of Corridor	1.5m	Provided	MR (Old case)
	f. Door Size	1-1.50 mtr	Provided	MR (Old case)

3.	Compartmentation			
	<ul style="list-style-type: none"> • Fire check door 	Required	Provided at basement	MR
	<ul style="list-style-type: none"> • Sealing of electrical shafts 	Required	Provided	MR
	<ul style="list-style-type: none"> • Fire Rating of shaft door 	02 Hrs	Provided	MR
	<ul style="list-style-type: none"> • Water Curtain 	NA	NA	NA
	<ul style="list-style-type: none"> • Fire Dampers 	NA	NA	NA
4.	Smoke managements System			
	<ul style="list-style-type: none"> • Basements 	30 a/c charge	Provided	MR
	<ul style="list-style-type: none"> • Upper floors 	12 a/c charge	Natural ventilation	MR
5.	Fire Extinguishers			
	<ul style="list-style-type: none"> • Total numbers 	30 nos.	32 Nos. Provided	MR
	<ul style="list-style-type: none"> • Types 	ABC & CO ₂	ABC & CO ₂	MR
	<ul style="list-style-type: none"> • IS marking 	ISI marked	ISI marked	MR
6.	First – Aid Hose Reels			
	<ul style="list-style-type: none"> • Total numbers on each floor 	03 Nos.	Provided	MR
	<ul style="list-style-type: none"> • Length of hose reel hose 	30	Provided	MR
	<ul style="list-style-type: none"> • Nozzle diameter 	05 mm	Provided	MR
7.	Automatic fire detection and alarming system			
	<ul style="list-style-type: none"> • Type of detectors 	NA	NA	NA
	<ul style="list-style-type: none"> • Location of Main Panel 	NA	NA	NA
	<ul style="list-style-type: none"> • Location of Repeater Panel 	NA	NA	NA
	<ul style="list-style-type: none"> • Alternate source of power 	NA	NA	NA
	<ul style="list-style-type: none"> • Hooters' Location 	NA	NA	NA
8.	MOEFA	Required	Provided	MR
9.	Public Address System	Required	Provided	MR
10.	Automatic Sprinkler System			
	<ul style="list-style-type: none"> • Basements 	Required	Provided	MR
	<ul style="list-style-type: none"> • Upper Floor 	NA	NA	NA
	<ul style="list-style-type: none"> • Sprinkler above false ceiling 	NA	NA	NA
11.	Internal Hydrants:			
	<ul style="list-style-type: none"> • Size of riser/down-comer 	100 mm	100 mm	MR
	<ul style="list-style-type: none"> • Number of hydrants per floor 	03 Nos.	03 Nos.	MR
	<ul style="list-style-type: none"> • Hose Box 	Required	Provided	MR
12.	Yard Hydrants			
	<ul style="list-style-type: none"> • Total number of hydrants 	NA	NA	NA
	<ul style="list-style-type: none"> • Hose Box 	NA	NA	NA

N/25																																										
13.	Pumping Arrangements:																																									
	<ul style="list-style-type: none"> • Ground Level • Discharge of main pump ➤ Head of main pump ➤ Number of main pumps ➤ Jockey pump out put ➤ Jockey pump head ➤ Standby Pump out put ➤ Standby Pump Head ➤ Auto starting/Manual stopping ➤ Pump House Access • Terrace level ➤ Discharge of pump ➤ Head of the pump ➤ Power supply ➤ Auto starting of pump 	<table border="1"> <tr><td>1620 lpm</td><td>Provided</td><td>MR</td></tr> <tr><td>40 m</td><td>Provided</td><td>MR</td></tr> <tr><td>01</td><td>Provided</td><td>MR</td></tr> <tr><td>NA</td><td>Provided</td><td>NA</td></tr> <tr><td>NA</td><td>Provided</td><td>NA</td></tr> <tr><td>1620 lpm</td><td>Provided</td><td>MR</td></tr> <tr><td>40 m</td><td>Provided</td><td>MR</td></tr> <tr><td>Required</td><td>Provided</td><td>MR</td></tr> <tr><td>Required</td><td>Provided</td><td>MR</td></tr> <tr><td>NA</td><td>450LPM</td><td>NA</td></tr> <tr><td>NA</td><td>40m</td><td>NA</td></tr> <tr><td>NA</td><td>Provided</td><td>NA</td></tr> <tr><td>NA</td><td>Provided</td><td>NA</td></tr> </table>	1620 lpm	Provided	MR	40 m	Provided	MR	01	Provided	MR	NA	Provided	NA	NA	Provided	NA	1620 lpm	Provided	MR	40 m	Provided	MR	Required	Provided	MR	Required	Provided	MR	NA	450LPM	NA	NA	40m	NA	NA	Provided	NA	NA	Provided	NA	
1620 lpm	Provided	MR																																								
40 m	Provided	MR																																								
01	Provided	MR																																								
NA	Provided	NA																																								
NA	Provided	NA																																								
1620 lpm	Provided	MR																																								
40 m	Provided	MR																																								
Required	Provided	MR																																								
Required	Provided	MR																																								
NA	450LPM	NA																																								
NA	40m	NA																																								
NA	Provided	NA																																								
NA	Provided	NA																																								
14.	Captive water Storage for fire fighting:																																									
	<ul style="list-style-type: none"> • Under ground tank capacity ➤ Draw off connection ➤ Fire service inlet ➤ Access to tank • Overhead Tank capacity 	<table border="1"> <tr><td>NA</td><td>50000 ltr</td><td>NA</td></tr> <tr><td>NA</td><td>NA</td><td>MR</td></tr> <tr><td>NA</td><td>NA</td><td>MR</td></tr> <tr><td>NA</td><td>NA</td><td>MR</td></tr> <tr><td>25000 ltrs</td><td>25000 ltr</td><td>MR</td></tr> <tr><td>Required</td><td>Provided</td><td>MR</td></tr> </table>	NA	50000 ltr	NA	NA	NA	MR	NA	NA	MR	NA	NA	MR	25000 ltrs	25000 ltr	MR	Required	Provided	MR																						
NA	50000 ltr	NA																																								
NA	NA	MR																																								
NA	NA	MR																																								
NA	NA	MR																																								
25000 ltrs	25000 ltr	MR																																								
Required	Provided	MR																																								
15	Exit Signage																																									
16.	Provision of Lifts																																									
	<ul style="list-style-type: none"> ➤ Pressurization of Lift Shaft ➤ Pressurization of lift lobby ➤ Communication in lift Car ➤ Fireman's Grounding Switch ➤ Lift Signage 	<table border="1"> <tr><td>NA</td><td>NA</td><td>NA</td></tr> <tr><td>NA</td><td>NA</td><td>NA</td></tr> <tr><td>Required</td><td>Provided</td><td>MR</td></tr> <tr><td>Required</td><td>Provided</td><td>MR</td></tr> <tr><td>Required</td><td>Provided</td><td>MR</td></tr> <tr><td>Required</td><td>DG set 120 KVA</td><td>MR</td></tr> </table>	NA	NA	NA	NA	NA	NA	Required	Provided	MR	Required	Provided	MR	Required	Provided	MR	Required	DG set 120 KVA	MR																						
NA	NA	NA																																								
NA	NA	NA																																								
Required	Provided	MR																																								
Required	Provided	MR																																								
Required	Provided	MR																																								
Required	DG set 120 KVA	MR																																								
17.	Standby power supply																																									
18.	Refuge Area																																									
	<ul style="list-style-type: none"> ➤ Total area ➤ Location 	<table border="1"> <tr><td>NA</td><td>NA</td><td>NA</td></tr> <tr><td>NA</td><td>NA</td><td>NA</td></tr> </table>	NA	NA	NA	NA	NA	NA																																		
NA	NA	NA																																								
NA	NA	NA																																								
19.	Fire control room																																									
	<ul style="list-style-type: none"> ➤ Detector system panel ➤ Flow Switch Panel ➤ PA System Panel ➤ Battery backup ➤ Building Floor Plans 	<table border="1"> <tr><td>NA</td><td>NA</td><td>NA</td></tr> <tr><td>NA</td><td>NA</td><td>NA</td></tr> <tr><td>Required</td><td>Provided</td><td>MR</td></tr> <tr><td>Required</td><td>Provided</td><td>MR</td></tr> <tr><td>Required</td><td>Provided</td><td>MR</td></tr> </table>	NA	NA	NA	NA	NA	NA	Required	Provided	MR	Required	Provided	MR	Required	Provided	MR																									
NA	NA	NA																																								
NA	NA	NA																																								
Required	Provided	MR																																								
Required	Provided	MR																																								
Required	Provided	MR																																								

20.	Special Fire Protection Systems for Protection of special Risks, if any;	Required	CO2 Fire extinguisher provided near electric panel	MR
-----	--	----------	--	----

The fire protection systems provided in the building were test checked and found functional at the time of inspection.

In view of the deemed compliance of minimum standards on fire prevention and fire safety as required under the rules the NOC issued vide letter F6/DFS/MS/School/2018/SZ/514 Dated 27/03/2018 renewal under rule 35 of the Delhi Fire Service Rules 2010 is recommended.

Signature of the Inspecting Officer

Name Uday Vir Singh
 Designation ADCP/DFSS

D/S/W - On leave

Dy SP/SZ
[Signature]
 29/11

G.F.O.

[Signature]
 1/5

[Signature]
 6/5/22

[Signature]

As letter is put up for b/f b/r

[Signature]

[Signature]
 13/12/21



retired on
 03/5