

**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI  
HEAD QUARTERS: DELHI FIRE SERVICE, CONNAUGHT PLACE  
NEW DELHI**

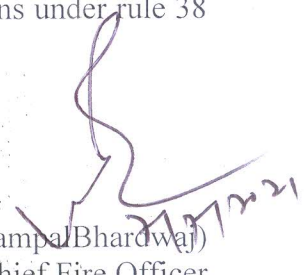
No. F6/DFS/MS/School/WZ/2021/ 451

Dated: 7 / 7 / 2021

**FIRE SAFETY CERTIFICATE**

Certified that the Govt. Sarvodaya kanya Vidyalaya Located at No-2, Shakurpur Delhi-110034 comprised of Total 03 Blocks (One BL=G+ 01 Upper Floor & Two BL=Ground Floor Only) (Except Auditorium) was issued FSC by this department Vide Letter No. F6/DFS/MS/School/WZ/2018/818 Date 24-04-2018. The said premise was re-inspected by the officer concerned of this department on 28.06.2021 in the presence of Mrs. Kamlesh Kumari (Vice Principal) & Sh. Ravinder Kumar Sharma (Estate Manager) and found that the premises / building have deemed complied with the fire prevention and fire safety requirements in accordance D.O.E., GNCT of Delhi, Circular no.3298-3398 dated 01-03-2011 and that the premises/building is fit for occupancy class "Educational Building" Group B with effect from 7/7/21 for a period of three years in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under Rule 40, subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules, 2010, printed overleaf.

Issued on 7/7/21..... at New Delhi by.

  
(Dharampal Bhardwaj)  
Dy. Chief Fire Officer  
(West Zone)

Copy to: -

1. The Director, Directorate of Education, GNCT of Delhi, Old Secretariat Delhi - 110054.
2. The Principal, Govt. Sarvodaya kanya Vidyalaya Located at No-2, Shakurpur Delhi-110034.

## CONDITIONS

1. All the means of escape shall be kept free of all type of obstruction all the time.
2. All the employees shall be acquainted with the use and maintenance of all fire equipments and method of smooth and speedy safe evacuation of occupants in case of emergency.
3. All the fire fighting equipments shall be maintained in perfect working condition all the time and any lapse rendering non-functional if fire safety measures, management shall be responsible.
4. Any deviation, with regards to construction, ventilation, occupation, electric installation etc. may be got verified from the concerned authorities.
5. The Fire Safety Certificate may not be treated in any case for regularizations of unauthorized construction / unauthorized use of land if any.
6. All comments / directions of licensing Department shall always be permitted and followed.
7. The owner /occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rule 2010. The form is available on [www.dfs.delhigovt.nic.in](http://www.dfs.delhigovt.nic.in)
8. The owner / occupier shall apply for renewal of this Fire Safety Certificate to the Director in 'Form J' (sub Rule (1) of Rule 37) along with copy of the certificate, six months prior to its expiry.



1. Name and address of the building:-Govt. Sarvodaya kanya Vidyalaya No. 2, Shakurpur Delhi-110034.
2. Type of Occupancy : Educational Total 03 Blocks(One BL=G+1 Upper Floor & Two BL=Ground Floor Only)
3. Type of Case : Renewal
4. Details of previous NOC : F6/DFS/MS/School/WZ/2018/818 Date 24-04-2018
5. Fire Safety directives Letter No.: DOE Circular no.3298-3398 dated 01-03-2011
6. Date of inspection : 28.06.2021
7. Name of the Inspecting Officer : S.P. Bhardwaj, ADO (WP)
8. Name and designation of Officer  
from the building side : Mrs. Kamlesh Kumari (Vice Principal) & Sh. Ravinder Kumar Sharma (Estate Manager)
9. Year of Construction : Ground Floor Block's, 1959 & G + 03 Upper Floors Block, 2002
10. Applicant's letter No. : Email dated 17.06.2021

| S No | Minimum standards on fire prevention and fire safety U/R 33   | D.O.E, Cr.No.3298-3398 dated 1-3-11/ letter dated 24.04.2018   | Provided at site   | Remarks MR/NMR   |
|------|---|--|--|--|
| 1.   | Access of building  |  |  |  |
|      | <ul style="list-style-type: none"> <li>• Road width</li> <li>• Gate width</li> <li>• Width of internal road</li> </ul>  | <ul style="list-style-type: none"> <li>Accessible</li> <li>Accessible</li> <li>NA</li> </ul>         | <ul style="list-style-type: none"> <li>5.5 m</li> <li>360cm</li> <li>NA</li> </ul>                   | <ul style="list-style-type: none"> <li>MR(Old Case)</li> <li>MR (Old Case)</li> <li>NA</li> </ul>    |
| 2.   | Number, width, Type & Arrangements of exits   |  |  |  |
|      | a. Number of staircases   |  |  |  |
|      | <ul style="list-style-type: none"> <li>• Upper floors</li> <li>• Basements</li> </ul>   | <ul style="list-style-type: none"> <li>2</li> <li>NA</li> </ul>                                      | <ul style="list-style-type: none"> <li>3 Provided (G+01 Block)</li> <li>NA</li> </ul>                | <ul style="list-style-type: none"> <li>MR</li> <li>NA</li> </ul>                                     |
|      | b. Width of staircases  |  |  |  |
|      | <ul style="list-style-type: none"> <li>• Upper floors</li> <li>• Basements</li> </ul>   | <ul style="list-style-type: none"> <li>150cm</li> <li>NA</li> </ul>                                  | <ul style="list-style-type: none"> <li>1x145cm &amp; 2x170cm Provided</li> <li>NA</li> </ul>         | <ul style="list-style-type: none"> <li>MR</li> <li>NA</li> </ul>                                     |
|      | c. Protection of exits  |  |  |  |
|      | <ul style="list-style-type: none"> <li>• Fire check door</li> <li>• Pressurization</li> </ul>   | <ul style="list-style-type: none"> <li>NA</li> <li>NA</li> </ul>                                     | <ul style="list-style-type: none"> <li>NA</li> <li>NA</li> </ul>                                     | <ul style="list-style-type: none"> <li>NA</li> <li>NA</li> </ul>                                     |
|      | d. No of continuous staircase to terrace  | NA   | NA   | MR   |
|      | e. Width Of Corridor  | 1.5 m  | 1.52 m   | MR   |
|      | f. Door Size  | 1 m  | 1.2 m  | MR   |
| 3.   | Compartmentation  |  |  |  |
|      | <ul style="list-style-type: none"> <li>• Fire check door</li> <li>• Sealing of electrical shafts</li> <li>• Fire Rating of shaft door</li> <li>• Water Curtain</li> <li>• Fire Dampers</li> </ul> | <ul style="list-style-type: none"> <li>NA</li> <li>NA</li> <li>NA</li> <li>NA</li> <li>NA</li> </ul> | <ul style="list-style-type: none"> <li>NA</li> <li>NA</li> <li>NA</li> <li>NA</li> <li>NA</li> </ul> | <ul style="list-style-type: none"> <li>NA</li> <li>NA</li> <li>NA</li> <li>NA</li> <li>NA</li> </ul> |
| 4.   | Smoke managements System  |  |  |  |
|      | <ul style="list-style-type: none"> <li>• Basements</li> <li>• Upper floors</li> </ul>   | <ul style="list-style-type: none"> <li>NA</li> <li>NA</li> </ul>                                     | <ul style="list-style-type: none"> <li>NA</li> <li>NA</li> </ul>                                     | <ul style="list-style-type: none"> <li>NA</li> <li>NA</li> </ul>                                     |
| 5.   | Fire Extinguishers  |  |  |  |
|      | <ul style="list-style-type: none"> <li>• Total numbers</li> <li>• Types</li> </ul>  | <ul style="list-style-type: none"> <li>33 nos.</li> <li>ABC &amp; CO<sub>2</sub></li> </ul>          | <ul style="list-style-type: none"> <li>37 Nos.</li> <li>Provided</li> </ul>                          | <ul style="list-style-type: none"> <li>MR</li> <li>MR</li> </ul>                                     |



|     |  |    |    |    |
|-----|--|----|----|----|
| 6.  | First – Aid Hose Reels                       |    |    |    |
|     | • Total numbers on each floor                | NA | NA | NA |
|     | • Length of hose reel hose                   | NA | NA | NA |
|     | • Nozzle diameter                            | NA | NA | NA |
| 7.  | Automatic fire detection and alarming system |    |    |    |
|     | • Type of detectors                          | NA | NA | NA |
|     | • Location of Main Panel                     | NA | NA | NA |
|     | • Location of Repeater Panel                 | NA | NA | NA |
|     | • Alternate source of power                  | NA | NA | NA |
|     | • Hooters' Location                          | NA | NA | NA |
| 8.  | MOEFA  | NA | NA | NA |
| 9.  | Public Address System                        | NA | NA | NA |
| 10. | Automatic Sprinkler System                   |    |    |    |
|     | • Basements                                  | NA | NA | NA |
|     | • Upper Floor                                | NA | NA | NA |
|     | • Sprinkler above false ceiling              | NA | NA | NA |
| 11. | Internal Hydrants:                           |    |    |    |
|     | • Size of riser/down- comer                  | NA | NA | NA |
|     | • Number of hydrants per floor               | NA | NA | NA |
|     | • Hose Box                                   | NA | NA | NA |
| 12. | Yard Hydrants                                |    |    |    |
|     | • Total number of hydrants                   | NA | NA | NA |
|     | • Hose Box                                   | NA | NA | NA |
| 13. | Pumping Arrangements:                        |    |    |    |
|     | • Ground Level                               |    |    |    |
|     | • Discharge of main pump                     | NA | NA | NA |
|     | ➤ Head of main pump                          | NA | NA | NA |
|     | ➤ Number of main pumps                       | NA | NA | NA |
|     | ➤ Jockey pump out put                        | NA | NA | NA |
|     | ➤ Jockey pump head                           | NA | NA | NA |
|     | ➤ Standby Pump out put                       | NA | NA | NA |
|     | ➤ Standby Pump Head                          | NA | NA | NA |
|     | ➤ Auto Staring/Manual stopping               | NA | NA | NA |
|     | ➤ Pump House Access                          | NA | NA | NA |
|     | • Terrace level                              |    |    |    |
|     | ➤ Discharge of pump                          | NA | NA | NA |
|     | ➤ Head of the pump                           | NA | NA | NA |
|     | ➤ Power supply                               | NA | NA | NA |
|     | ➤ Auto starting of pump                      | NA | NA | NA |
| 14. | Captive water Storage for fire fighting:     |    |    |    |
|     | • Under ground tank capacity                 | NA | NA | NA |
|     | ➤ Draw off connection                        | NA | NA | NA |
|     | ➤ Fire service inlet                         | NA | NA | NA |
|     | ➤ Access to tank                             | NA | NA | NA |
|     | • Overhead Tank capacity                     | NA | NA | NA |
| 15  | Exit Signage                                 | NA | NA | NA |
| 16. | Provision of Lifts                           |    |    |    |
|     | ➤ Pressurization of Lift Shaft               | NA | NA | NA |
|     | ➤ Pressurization of lift lobby               | NA | NA | NA |
|     | ➤ Communication in                           | NA | NA | NA |



4-12

|     |  |    |    |    |
|-----|--|----|----|----|
| 17. | Standby power supply   | NA | NA | NA |
| 18. | Refuge Area  |    |    |    |
|     | ➤ Total area   | NA | NA | NA |
|     | ➤ Location   | NA | NA | NA |
| 19. | Fire control room  |    |    |    |
|     | ➤ Detector system panel  | NA | NA | NA |
|     | ➤ Flow Switch Panel  | NA | NA | NA |
|     | ➤ PA System Panel  | NA | NA | NA |
|     | ➤ Battery backup   | NA | NA | NA |
|     | ➤ Building Floor Plans   | NA | NA | NA |
| 20. | Special Fire Protection Systems for Protection of special Risks, if any; | NA | NA | NA |

Fire protection systems provided in the building were checked and found functional at the time of inspection.

**Note:- A New Block comprised of Ground + 03 Upper Floors is under construction & not under consideration.**

In view of the deemed compliance of the minimum standards on fire prevention and fire safety requirements as per D.O.E. Circular no. 3298-3398 dated 01.03.2011, renewal of Fire Safety Certificate issued vide letter no. F6/DFS/MS/School/WZ/2018/818 Date 24-04-2018 is recommended.

S.P. Bhardwaj  
ADO (WP)

~~D/West~~

~~29/6~~

~~DCFO (WZ)~~

~~27/7/2021~~

~~ADOL/WZ~~

FT is part upper floor plan

~~D/West~~  
~~27/7/2021~~

~~6/7/21~~

~~mscell~~

D.O. (WEST)/148  
DATED. 29/06/21