

**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEAD QUARTERS: DELHI FIRE SERVICE: NEW DELHI - 110001**


No F 6/DFS/MS/School/2021 /WZ/ 492

Dated: 15/7/21

FIRE SAFETY CERTIFICATE

Certified that the Raja Ram Mohan Rai Sarvodaya Kanya Vidyalaya, located at Pooth Khurd, Delhi-39. Comprised of total 03 blocks having Ground and first upper floor was granted FSC by this department vide letter No. F-6/DFS/MS/School/2018/WZ/407 dated 13.03.2018. The premises was re-inspected by the officer concerned of this department on 29.06.2021 in the presence of Mrs. Sarita (Vice Principal) and observed that all the fire prevention and fire safety arrangements as provided in the premises found in good working condition. The premises have deemed complied with requirements of circular issued by Director of Education letter no 3298-3398 dated 01.03.2011 and the building/ premise is fit for occupancy Group B Educational with effect from 15/7/21..... for a period of three years, subject to compliance of the conditions mentioned below:

Issued on 15/7/21..... at New Delhi


(Dhrampal Bhardwaj)
Dy.Chief Fire Officer
Tel:-01123414250
MC
14/7/21

Copy to: -

1. The Director, Education, Government of N.C.T of Delhi. Old Sect. Delhi - 54;
2. The Principal Raja Ram Mohan Rai Sarvodaya Kanya Vidyalaya, Pooth Khurd, Delhi-39.,

Conditions for the validity of Fire Safety Certificate:

1. All the fire safety arrangement provided there-in shall be maintained in good working conditions at all times.
2. Loss of life or property due to non functional fire safety measure shall be at the responsibility of the management.
3. The trained fire fighting staff should be available round the clock.
4. Any deviation with regard to the construction etc shall be verified by the concerned building sanctioning agency.
5. This certificate cannot be treated in any case for regularizations of unauthorized construction.
6. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director of Form 'J' [sub rule (1) of rule 37] along with a copy of this Certificate, six months prior to its expiry".
7. The owner / occupier shall submit a declaration every year in form "K" provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on WWW.dfs.Delhigovt.nic.in

INSPECTION REPORT

1. Name & address of the building : Raja Ram Mohan Rai Sarvodaya Kanya Vidyalaya, Pooth Khurd, Delhi-39.
2. Type of Occupancy : Educational
3. Type of Case : Renewal-04 Blocks (G+01 Upper floor)
4. Details of previous NOC : F-6/DFS/MS/School/2018/WZ/407 dated 13.03.2018
5. Fire Safety directives letter No : Director of Education Circular dated 01.03.2011.
6. Date of inspection : 29.06.2021
7. Name of the Inspecting Officers : A.K.Sharma ADO (Rohini)
8. Name and designation of officers from the building side : Mrs. Sarita (Vice Principal)
9. Year of Construction : 1970, 2002-03 & 2014
10. Applicant's letter No. : Online e-mail dated 15.06.2021


	Minimum Standards on fire prevention and fire safety U/R 33	Director. Of Education	Provided at site	Remarks MR/NMR	
1	Access to building				
	<ul style="list-style-type: none"> • Road width • Gate width • Width of internal road 	Accessible	Accessible	MR	
		Accessible	4.50m	MR	
		NA	NA	NA	
2	Number, Width, Type & Arrangement of Exits				
	a. Number of staircases				
	<ul style="list-style-type: none"> • Upper Floors • Basements 	05 NA	06 NA	MR NA	
	b. Width of staircases				
	<ul style="list-style-type: none"> • Upper Floors • Basements 	A block-1.5m Bblock-1.5m C block-1.5mx2 Dblock-1.5m NA	1.5m x 2 1.90m x 01 1.5m x 2 1.5m x 2 NA	MR NA	
	c. Protection of exits				
	<ul style="list-style-type: none"> • Fire check door • Pressurization 	NA NA	NA NA	NA NA	
	d. No. of continuous staircases to terrace	NA	NA	NA	
	e. Width of Corridor	NA	NA	NA	
	f. Door Size	1m	1m&1.10m Double door	MR	
	3	Compartmentation.			
		<ul style="list-style-type: none"> • Fire check door • Sealing of electrical shafts • Fire Rating of shaft door • Water Curtain • Fire Dampers 	NA NA NA NA NA	NA NA NA NA NA	NA NA NA NA NA
Smoke Management System.					
<ul style="list-style-type: none"> • Basements • Upper floors 		30 a/c per hour 12 a/c per hour	NA Natural Ventilated	NA MR	
Fire Extinguishers					
<ul style="list-style-type: none"> • Total numbers 		21nos	24 nos	MR	

	<ul style="list-style-type: none"> Types ISI marking 	ABC/Co2	ABC-17&Co2 -07	MR
		Yes	Provided	MR
6	First-Aid Hose Reels.			
	<ul style="list-style-type: none"> Total numbers on each floor 	NA	NA	NA
	<ul style="list-style-type: none"> Length of hose reel hose 	NA	NA	NA
	<ul style="list-style-type: none"> Nozzle diameter 	NA	NA	NA
7	Automatic fire detection and alarming system.			
	<ul style="list-style-type: none"> Type of detectors 	NA	NA	NA
	<ul style="list-style-type: none"> Location of Main Panel 	NA	NA	NA
	<ul style="list-style-type: none"> Location of Repeater Panel 	NA	NA	NA
	<ul style="list-style-type: none"> Alternate source of power 	NA	NA	NA
	<ul style="list-style-type: none"> Hooters' Location 	NA	NA	NA
8	MOEFA	NA	NA	NA
9	Public Address System.	NA	NA	NA
10	Automatic Sprinkler System.			
	<ul style="list-style-type: none"> Basement 	NA	NA	NA
	<ul style="list-style-type: none"> Upper Floor 	NA	NA	NA
	<ul style="list-style-type: none"> Sprinkler above false ceiling 	NA	NA	NA
11	Internal Hydrants			
	<ul style="list-style-type: none"> Size of riser/down-comer 	NA	NA	NA
	<ul style="list-style-type: none"> Number of hydrants per floor 	NA	NA	NA
	<ul style="list-style-type: none"> Hose Box 	NA	NA	NA
12	Yard Hydrants.			
	<ul style="list-style-type: none"> Total number of hydrants 	NA	NA	NA
	<ul style="list-style-type: none"> Hose Box 	NA	NA	NA
13	Pumping Arrangements.			
	<ul style="list-style-type: none"> Ground Level <ul style="list-style-type: none"> Discharge of main Pump Head of Main pump Number of main pumps Jockey Pump out put Jockey pump head Standby Pump out put Standby Pump Head Auto Starting/ Manual stopping Pump House Access Terrace level <ul style="list-style-type: none"> Discharge of pump Head of the pump Power Supply Auto Starting of pump 	N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA
14	Captive Water Storage for fire fighting.			
	<ul style="list-style-type: none"> Underground tank capacity 	NA	NA	NA
	<ul style="list-style-type: none"> Draw-off connection 	NA	NA	NA
	<ul style="list-style-type: none"> Fire service inlet 	NA	NA	NA
	<ul style="list-style-type: none"> Access to tank 	NA	NA	NA
	<ul style="list-style-type: none"> Overhead Tank capacity 	NA	NA	NA

15	Exit Signage.	NA	NA	NA
16	Provision of Lifts.			
	• Pressurization of Lift Shaft	N/A	N/A	N/A
	• Pressurization of Lift lobby	N/A	N/A	N/A
	• Communication In lift Car	N/A	N/A	N/A
	• Fireman's Grounding Switch	N/A	N/A	N/A
	• Lift Signage	N/A	N/A	N/A
17	Standby power supply	N/A	N/A	N/A
18	Refuge Area.			
	➤ Total Area	N/A	N/A	N/A
	➤ Location	N/A	N/A	N/A
19	Fire Control Room			
	• Detector System Panel	N/A	N/A	N/A
	• Flow Switch Panel	N/A	N/A	N/A
	• PA System Panel	N/A	N/A	N/A
	• Batter backup	N/A	N/A	N/A
	• Building Floor Plans	N/A	N/A	N/A
20	Special Fire Protection Systems for Protection of special Risks, if any:	N/A	N/A	N/A

The fire protection systems provided in the building were test checked randomly and found functional at the time of inspection.



Keeping in view the satisfactory compliance of the minimum standards on fire prevention and fire safety required as stipulated in Director of Education Circular dated 01.03.2011 and the FSC issued vide letter no. F-6/DFS/MS/School/2018/WZ/407 dated 13.03.2018. Renewal under rule 37 of the Delhi Fire Service Rules, 2010 is recommended



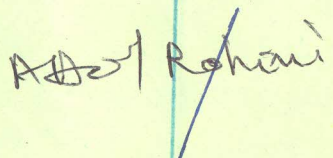
Signature of Inspecting Officer

Name: A. K. Sharma
Designation: ADO (Rohini)


DO (NW)



08/07/2021

DeFO (w2)



12/7/2021


ADO Rohini

FT letter is put up for kind perusal
and signature pls-


DeFO (w2)


14/7/2021


14/7/21

कार का उद्यम