

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE, NEW DELHI-110001


No. F6/DFS/MS/2021/WZ/ 372

Dated: 03/08/2021

FIRE SAFETY CERTIFICATE

Certified that the A-41, Mangol Puri Block-A, Industrial Area, Phase-II, Mangol Puri, Delhi-83, comprised of Ground + Mezzanine + First Floor only owned/occupied by Mr. Anil Wadhawan was issued FSC by this department vide letter No. F.6/DFS/MS/WZ/2018/1001 dated 10.05.2018. The premises was re-inspected by the officer concerned of this department on 23.07.2021 in the presence of Sh. Gaurav Shah and found that the said building have deemed complied with the fire prevention and fire safety requirements in accordance with Rule 33 of the Delhi Fire Service Rules, 2010 and that the premises fit for occupancy class "Business Occupancy" (Bank Chest) in Industrial Building with effect from 03/08/2021 for a period of three years in accordance with Rule 36 unless renewed under Rule 37 or sooner cancelled under Rule 40 and subjected to compliance of the conditions under Rule 38 of the Delhi Fire Service Rules, 2010.

Issued on ...03/08/2021... at New Delhi by


(Dhrampal Bhardwaj)
Dy.Chief Fire Officer
Tel:-01123414250

Copy to :-

1. Sh. Gaurav Shah , A-41, Mangol Puri Block-A, Industrial Area, Phase-II, Mangol Puri, Delhi-83

Conditions for validity of Fire Safety Certificate;

1. All the fire safety arrangement provided there-in shall be maintained in good working conditions at all times.
2. Loss of life or property due to non functional fire safety measure shall be at the responsibility of the management.
2. The trained fire fighting staff should be available round the clock.
3. Any deviation with regard to the construction etc shall be verified by the concerned building sanctioning agency.
4. This certificate cannot be treated in any case for regularizations of unauthorized construction.
5. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director along with a copy of this Certificate, six months prior to its expiry".
6. The owner / occupier shall submit a declaration every year in form "K" provided in the first schedule of Delhi Fire Service Rules 2010. The form "K" is available on http://www.delhi.gov.in/wps/wcm/connect/doit_fire/FIRE/Home/Fire+Safety+Acts+and+Rules/ http://www.delhi.gov.in/wps/wcm/connect/doit_fire/FIRE/Home/Forms

INSPECTION REPORT

1. Name & address of the building : A-41, Mangol Puri Block-A, Industrial Area, Phase-II, Mangol Puri, Delhi-83
2. Type of Occupancy : Business Occupancy in Industrial Building (**Bank Chest (Ground, Mezzanine & 1st floor)**)
3. Type of Case : Renewal
4. Details of Previous NOC : F.6/DFS/MS/WZ/2018/1001 dated 10.05.2018
5. Fire Safety directives letter No : F.6/DFS/MS/BP/2012/711 dated 29.02.2012
6. Date of inspection : 23.07.2021
7. Name of Inspecting Officer : A.K.Sharma ADO(Rohini)
8. Name and designation of officers
From the building side : Sh. Gaurav Shah
9. Year of Construction : 1992
10. Applicant's letter No. : Online e-mail 12.07.2021

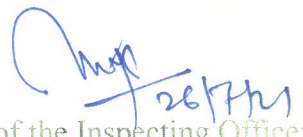
| S. No. | Minimum Standards on fire prevention and fire safety U/R 33 | NBC Part-IV Requirements | Provided at site | Remarks MR/NMR |
|-----------|---|--------------------------|------------------|----------------|
| 1. | Access to building | | | |
| | • Road width | Accessible | Accessible | MR |
| | • Gate width | Accessible | 4.5m | MR |
| | • Width of internal road | NA | NA | NA |
| 2. | Number, Width, Type & Arrangement of Exits | | | |
| | a. Number of staircases | | | |
| | • Upper Floors | 02 | 02 | MR |
| | • Basements | NA | NA | NA |
| | b. Width of staircases | | | |
| | • Upper Floor | 1.25 & 1.5m | 1.25 & 1.5m | MR |
| | • Basements | NA | NA | NA |
| | c. Protection of exits | | | |
| | Fire check door | Required | Provided | MR |
| | • Pressurization | NA | NA | NA |
| | d. No. of continuous staircases to terrace | NA | NA | NA |
| | e. Width of Corridor | 1.5m | 1.5m | MR |
| | f. Door Size | 1.0m | 1.25m | MR |
| 3. | Compartmentation | | | |
| | • Fire check door | Required | Provided | MR |
| | • Sealing of electrical shafts | NA | NA | NA |
| | • Fire Rating of shaft door | NA | NA | NA |
| | • Water Curtain | NA | NA | NA |
| | • Fire Dampers | NA | NA | NA |
| 4. | Smoke Management System | | | |
| | • Basements | 30 a/c per hour | NA | NA |
| | • Upper floors | Required | Provided | MR |
| 5. | Fire Extinguishers | | | |
| | • Total numbers | 06nos. | 06nos. | MR |
| | • Types | ABC/CO2/Wco2 | ABC/CO2/Wco2 | MR |
| | • IS marking | ISI marked | Yes | MR |
| 6. | First-Aid Hose Reels | | | |
| | • Total numbers on each floor | 01 | Provided | MR |
| | • Length of hose reel hose | 30 Mtrs | Provided | MR |
| | • Nozzle diameter | 5 mm | Provided | MR |
| 7. | Automatic fire detection and alarming system | | | |
| | • Type of detectors | NA | Provided | NA |
| | • Location of Main Panel | NA | Provided | NA |
| | • Location of Repeater Panel | NA | NA | NA |


| | | | | |
|-----|---|-----------|-----------|----|
| | <ul style="list-style-type: none"> • Alternate source of power | NA | Provided | NA |
| | <ul style="list-style-type: none"> • Hooters' Location | NA | Provided | NA |
| 8. | MOEFA | NA | NA | NA |
| 9. | Public Address System | NA | NA | NA |
| 10. | Automatic Sprinkler System | | | |
| | <ul style="list-style-type: none"> • Basement | NA | NA | NA |
| | <ul style="list-style-type: none"> • Ground & Upper Floors | Required | Provided | MR |
| | <ul style="list-style-type: none"> • Sprinkler above false ceiling | NA | NA | NA |
| 11. | Internal Hydrants | | | |
| | <ul style="list-style-type: none"> • Size of riser/down-comer | 100mm | Provided | MR |
| | <ul style="list-style-type: none"> • Number of hydrants per floor | 1 | Provided | MR |
| | <ul style="list-style-type: none"> • Hose Box | 1 | Provided | MR |
| 12. | Yard Hydrants | | | |
| | <ul style="list-style-type: none"> • Total number of hydrants | NA | NA | NA |
| | <ul style="list-style-type: none"> • Hose Box | NA | NA | NA |
| 13. | Pumping Arrangements | | | |
| | <ul style="list-style-type: none"> • Ground Level | | | |
| | <ul style="list-style-type: none"> ➤ Discharge of main Pump | NA | NA | NA |
| | <ul style="list-style-type: none"> ➤ Head of Main pump | NA | NA | NA |
| | <ul style="list-style-type: none"> ➤ Number of main pumps | NA | NA | NA |
| | <ul style="list-style-type: none"> ➤ Jockey Pump out put | NA | NA | NA |
| | <ul style="list-style-type: none"> ➤ Jockey pump head | NA | NA | NA |
| | <ul style="list-style-type: none"> ➤ Standby Pump out put | NA | NA | NA |
| | <ul style="list-style-type: none"> ➤ Standby Pump Head | NA | NA | NA |
| | <ul style="list-style-type: none"> ➤ Auto Starting/Manual Stopping | NA | NA | NA |
| | <ul style="list-style-type: none"> ➤ Pump House Access | NA | NA | NA |
| | <ul style="list-style-type: none"> • Terrace level | | | |
| | <ul style="list-style-type: none"> ➤ Discharge of pump | 900lpm | 900lpm | MR |
| | <ul style="list-style-type: none"> ➤ Head of the pump | 40m | 40m | MR |
| | <ul style="list-style-type: none"> ➤ Power Supply | Required | Provided | MR |
| | <ul style="list-style-type: none"> ➤ Auto Starting of pump | Required | Provided | MR |
| 14. | Captive Water Storage for fire fighting | | | |
| | <ul style="list-style-type: none"> • Underground tank capacity | NA | NA | NA |
| | <ul style="list-style-type: none"> ➤ Draw-off connection | NA | NA | NA |
| | <ul style="list-style-type: none"> ➤ Fire service inlet | NA | NA | NA |
| | <ul style="list-style-type: none"> ➤ Access to tank | NA | NA | NA |
| | <ul style="list-style-type: none"> • Overhead Tank capacity | 10,000ltr | 10,000ltr | MR |
| 15. | Exit Signage. | Required | Provided | MR |
| 16. | Provision of Lifts. | | | |
| | <ul style="list-style-type: none"> • Pressurization of Lift Shaft | NA | NA | NA |
| | <ul style="list-style-type: none"> • Pressurization of Lift lobby | NA | NA | NA |
| | <ul style="list-style-type: none"> • Communication In lift Car | NA | NA | NA |
| | <ul style="list-style-type: none"> • Fireman's Grounding Switch | Required | Provided | MR |
| | <ul style="list-style-type: none"> • Lift Signage | Required | Provided | MR |
| 17. | Standby power supply | Required | Provided | MR |
| 18. | Refuge Area. | | | |
| | <ul style="list-style-type: none"> ➤ Total Area | NA | NA | NA |
| | <ul style="list-style-type: none"> ➤ Location | NA | NA | NA |
| 19. | Fire Control Room | | | |
| | <ul style="list-style-type: none"> • Detector System Panel | NA | NA | NA |
| | <ul style="list-style-type: none"> • Flow Switch Panel | NA | NA | NA |
| | <ul style="list-style-type: none"> • PA System Panel | NA | NA | NA |
| | | NA | NA | NA |


| | | | | |
|-----|--|----|----|----|
| | <ul style="list-style-type: none"> Battery backup Building Floor Plans | NA | NA | NA |
| 20. | Special Fire Protection System for Protection of special Risks, if any: | NA | NA | NA |

The fire protection systems provided in the building were test checked and found functional at the time of inspection.

In view of the deemed compliance of the minimum standards of the fire prevention and fire safety measures as required under the rules the NOC issued vide letter no. F.6/DFS/MS/WZ/2018/1001 dated 10.05.2018 is recommended for renewal under rule 37 of the Delhi Fire Service rules 2010.


 Signature of the Inspecting Officer
 Name Ajay Kumar Sharma
 Designation ADO(Rohini)


~~DO (NW)~~

 27/07/2021
 Dy CPO (WZ)



 28/7/2021

~~ms/cell~~

ADO/Rohini

Sir, F.T is put up for your perusal & sig. pls.

~~Dy CPO (WZ)~~

 27/7/2021


 04/08/2021

~~ms/cell~~