

**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI  
HEADQUARTERS: DELHI FIRE SERVICE: NEW DELHI- 110001**


No. F.6/DFS/MS/School/2021/WZ/ 565

Dated:--- 28/7/21

**FIRE SAFETY CERTIFICATE**

Certified that the Nigam Pratibha Vidyalaya, located at Mukherji Park, New Delhi-110018, is comprised of Ground plus One upper floor, having 12 rooms (including class rooms and office etc.) Owned/occupied by SDMC was issued fire safety certificate by this department vide letter No. F.6/DFS/MS/School/2018/SZ/1475 dated 22/06/2018. The premises was re-inspected by officer concern of this department on 14/07/2021 in the presence of Smt. Manoj Bala (Principal) of the school and found that said school building have deemed complied with the fire prevention and fire safety requirements in accordance with the circular No. F.16/Estate/CC/Fire Safety/2011/3298 to 3398 dated 01/03/2011 issued by Director of Education, Govt. of NCT of Delhi, and that the building/premises is fit for occupancy class **"Educational Building"** Group B, **(Except SPS Block)** as above with effect from 28/7/21 for a period of **Three years** and subject to compliance of the conditions mentioned below.

Issued on 28/7/21 at New Delhi by

  
(Dharampal Bhardwaj)  
Dy. Chief Fire Officer  
West Zone

Copy to: -

1. The Principal, Nigam Pratibha Vidyalaya, located at Mukherji Park, New Delhi-110018
2. The Director of Education, Govt. of NCT of Delhi, Old Secretariat, New Delhi.

**Conditions for the validity of Fire Safety Certificate**

1. All the means of escape/entry/exit shall be kept free from any obstruction.
2. All the fire safety arrangements provided therein shall be maintained in good working condition at all time as seen during inspection. Any loss of life or property due to non-functional fire safety measures shall be at the responsibility of the management.
3. All the staff members must know the correct method of operation of firefighting system.
4. This Certificate cannot be treated as regularization of unauthorized construction, if any.
5. The Owner/Occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rules, 2010. The form is available on [www.dfs.delhigovt.nic.in](http://www.dfs.delhigovt.nic.in).
6. The Owner/Occupier shall apply for renewal of this Fire Safety Certificate to the Director in the form 'J' [sub rule (1) of rule 37] along with copy of this certificate, six months prior to its expiry. The form is available on [www.dfs.delhigovt.nic.in](http://www.dfs.delhigovt.nic.in).

## INSPECTION REPORT

1	Name & Address of the Building	Nigam Pratibha Vidyalaya, located at Mukherji Park, New Delhi-110018
2	Type of Occupancy	Educational
3	Building Comprised of	Block -1 is Ground plus one upper floor & Block -2 is SPS (Pota Cabin)
4	Type of Case	Renewal
5	Details of Previous NOC	F.6/DFS/MS/School/2018/SZ/1475 dated 22/06/2018
6	Fire Safety Directives Letter No	DOE Circular dated 01/03/2011
7	Date of Inspection	14/07/2021
8	Name of the Inspecting Officers	ADO Sarabjeet Singh
9	Name & Designation of Officers from the building side	Smt. Manoj Bala (Principal)
10	Year of construction	2010 (As per previous inspection report)
11	Applicant letter No.	Email date 29/06/2021

The School Building complex is having two Blocks Ground + one upper floor and Second Block is a SPS (Pota Cabin). The School is running only in Block one comprised of Ground +1 upper floor

S. No	Minimum standards on Fire Prevention and Fire Safety U/R 33	NBC part-IV Requirements /As per prev. Ins-rep/ dt. 08/06/2018	Provided at Site	Remarks MR/NMR
1	<b>Access to Building.</b>			
	<ul style="list-style-type: none"> <li>Road width</li> </ul>	6 m	Provided	MR
	<ul style="list-style-type: none"> <li>Gate width</li> </ul>	4.5 m	Directly accessible from road	MR
	<ul style="list-style-type: none"> <li>Width of internal road</li> </ul>	-N/A-	-N/A-	-N/A-
2	<b>Number, width, type &amp; arrangement of exits.</b>			
	<b>a) Number of Staircase</b>			
	<ul style="list-style-type: none"> <li>Upper floors</li> </ul>	2	Provided	MR
	<ul style="list-style-type: none"> <li>Basement floor</li> </ul>	-N/A-	-N/A-	-N/A-
	<b>b) Width of Staircase</b>			
	<ul style="list-style-type: none"> <li>Upper floor</li> </ul>	1.50 m	1.50 m x 2	MR
	<ul style="list-style-type: none"> <li>Basement floor</li> </ul>	-N/A-	-N/A-	-N/A-
	<b>c) Protection of exits</b>			
	<ul style="list-style-type: none"> <li>Fire check door</li> </ul>	-N/A-	-N/A-	-N/A-
	<ul style="list-style-type: none"> <li>Pressurization</li> </ul>	-N/A-	-N/A-	-N/A-
	<b>d) No. of continuous staircase to terrace</b>	-N/A-	-N/A-	-N/A-
	<b>e) Width of corridor</b>	1.50 m	2.15 m	MR
	<b>f) Door size</b>	1.0 m	1.14 m (double door)	MR
3	<b>Compartmentation.</b>			
	<ul style="list-style-type: none"> <li>Fire check door.</li> </ul>	-N/A-	-N/A-	-N/A-
	<ul style="list-style-type: none"> <li>Sealing of electrical shafts.</li> </ul>	-N/A-	-N/A-	-N/A-
	<ul style="list-style-type: none"> <li>Fire rating of shaft door.</li> </ul>	-N/A-	-N/A-	-N/A-
	<ul style="list-style-type: none"> <li>Water curtain</li> </ul>	-N/A-	-N/A-	-N/A-
	<ul style="list-style-type: none"> <li>Fire dampers.</li> </ul>	-N/A-	-N/A-	-N/A-
4	<b>Smoke Management system.</b>			
	<ul style="list-style-type: none"> <li>Basement</li> </ul>	-N/A-	-N/A-	-N/A-
	<ul style="list-style-type: none"> <li>Upper floors</li> </ul>	Required	Natural ventilation provided	MR
5	<b>Fire Extinguishers.</b>			
	<ul style="list-style-type: none"> <li>Total numbers</li> </ul>		Provided	MR
	<ul style="list-style-type: none"> <li>Types</li> </ul>		Provided	MR
	<ul style="list-style-type: none"> <li>ISI Marking</li> </ul>	05 nos ABC/CO <sub>2</sub> ISI Marking		MR

6.	<b>First Aid Hose Reels.</b> <ul style="list-style-type: none"> <li>Total numbers on each floor.</li> <li>Length of hose-reel hose.</li> <li>Nozzle Diameter</li> </ul>	-N/A-	-N/A-	-N/A-
		-N/A-	-N/A-	-N/A-
		-N/A-	-N/A-	-N/A-
7	<b>Automatic fire detection &amp; alarming system.</b>			
	<ul style="list-style-type: none"> <li>Type of detectors</li> <li>Location of Main Panel</li> <li>Location of Repeater Panel</li> <li>Alternate source of power</li> <li>Hooter's location</li> </ul>	-N/A-	-N/A-	-N/A-
		-N/A-	-N/A-	-N/A-
		-N/A-	-N/A-	-N/A-
		-N/A-	-N/A-	-N/A-
		-N/A-	-N/A-	-N/A-
8.	<b>MOEFA</b>	-N/A-	-N/A-	-N/A-
9.	<b>Public Address System</b>	-N/A-	-N/A-	-N/A-
10.	<b>Automatic Sprinkler System</b>			
	<ul style="list-style-type: none"> <li>Basement.</li> <li>Upper floors</li> <li>Sprinkler above false ceiling</li> </ul>	-N/A-	-N/A-	-N/A-
		-N/A-	-N/A-	-N/A-
		-N/A-	-N/A-	-N/A-
11.	<b>Internal Hydrants.</b>			
	<ul style="list-style-type: none"> <li>Size of Riser / Down-comer</li> <li>Number of Hydrant per floor</li> <li>Hose box.</li> </ul>	-N/A-	-N/A-	-N/A-
		-N/A-	-N/A-	-N/A-
		-N/A-	-N/A-	-N/A-
12.	<b>Yard Hydrants.</b>			
	<ul style="list-style-type: none"> <li>Total number of hydrants.</li> <li>Hose box.</li> </ul>	-N/A-	-N/A-	-N/A-
		-N/A-	-N/A-	-N/A-
13.	<b>Pumping arrangements.</b>			
	<ul style="list-style-type: none"> <li><b>Ground Level</b></li> <li>Discharge of main pump. <ul style="list-style-type: none"> <li>➤ Head of main pump.</li> <li>➤ Number of main pumps.</li> <li>➤ Jockey Pump output.</li> <li>➤ Jockey Pump head.</li> <li>➤ Standby Pump output.</li> <li>➤ Standby Pump head.</li> </ul> </li> <li>Auto Starting/Manual stopping. <ul style="list-style-type: none"> <li>➤ Pump house access.</li> </ul> </li> <li><b>Terrace Level</b></li> <li>➤ Discharge of pump.</li> <li>➤ Head of pump.</li> <li>➤ Power supply.</li> <li>➤ Auto starting of pump.</li> </ul>	-N/A-	-N/A-	-N/A-
		-N/A-	-N/A-	-N/A-
		-N/A-	-N/A-	-N/A-
		-N/A-	-N/A-	-N/A-
		-N/A-	-N/A-	-N/A-
		-N/A-	-N/A-	-N/A-
		-N/A-	-N/A-	-N/A-
		-N/A-	-N/A-	-N/A-
		-N/A-	-N/A-	-N/A-
		-N/A-	-N/A-	-N/A-
		-N/A-	-N/A-	-N/A-
		-N/A-	-N/A-	-N/A-
		-N/A-	-N/A-	-N/A-
14.	<b>Captive water storage for firefighting.</b>			
	<ul style="list-style-type: none"> <li>Underground tank capacity. <ul style="list-style-type: none"> <li>➤ Draw-off connection.</li> <li>➤ Fire Service Inlet.</li> <li>➤ Access to tank.</li> </ul> </li> <li>Overhead tank capacity.</li> </ul>	-N/A-	-N/A-	-N/A-
		-N/A-	-N/A-	-N/A-
		-N/A-	-N/A-	-N/A-
		-N/A-	-N/A-	-N/A-
		-N/A-	-N/A-	-N/A-
15.	<b>Exit Signage.</b>	-N/A-	-N/A-	-N/A-

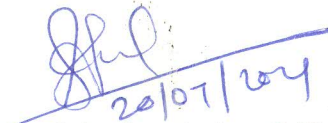
16.	<b>Provision of Lifts.</b>			
	<ul style="list-style-type: none"> <li>• Pressurization of lift shaft.</li> <li>• Pressurization of lift lobby.</li> <li>• Communication in lift car.</li> <li>• Fireman's switch.</li> <li>• Lift signage.</li> </ul>	-N/A-	-N/A-	-N/A-
17	<b>Standby Power Supply</b>	-N/A-	-N/A-	-N/A-
18.	<b>Refuge Area</b>			
	<ul style="list-style-type: none"> <li>• Total area</li> <li>• Location</li> </ul>	-N/A-	-N/A-	-N/A-
19.	<b>Fire Control Room.</b>			
	<ul style="list-style-type: none"> <li>• Detector System Panel.</li> <li>• Flow Switch Panel.</li> <li>• PA system Panel.</li> <li>• Battery backup</li> <li>• Building floor plan</li> </ul>	-N/A-	-N/A-	-N/A-
20.	<b>Special Fire Protection System for the Protection of special Risk, if any.</b>	-N/A-	-N/A-	-N/A-

The fire protection system provided in the building were tested/ checked and found functional at the time of inspection.

Keeping in view the substantial compliance of the minimum standards on fire prevention and fire safety measures as required under the rules, the FSC issued vide letter no. F.6/DFS/MS/School/2018/SZ/1475 dated 22/06/2018, renewal In accordance with the circular no. F.16/Estate/CC/Fire Safety/2011/3298to3398 dated 01/03/2011 issued by the directorate of education is recommended, for Block-1 comprised of Ground + one upper floor only.

Accordingly DFA is put up for approval and signature please.

~~D.O (west)~~  
 D.O (WEST) 147  
 22/07/21  
~~D.O (west)~~  
 DFS (W2)  
 22/07/2021  
 25/07/2021  
 Sir, F.T is put up for your signature pls  
 22/07/2021

  
 Signature of the Inspecting Officer  
 Name : Sarabjeet Singh  
 Designation: ADO (MN)

  
 26/7/2021