

**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI**  
**HEAD QUARTERS: DELHI FIRE SERVICE, CONNAUGHT PLACE**  
**NEW DELHI**



No. F6/DFS/MS/School/2021/WZ/ 623

Dated 19/8/2021

**FIRE SAFETY CERTIFICATE**

Certified that the **Satguru Model School**, Located at **A-2 KeshavPuram, Delhi-110035** comprised of Ground + 01Upper Floors was issued Fire Safety Certificate by this department vide Letter No. F6/DFS/MS/School/2018/708 dated 13.04.2018. The said premises was re-inspected by the officer concerned of this department on 05.08.2021 in the presence of Ms. Manju Vig (Teacher) & Mr. Karan (Accountant) and found that the premises / building have deemed complied with the fire prevention and fire safety requirements in accordance Circular No – 262-362 dated 17-01-2005 and that the premises is fit for occupancy class “Educational” Group B with effect from 19/8/21 for a period of three years, subject to compliance of the conditions, printed overleaf.

Issued on .....19/8/21 at New Delhi by.

  
(Dharampal Bhardwaj)  
Dy. Chief Fire Officer  
(West Zone)  


Copy to:

- 1. Dr. Vinod Garg (Authorized Signatory), Satguru Model School, A-2, KeshavPuram, Delhi-110035.
- 2. The Director, Directorate of Education, GNCT of Delhi, Old Secretariat Delhi – 110054

## CONDITIONS

1. All the means of escape shall be kept free of all type of obstruction all the time.
2. All the employees shall be acquainted with the use and maintenance of all fire equipments and method of smooth and speedy safe evacuation of occupants in case of emergency.
3. All the fire fighting equipments shall be maintained in perfect working condition all the time and any lapse rendering non-functional if fire safety measures, management shall be responsible.
4. Any deviation, with regards to construction, ventilation, occupation, electric installation etc. may be got verified from the concerned authorities.
5. The Fire Safety Certificate may not be treated in any case for regularizations of unauthorized construction / unauthorized use of land if any.
6. All comments / directions of licensing Department shall always be permitted and followed.
7. The owner / occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rule 2010. The form is available on [www.dfs.delhigovt.nic.in](http://www.dfs.delhigovt.nic.in)
8. The owner / occupier shall apply for renewal of this Fire Safety Certificate to the Director in 'Form J' (sub Rule (1) of Rule 37) along with copy of the certificate, six months prior to its expiry.

2. Type of Occupancy : Educational (Ground + 1 Upper Floor)
3. Type of Case : Renewal
4. Details of previous NOC : F6/DFS/MS/School/2018/708 dated 13.04.2018
5. Fire Safety directives Letter No. : Circular No – 262-362 dated 17-01-2005
6. Date of inspection : 05.08.2021
7. Name of the Inspecting Officer : S.P. Bhardwaj, ADO (WP)
8. Name and designation of Officer  
from the building side : Ms. Manju Vig (Teacher) & Sh. Karan (Accountant)
9. Year of Construction : 2002
10. Applicant's letter No. : email dated 27.07.2021

S No	Minimum standards on fire prevention and fire safety U/R 33	Cr. No. 262-362 dated 17-01-2005/letter dated 13.04.2018	Provided at site	Remarks MR/NMR
1.	Access of building			
	<ul style="list-style-type: none"> <li>Road width</li> <li>Gate width</li> <li>Width of internal road</li> </ul>	<ul style="list-style-type: none"> <li>Accessible</li> <li>Accessible</li> <li>NA</li> </ul>	<ul style="list-style-type: none"> <li>Provided</li> <li>314cm Provided</li> <li>NA</li> </ul>	<ul style="list-style-type: none"> <li>MR</li> <li>MR</li> <li>NA</li> </ul>
2.	Number, width, Type & Arrangements of exits			
	a. Number of staircases			
	<ul style="list-style-type: none"> <li>Upper floors</li> <li>Basements</li> </ul>	<ul style="list-style-type: none"> <li>1</li> <li>NA</li> </ul>	<ul style="list-style-type: none"> <li>2</li> <li>NA</li> </ul>	<ul style="list-style-type: none"> <li>MR</li> <li>NA</li> </ul>
	b. Width of staircases			
	<ul style="list-style-type: none"> <li>Upper floors</li> <li>Basements</li> </ul>	<ul style="list-style-type: none"> <li>1x150cm</li> <li>NA</li> </ul>	<ul style="list-style-type: none"> <li>1x150cm 1x125cm</li> <li>NA</li> </ul>	<ul style="list-style-type: none"> <li>MR</li> <li>NA</li> </ul>
	c. Protection of exits			
	<ul style="list-style-type: none"> <li>Fire check door</li> <li>Pressurization</li> </ul>	<ul style="list-style-type: none"> <li>NA</li> <li>NA</li> </ul>	<ul style="list-style-type: none"> <li>NA</li> <li>NA</li> </ul>	<ul style="list-style-type: none"> <li>NA</li> <li>NA</li> </ul>
	d. No of continuous staircase to terrace	NA	NA	NA
	e. Width Of Corridor	NA	183cm	NA
	f. Door Size	1x100cm	Provided	MR
3.	Compartmentation			
	<ul style="list-style-type: none"> <li>Fire check door</li> <li>Sealing of electrical shafts</li> <li>Fire Rating of shaft door</li> <li>Water Curtain</li> <li>Fire Dampers</li> </ul>	<ul style="list-style-type: none"> <li>NA</li> <li>NA</li> <li>NA</li> <li>NA</li> <li>NA</li> </ul>	<ul style="list-style-type: none"> <li>NA</li> <li>NA</li> <li>NA</li> <li>NA</li> <li>NA</li> </ul>	<ul style="list-style-type: none"> <li>NA</li> <li>NA</li> <li>NA</li> <li>NA</li> <li>NA</li> </ul>
4.	Smoke managements System			
	<ul style="list-style-type: none"> <li>Basements</li> <li>Upper floors</li> </ul>	<ul style="list-style-type: none"> <li>NA</li> <li>NA</li> </ul>	<ul style="list-style-type: none"> <li>NA</li> <li>NA</li> </ul>	<ul style="list-style-type: none"> <li>NA</li> <li>NA</li> </ul>
5.	Fire Extinguishers			
	<ul style="list-style-type: none"> <li>Total numbers</li> <li>Types</li> <li>IS marking</li> </ul>	<ul style="list-style-type: none"> <li>04nos.</li> <li>ABC &amp; CO<sub>2</sub></li> <li>ISI marked</li> </ul>	<ul style="list-style-type: none"> <li>Provided</li> <li>Provided</li> <li>Provided</li> </ul>	<ul style="list-style-type: none"> <li>MR</li> <li>MR</li> <li>MR</li> </ul>
6.	First – Aid Hose Reels			
	<ul style="list-style-type: none"> <li>Total numbers on each floor</li> <li>Length of hose reel hose</li> </ul>	<ul style="list-style-type: none"> <li>01</li> <li>30 mtrs</li> </ul>	<ul style="list-style-type: none"> <li>Provided</li> <li>Provided</li> </ul>	<ul style="list-style-type: none"> <li>MR</li> <li>MR</li> </ul>

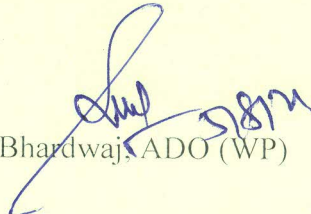
	<ul style="list-style-type: none"> <li>Type of detectors</li> <li>Location of Main Panel</li> <li>Location of Repeater Panel</li> <li>Alternate source of power</li> <li>Hooters' Location</li> </ul>	NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA
8.	MOEFA	NA	NA	NA
9.	Public Address System	NA	NA	NA
10.	Automatic Sprinkler System			
	<ul style="list-style-type: none"> <li>Basements</li> </ul>	NA	NA	NA
	<ul style="list-style-type: none"> <li>Upper Floor</li> </ul>	NA	NA	NA
	<ul style="list-style-type: none"> <li>Sprinkler above false ceiling</li> </ul>	NA	NA	NA
11.	Internal Hydrants:			
	<ul style="list-style-type: none"> <li>Size of riser/down-comer</li> </ul>	NA	Provided	NA
	<ul style="list-style-type: none"> <li>Number of hydrants per floor</li> </ul>	NA	Provided	NA
	<ul style="list-style-type: none"> <li>Hose Box</li> </ul>	NA	Provided	NA
12.	Yard Hydrants			
	<ul style="list-style-type: none"> <li>Total number of hydrants</li> </ul>	NA	NA	NA
	<ul style="list-style-type: none"> <li>Hose Box</li> </ul>	NA	NA	NA
13.	Pumping Arrangements:			
	<ul style="list-style-type: none"> <li>Ground Level</li> </ul>			
	<ul style="list-style-type: none"> <li>Discharge of main pump</li> </ul>	NA	NA	NA
	<ul style="list-style-type: none"> <li>Head of main pump</li> </ul>	NA	NA	NA
	<ul style="list-style-type: none"> <li>Number of main pumps</li> </ul>	NA	NA	NA
	<ul style="list-style-type: none"> <li>Jockey pump out put</li> </ul>	NA	NA	NA
	<ul style="list-style-type: none"> <li>Jockey pump head</li> </ul>	NA	NA	NA
	<ul style="list-style-type: none"> <li>Standby Pump out put</li> </ul>	NA	NA	NA
	<ul style="list-style-type: none"> <li>Standby Pump Head</li> </ul>	NA	NA	NA
	<ul style="list-style-type: none"> <li>Auto Starting/Manual stopping</li> </ul>	NA	NA	NA
	<ul style="list-style-type: none"> <li>Pump House Access</li> </ul>	NA	NA	NA
	<ul style="list-style-type: none"> <li>Terrace level</li> </ul>			
	<ul style="list-style-type: none"> <li>Discharge of pump</li> </ul>	220LPM	Provided	MR (Old Case)
	<ul style="list-style-type: none"> <li>Head of the pump</li> </ul>	40 mtrs	Provided	MR
	<ul style="list-style-type: none"> <li>Power supply</li> </ul>	Required	Provided	MR
	<ul style="list-style-type: none"> <li>Auto starting of pump</li> </ul>	Required	Provided	MR
14.	Captive water Storage for fire fighting:			
	<ul style="list-style-type: none"> <li>Under ground tank capacity</li> </ul>	NA	NA	NA
	<ul style="list-style-type: none"> <li>Draw off connection</li> </ul>	NA	NA	NA
	<ul style="list-style-type: none"> <li>Fire service inlet</li> </ul>	NA	NA	NA
	<ul style="list-style-type: none"> <li>Access to tank</li> </ul>	NA	NA	NA
	<ul style="list-style-type: none"> <li>Overhead Tank capacity</li> </ul>	2500Ltrs	Provided	MR
15	Exit Signage	Required	Provided	MR
16.	Provision of Lifts			
	<ul style="list-style-type: none"> <li>Pressurization of Lift Shaft</li> </ul>	NA	NA	NA
	<ul style="list-style-type: none"> <li>Pressurization of lift lobby</li> </ul>	NA	NA	NA
	<ul style="list-style-type: none"> <li>Communication in lift Car</li> </ul>	NA	NA	NA
	<ul style="list-style-type: none"> <li>Fireman's Grounding Switch</li> </ul>	NA	NA	NA

17.	Standby power supply	NA	NA	NA
18.	Refuge Area			
	➤ Total area	NA	NA	NA
	➤ Location	NA	NA	NA
19.	Fire control room			
	➤ Detector system panel	NA	NA	NA
	➤ Flow Switch Panel	NA	NA	NA
	➤ PA System Panel	NA	NA	NA
	➤ Battery backup	NA	NA	NA
	➤ Building Floor Plans	NA	NA	NA
20.	Special Fire Protection Systems for Protection of special Risks, if any;	NA	NA	NA

The fire protection systems provided in the building were checked and found functional at the time of inspection.

In view of the deemed compliance of minimum standards on fire prevention and fire safety as requirements as per D.O.E Cr. No. 262-362 dated 17.01.2005, renewal of Fire Safety Certificate issued vide letter no. F6/DFS/MS/School/2018/708 dated 13.04.2018 is recommended.

D.O. (WEST)/185  
DATED. 09/08/21

  
S.P. Bhardwaj, ADO (WP)

~~D.O. (WEST)~~

~~DFS (W2)~~  
9/8


  
11/8/2021

~~ADO (WEST)~~

FT is put up for sanction for

~~DFS (W2)~~

  
18/8/2021

  
16/8/21

~~MS/CELL~~