

c-25

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE: NEW DELHI-110001

No. F.6/DFS/MS/EH/2021/SZ/ 186

Dated: 16/08/2021

FIRE SAFETY CERTIFICATE

Certified that the Eating House in the name & style of M/s **Liv Bar** (A Unit of Delhi Lounge & Bar Pvt. Ltd) at Shop No-R3, Lower Ground Floor, Worldmark-I, Aerocity, New Delhi-110037, comprised of Three Tiers Basement, Ground, Mezzanine & Six Upper Floors but the restaurant running at lower ground floor only was issued Fire Safety Certificate by this department vide letter No F.6/DFS/MS/EH/2018/SZ/1698 dated 20/07/2018 in the name & style of M/s **Carbon** (A Unit of Delhi Lounge & Bar Pvt. Ltd). The premise was re-inspected by the officer concerned of this department on 13/08/2021 in the presence of Mr. Ravinder (Manager) and found that the said premises have deemed complied with the fire prevention and fire safety requirements in accordance with Rule 33 of the Delhi Fire Service Rules, 2010 and that the said premises is fit for occupancy class "**Group-D Assembly**" with effect from 16/8/2021 for a period of **Three years** in accordance with Rule 36 unless renewed under Rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under Rule 38 of the Delhi Fire Service Rules, 2010.

Issued on 16/8/2021 at New Delhi by



(Sunil Chawdhary)
Dy. Chief Fire Officer (SZ)
Delhi Fire Service

Copy to: -

1. The Dy. Health Officer, South Delhi Municipal Corporation, Public Health Department, Najafgarh Zone, Dhansa Stand, Najafgarh, New Delhi-110043
2. Authorized Signatory, M/s Liv Bar (A Unit of Delhi Lounge & Bar Pvt. Ltd), Shop No-R3, Lower Ground Floor, Worldmark-I, Aerocity, New Delhi-110037

Conditions for the validity of Fire Safety Certificate: -

1. All the means of escape/entry/exit shall be kept free from any obstruction.
2. All the fire safety arrangements provided therein shall be maintained in good working condition at all time as seen during inspection. Any loss of life or property due to non-functional fire safety measures shall be at the responsibility of the management.
3. All the staff members must know the correct method of operation of fire-fighting system.
4. The owner/occupier shall submit a declaration every year in Form 'K' provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on www.dfs.delhigovt.nic.in
5. This fire safety certificate may not in any way be treated as regularization (Clause 2.8 of UBBL-2016) of unauthorized construction or alteration (Clause 1.4.3 of UBBL-2016), if any.
6. "The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in Form 'J' [sub rule (1) of rule 37] along with a copy of this Certificate, six months prior to its

INSPECTION REPORT

1	Name & Address of the Building	M/s Liv Bar (A Unit of Delhi Lounge & Bar Pvt. Ltd) at Shop No-R3, Lower Ground Floor, Worldmark-I, Aerocity, New Delhi-110037		
2	Type of Occupancy	Assembly "Group-D" (Restt. at Lower Ground Floor)		
3	Building comprised of	03 tiers basement, ground, mezzanine & 06 UFs.		
4	Type of Case	Renewal		
5	Details of Previous NOC	F.6/DFS/MS/EH/2018/SZ/1698 dated 20/07/2018		
6	Fire Safety Directives Letter No	Nil		
7	Date of Inspection	13/08/2021		
8	Name of the Inspecting Officers	DO (SD)		
9	Name & Designation of Officers from the building side	Mr. Ravinder (Manager)		
10	Year of construction	2014		
11	Applicant letter No.	Online ID-2021062314160 dated 03/08/2021		
S. No.	Minimum standards on Fire Prevention and Fire Safety U/R 33	Old FSC Requirement	Provided at Site	Remarks MR/NMR
1	Access to Building.	F.6/DFS/MS/Mixed/SZ/2021/09 dated 08/03/2021		
	• Road width	Restt within	As above	MR
	• Gate width	Worldmark-1,	As above	-NA-
	• Width of internal road	Aerocity	As above	-NA-
2	Number, width, type & arrangement of exits			
	a. Number of Staircase	Provided & Maintained by Bldg. Management		
	• Upper floors	-NA-	As above	-NA-
	• Basement floor	-NA-	As above	-NA-
	b. Width of Staircase	Provided & Maintained by Bldg. Management		
	• Upper floors	-NA-	As above	-NA-
	• Basement floor	-NA-	As above	-NA-
	c. Protection of exits	Provided & Maintained by Bldg. Management		
	• Fire check door	-NA-	As above	-NA-
	• Pressurization	-NA-	As above	-NA-
	d. No. of continuous staircase to terrace	Required	As above	MR
	e. Width of corridor	-NA-	-NA-	-NA-
	f. Door size	2 exits	1.40m & 2.80m	MR
3	Compartmentation.	Provided & Maintained by Bldg. Management		
	• Fire check door.	-NA-	As above	-NA-
	• Sealing of electrical shafts.	-NA-	As above	-NA-
	• Fire rating of shaft door.	-NA-	As above	-NA-
	• Water curtain	-NA-	As above	-NA-
	• Fire dampers.	-NA-	As above	-NA-
4	Smoke Management system.	Provided & Maintained by Bldg. Management		
	• Basement	-NA-	As above	N/A
	• Upper floor / Restt. Area	Required	Exhaust fan provided	MR
5	Fire Extinguishers.			
	• Total numbers	06 Nos.	Provided	MR
	• Types	ABC / CO ₂	ABC & CO ₂	MR
	• ISI Marking	ISI marked	Provided	MR
6	First Aid Hose Reels.	Provided & Maintained by Bldg. Management		
	• Total numbers on each floor.	One	One near Restt.	MR
	• Length of hose-reel hose.	30m	Provided	MR
	• Nozzle Diameter	5mm	Provided	MR


		(Provided & Maintained by Bldg. Management)		
7	Automatic fire detection & alarming system.			
	<ul style="list-style-type: none"> Type of detectors Location of Main Panel Location of Repeater Panel Alternate source of power Hoofer's location 	-NA-	Smoke & Heat	-NA-
		-NA-	Mezzanine floor	-NA-
		-NA-	FCR at GF	-NA-
		-NA-	Provided	-NA-
		-NA-	All area	-NA-
8	MOEFA	Required	Provided	MR
9	Public Address System	-NA-	-NA-	-NA-
10	Automatic Sprinkler System	Provided & Maintained by Bldg. Management		
	<ul style="list-style-type: none"> Basement Upper floors / Restt. Area Sprinkler above false ceiling 	-NA-	As above	-NA-
		-NA-	As above	-NA-
		-NA-	As above	-NA-
11	Internal Hydrants.	Provided & Maintained by Bldg. Management		
	<ul style="list-style-type: none"> Size of Riser/Down-comer Number of Hydrant per floor Hose box. 	-NA-	As above	-NA-
		-NA-	As above	-NA-
		-NA-	As above	-NA-
12	Yard Hydrants.	Provided & Maintained by Bldg. Management		
	<ul style="list-style-type: none"> Total number of hydrants. Hose box. 	-NA-	As above	-NA-
		-NA-	As above	-NA-
13	Pumping arrangements.	Provided & Maintained by Bldg. Management		
	<ul style="list-style-type: none"> Ground Level <ul style="list-style-type: none"> Discharge of main pump. Head of main pump. Number of main pumps. Jockey Pump output. Jockey Pump head. Standby Pump output. Standby Pump head. Auto Starting / Manual Stopping. Pump House Access Terrace Level <ul style="list-style-type: none"> Discharge of pump. Head of pump. Power supply. Auto starting of pump. 	-NA-	2280 LPM	-NA-
		-NA-	105m	-NA-
		-NA-	Two	-NA-
		-NA-	2 x 180 LPM	-NA-
		-NA-	105m	-NA-
		-NA-	2280 LPM	-NA-
		-NA-	105m.	-NA-
		-NA-	Provided	-NA-
		-NA-	Provided	-NA-
		450 LPM	As above	MR
		40m	As above	MR
		Required	As above	MR
		Required	As above	MR
14	Captive water storage for Fire Fighting.	Provided & Maintained by Bldg. Management		
	<ul style="list-style-type: none"> Underground tank capacity. <ul style="list-style-type: none"> Draw-off connection. Fire Service Inlet. Access to tank. Overhead tank capacity. 	-NA-	1,50,000 Ltrs.	-NA-
		-NA-	Provided	-NA-
		-NA-	Provided	-NA-
		-NA-	Provided	-NA-
		5,000 Ltrs	20,000 Ltrs	MR
		Required	Provided	MR
15	Exit Signage.	Provided & Maintained by Bldg. Management		
16	Provision of Lifts.	Provided & Maintained by Bldg. Management		
	<ul style="list-style-type: none"> Pressurization of lift shaft. Pressurization of lift lobby. Communication in lift car. Fireman's switch. Lift signage. 	-NA-	As above	-NA-
		-NA-	As above	-NA-
		-NA-	As above	-NA-
		-NA-	As above	-NA-
		-NA-	As above	-NA-
17	Standby Power Supply	Required	As above	MR

18	Refuge Area	Provided & Maintained by Bldg. Management		
	• Total area	-NA-	-NA-	-NA-
	• Location	-NA-	-NA-	-NA-
19	Fire Control Room.	Provided & Maintained by Bldg. Management		
	• Detector System Panel.	-NA-	As above	-NA-
	• Flow Switch Panel.	-NA-	As above	-NA-
	• PA system Panel.	-NA-	As above	-NA-
	• Battery backup	-NA-	As above	-NA-
	• Building floor plan	-NA-	As above	-NA-
20	Special Fire Protection System for the Protection of special Risk, if any :	-NA-	As above	-NA-


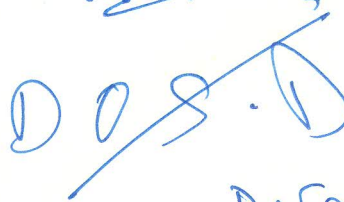
The Fire protection systems provided in the building were test checked and found functional at the time of inspection. The main building (M/s Aspen Buildtech Limited at Asset No. 11, Hospitality District, Aerocity, IGI Airport, New Delhi) has already been issued Fire Safety Certificate vide this department letter No. F.6/DFS/MS/Mixed/SZ/2021/09 dated 08/03/2021.

Keeping in view of the deemed compliance of the minimum standards on fire prevention and fire safety measures as required under the rules, the fire safety certificated issued by this department vide letter No. F.6/DFS/MS/EH/2018/SZ/1698 dated 20/07/2018 issued in the name of M/s Carbon (A Unit of Delhi Lounge & Bar Pvt. Ltd), renewal under Rule 37 of the Delhi Fire Service Rules, 2010 is recommended.

Accordingly, DFA is put up for approval and signature please.


 Signature of the Inspecting Officer
 Name : S.K. Dua
 Designation: DO (SD)

Dy. CFO (SZ)

F.T. please.


 DeFO (SZ)
 M.S. cell

F.T. letter is put up for sign.
