

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE: CONNAUGHT PLACE
NEW DELHI-110 001

No.F.6/DFS/MS/School/2021/SZ/ 734

Dated: 9/9/21

FIRE SAFETY CERTIFICATE

Certified that the **Raghubir Singh Modern School**, L-2, Mohan Garden, New Delhi-110059 comprised of ground floor plus three upper floors, owned/occupied by Raghubir Singh Modern School was issued Fire Safety Certificate by this department vide letter no. F.6/DFS/MS/School/2018SZ/2130 dated 19/09/2018. The School building was re-inspected by the officer concerned of this department on 04/09/2021 in the presence of Sh. Rajiv Tyagi (Manager) and found that School building have deemed complied with the fire prevention and fire safety requirements in accordance with rule 33 of the Delhi Fire Service Rules, 2010 and that the building/ premises is fit for occupancy class educational w.e.f. the date of issue of this certificate for a period of three years in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under rule-38 of the Delhi Fire Service Rules, 2010 printed as below.

Issued on..... 9/9/21..... at New Delhi.


(SUNIL CHAUDHARY)
DY.CHIEF FIRE OFFICER

Copy to:-

1. The Manager,
Raghubir Singh Modern School,
L-2, Mohan Garden, New Delhi-110059
2. Director of Education,
Govt. of NCT of Delhi, Old Secretariat,
New Delhi – 110054

Following fire safety directives must be adhered to:-

1. All the fire safety arrangements provided therein shall be maintained in good working condition at all times.
2. The means of escape shall be kept unlocked and unobstructed for unhindered evacuation of occupants in case of emergency.
3. Any loss of life or property due to non-functional fire safety measures shall be at the risk and responsibility of the management.
4. The trained staff should be available round the clock.
5. Any deviations w.r.t. construction shall be verified by the concerned building sanctioning agency.
6. The certificate may not be treated in any case for the regularization of the unauthorized construction, if any.
7. The owner/occupier shall submit a declaration every year in the form 'K' provided in the first schedule of Delhi Fire Service Rules 2010, form is available on www.dfs.delhigovt.nic.in.
8. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in the Form 'J' [sub rule (1) of rule 37] along with a copy of this Certificate, six months prior to its expiry.

INSPECTION REPORT

1. Name & address of the building : Raghbir Singh Modern School, L-2, Mohan Garden, New Delhi-59
2. Building comprised of : G+3 Upper floors
3. Type of Occupancy : Educational
4. Type of Case : Renewal
5. Details of Previous NOC : F.6/DFS/MS/School/2018/SZ/2130 dated 19/09/2018
6. Fire Safety directives letter No : N/A
7. Date of inspection : 04/09/2021
8. Name of Inspecting Officer : A.D.O. R.K.Yadav
9. Name and designation of officers
From the building side : Sh. Rajiv Tyagi (Manager)
10. Year of Construction : 1997 to 2015
11. Applicant's letter No. : RSMS/CFO/DFS08/21/1373 dated 19.08.2021


S. No.	Minimum Standards on fire prevention and fire safety U/R 33	Requirement	Provided at site	Remarks MR/NMR
1.	Access to building			
	<ul style="list-style-type: none"> • Road width • Gate width • Width of internal road 	Accessible 06 mtrs 4.5 mtrs N/A	Provided 03 mtrs N/A	MR MR, being old case N/A
2.	Number, Width, Type & Arrangement of Exits			
	a. Number of staircases			
	<ul style="list-style-type: none"> • Upper Floors • Basements 	03 No's N/A	03 No's N/A	MR N/A
	b. Width of staircases			
	<ul style="list-style-type: none"> • Upper Floor • Basements 	1.5m/additional staircase of .75 m if less than 1.5 m N/A	1.57, 1.50-1.42 & 1.28-1.24 m N/A	MR, being old case N/A
	c. Protection of exits			
	<ul style="list-style-type: none"> • Fire check door • Pressurization 	N/A N/A	N/A N/A	N/A N/A
	d. No. of continuous staircases to terrace	Required	Two	MR
	e. Width of Corridor	1.50 m	1.85 m	MR
	f. Door Size	1.0 m	1.0 m	MR
3.	Compartmentation			
	<ul style="list-style-type: none"> • Fire check door • Sealing of electrical shafts • Fire Rating of shaft door • Water Curtain • Fire Dampers 	N/A N/A N/A N/A N/A	N/A N/A N/A N/A N/A	N/A N/A N/A N/A N/A
4.	Smoke Management System			
	<ul style="list-style-type: none"> • Basements 	N/A	N/A	N/A
	<ul style="list-style-type: none"> • Upper floors 	Required	Natural ventilation	MR
5.	Fire Extinguishers			
	<ul style="list-style-type: none"> • Total numbers on each floor • Types • IS marking 	04 no.'s ABC/CO ₂ type ISI marked	Provided Provided ISI marked	MR MR MR

6.	First-Aid Hose Reels			
	<ul style="list-style-type: none"> Total numbers on each floor Length of hose reel hose Nozzle diameter 	02 no.'s	Provided	MR
		30 mtrs	Provided	MR
		5 mm	Provided	MR
7.	Automatic fire detection and alarming system			
	<ul style="list-style-type: none"> Type of detectors Location of Main Panel Location of Repeater Panel Alternate source of power Hooters' Location 	N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
8.	MOEFA			
9.	Public Address System			
		N/A	N/A	N/A
10.	Automatic Sprinkler System			
	<ul style="list-style-type: none"> Basement Ground Floor Sprinkler above false ceiling 	N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
11.	Internal Hydrants			
	<ul style="list-style-type: none"> Size of riser/down-comer Number of hydrants per floor Hose Box 	N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
12.	Yard Hydrants			
	<ul style="list-style-type: none"> Total number of hydrants Hose Box 	N/A	N/A	N/A
		N/A	N/A	N/A
13.	Pumping Arrangements			
	<ul style="list-style-type: none"> Ground Level <ul style="list-style-type: none"> Discharge of main Pump Head of Main pump Number of main pumps Jockey Pump out put Jockey pump head Standby Pump out put Standby Pump Head Auto Starting/Manual Stopping Pump House Access Terrace level <ul style="list-style-type: none"> Discharge of pump Head of the pump Power Supply Auto Starting of pump 	N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		450 LPM	Provided	MR
		30 mtrs	Provided	MR
	Required	Provided	MR	
	Required	Provided	MR	
14.	Captive Water Storage for fire fighting			
	<ul style="list-style-type: none"> Underground tank capacity <ul style="list-style-type: none"> Draw-off connection Fire service inlet Access to tank Overhead Tank capacity 	N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
15.	Exit Signage.			
	10,000 ltrs	Provided	MR	
	Required	Provided	MR	

16.	Provision of Lifts.	No Lift		
	• Pressurization of Lift Shaft	N/A	N/A	N/A
	• Pressurization of Lift lobby	N/A	N/A	N/A
	• Communication In lift Car	N/A	N/A	N/A
	• Fireman's Grounding Switch	N/A	N/A	N/A
	• Lift Signage	N/A	N/A	N/A
17.	Standby power supply	N/A	N/A	N/A
18.	Refuge Area.			
	➤ Total Area	N/A	N/A	N/A
	➤ Location	N/A	N/A	N/A
19.	Fire Control Room			
	• Detector System Panel	N/A	N/A	N/A
	• Flow Switch Panel	N/A	N/A	N/A
	• PA System Panel	N/A	N/A	N/A
	• Battery backup	N/A	N/A	N/A
	• Building Floor Plans	N/A	N/A	N/A
20.	Special Fire Protection System for Protection of special Risks, if any:	N/A	N/A	N/A

The fire protection systems provided in the building were tested, checked and found functional at the time of inspection.

In view of the deemed compliance of the minimum standards of fire prevention and fire safety measures as required under the rules the FSC issued vide letter number F.6/DFS/MS/School/2018/SZ/2130 dated 19.09.2018 renewal under rule 37 of the Delhi Fire Service Rules 2010 is recommended.





Signature of Inspecting Officer

Name:- R.K. Yadav

Designation:- Asstt. Divisional Officer

D.O. (South West)


 07/10/2021
 D.Y. Choudhary (S.S.)

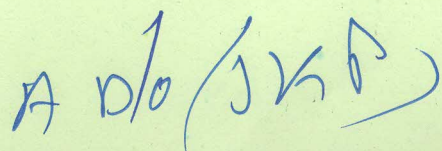

F.T. Letter a but rule for spec. Meas