

C-31

**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI  
HEADQUARTERS: DELHI FIRE SERVICE, NEW DELHI-110001**

No. F6/DFS/MS/2021/School/WZ/ **784**

Dated: **27/9/21**

**FIRE SAFETY CERTIFICATE**

Certified that the **Govt. Girl Senior Secondary School, BC-Block, Sultan Puri, Delhi-86**, comprised of **03 Blocks, Ground + 01 upper floor & Ground + Three upper floor & 01 hall ground floor only** owned/occupied by **Govt. Girl Senior Secondary School**, has already been issued FSC by this department vide letter No. **F.6/DFS/MS/2019/WZ/114 dated 16.01.2019 (Gr.+3) & F.6/DFS/MS/School/2017/WZ/1298 dated 28.08.2017 (Gr.+1)**. The premises was re-inspected by the officer concerned of this department on **09.09.2021** in the presence of **Smt. Anita Dixit (Head of School)** and observed that all the fire prevention and fire safety arrangements as provided in the premise found in good working condition. The premises have therefore deemed complied with the requirements under Rule 33 of the Delhi Fire Service Rules, 2010 and that the premises fit for occupancy under **Educational "Group B"** with effect from **27/9/21** for a period of **three years** in accordance with Rule 36 unless renewed under Rule 37 or sooner cancelled under Rule 40 and subjected to compliance of the conditions under Rule 38 of the Delhi Fire Service Rules, 2010

Issued on ....**27/9/21**..... at New Delhi by

**(Dhrampal Bhardwaj)**  
**Dy.Chief Fire Officer**  
**Tel:-01123414250**

**27/9/2021**  
**OK**  
**NY**

Copy to :-

1. The Principal, Govt. Girl Senior Secondary School, BC-Block, Sultan Puri, Delhi-86.
2. The Director of Education, GNCT of Delhi Old Secretariat, Delhi-110054

**Conditions for validity of Fire Safety Certificate;**

1. All the fire safety arrangement provided there-in shall be maintained in good working conditions at all times.
2. Loss of life or property due to non functional fire safety measure shall be at the responsibility of the management.
3. The trained fire fighting staff should be available round the clock.
4. Any deviation with regard to the construction etc shall be verified by the concerned building sanctioning agency.
5. This certificate cannot be treated in any case for regularizations of unauthorized construction.
6. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director of Form's' [sub rule (1) of rule 37] along with a copy of this Certificate, six months prior to its expiry".
7. The owner / occupier shall submit a declaration every year in form "K" provided in the first schedule of Delhi Fire Service Rules 2010. The form "K" is available on [http://www.delhi.gov.in/wps/wcm/connect/doit\\_fire/FIRE/Home/Fire+Safety+Acts+and+Rule s/](http://www.delhi.gov.in/wps/wcm/connect/doit_fire/FIRE/Home/Fire+Safety+Acts+and+Rule+s/) [http://www.delhi.gov.in/wps/wcm/connect/doit\\_fire/FIRE/Home/Forms](http://www.delhi.gov.in/wps/wcm/connect/doit_fire/FIRE/Home/Forms)

## INSPECTION REPORT

1. Name & address of the building : Govt. Girl Senior Secondary School, BC-Block, Sultan Puri, Delhi-86.
2. Type of Occupancy : Educational
3. Type of Case : Renewal **3Blocks, Gr.+1 & Gr.+ 03 upper floor , 01 hall**
4. Details of Previous NOC : F.6/DFS/MS/2019/WZ/114 dated 16.01.2019 (Gr.+3)  
F.6/DFS/MS/School/2017/WZ/1298 dated 28.08.2017 (Gr.+ 01)
5. Fire Safety directives letter No : NBC Part-IV & Director of Education Cir. dated 01.03.2011
6. Date of inspection : 09.09.2021
7. Name of Inspecting Officer : A.K.Sharma ADO(Rohini)
8. Name and designation of officers  
From the building side : Smt. Anita Dixit (Head of school)
9. Year of Construction :
10. Applicant's letter No. : Online e-mail dated 18.03.2021


S. No.	Minimum Standards on fire prevention and fire safety U/R 33	NBC Requirement	Provided at site	Remarks MR/NMR
<b>1.</b>	<b>Access to building</b>			
	<ul style="list-style-type: none"> <li>• Road width</li> <li>• Gate width</li> <li>• Width of internal road</li> </ul>	<ul style="list-style-type: none"> <li>Accessible</li> <li>Accessible</li> <li>NA</li> </ul>	<ul style="list-style-type: none"> <li>Accessible</li> <li>4.5m</li> <li>NA</li> </ul>	<ul style="list-style-type: none"> <li>MR</li> <li>MR</li> <li>NA</li> </ul>
<b>2.</b>	<b>Number, Width, Type &amp; Arrangement of Exits</b>			
	a. Number of staircases			
	<ul style="list-style-type: none"> <li>• Upper Floors</li> <li>• Basements</li> </ul>	<ul style="list-style-type: none"> <li>Gr.+3 Blk-04</li> <li>Gr.+1 Blk-02</li> <li>NA</li> </ul>	<ul style="list-style-type: none"> <li>Gr.+3 Blk-05</li> <li>Gr.+1 Blk-02</li> <li>NA</li> </ul>	<ul style="list-style-type: none"> <li>MR</li> <li>MR</li> <li>NA</li> </ul>
	b. Width of staircases			
	<ul style="list-style-type: none"> <li>• Upper Floor</li> <li>• Basements</li> </ul>	<ul style="list-style-type: none"> <li>Gr.+3 Blk-1.5m</li> <li>Gr.+1 Blk-1.5m</li> </ul>	<ul style="list-style-type: none"> <li>5 x 1.70m &amp;</li> <li>2 x 1.50m</li> </ul>	<ul style="list-style-type: none"> <li>MR</li> <li>MR</li> </ul>
	c. Protection of exits			
	Fire check door			
	<ul style="list-style-type: none"> <li>• Pressurization</li> </ul>	<ul style="list-style-type: none"> <li>NA</li> </ul>	<ul style="list-style-type: none"> <li>NA</li> </ul>	<ul style="list-style-type: none"> <li>NA</li> </ul>
	d. No. of continuous staircases to terrace	<ul style="list-style-type: none"> <li>NA</li> </ul>	<ul style="list-style-type: none"> <li>NA</li> </ul>	<ul style="list-style-type: none"> <li>NA</li> </ul>
	e. Width of Corridor	<ul style="list-style-type: none"> <li>NA</li> </ul>	<ul style="list-style-type: none"> <li>NA</li> </ul>	<ul style="list-style-type: none"> <li>NA</li> </ul>
	f. Door Size	<ul style="list-style-type: none"> <li>01</li> <li>Required</li> <li>NA</li> </ul>	<ul style="list-style-type: none"> <li>02</li> <li>Provided</li> <li>NA</li> </ul>	<ul style="list-style-type: none"> <li>MR</li> <li>MR</li> <li>NA</li> </ul>
<b>3.</b>	<b>Compartmentation</b>			
	<ul style="list-style-type: none"> <li>• Fire check door</li> <li>• Sealing of electrical shafts</li> <li>• Fire Rating of shaft door</li> <li>• Water Curtain</li> <li>• Fire Dampers</li> </ul>	<ul style="list-style-type: none"> <li>NA</li> <li>NA</li> <li>NA</li> <li>NA</li> <li>NA</li> </ul>	<ul style="list-style-type: none"> <li>NA</li> <li>NA</li> <li>NA</li> <li>NA</li> <li>NA</li> </ul>	<ul style="list-style-type: none"> <li>NA</li> <li>NA</li> <li>NA</li> <li>NA</li> <li>NA</li> </ul>
<b>4.</b>	<b>Smoke Management System</b>			
	<ul style="list-style-type: none"> <li>• Basements</li> </ul>	30 a/c per hour	NA	NA
	<ul style="list-style-type: none"> <li>• Upper floors</li> </ul>	12 a/c per hour	Natural ventilated	MR
<b>5.</b>	<b>Fire Extinguishers</b>			
	<ul style="list-style-type: none"> <li>• Total numbers</li> <li>• Types</li> <li>• IS marking</li> </ul>	<ul style="list-style-type: none"> <li>36nos.</li> <li>ABC/CO2</li> <li>ISI marked</li> </ul>	<ul style="list-style-type: none"> <li>60nos.</li> <li>ABC-40/CO2-20</li> <li>Yes</li> </ul>	<ul style="list-style-type: none"> <li>MR</li> <li>MR</li> <li>MR</li> </ul>
<b>6.</b>	<b>First-Aid Hose Reels</b>			
	<ul style="list-style-type: none"> <li>• Total numbers on each floor</li> <li>• Length of hose reel hose</li> <li>• Nozzle diameter</li> </ul>	<ul style="list-style-type: none"> <li>02</li> <li>30mm</li> <li>5m</li> </ul>	<ul style="list-style-type: none"> <li>Provided</li> <li>Provided</li> <li>Provided</li> </ul>	<ul style="list-style-type: none"> <li>MR</li> <li>MR</li> <li>MR</li> </ul>
<b>7.</b>	<b>Automatic fire detection and alarming system</b>			
	<ul style="list-style-type: none"> <li>• Type of detectors</li> <li>• Location of Main Panel</li> </ul>	<ul style="list-style-type: none"> <li>NA</li> <li>NA</li> </ul>	<ul style="list-style-type: none"> <li>NA</li> <li>NA</li> </ul>	<ul style="list-style-type: none"> <li>NA</li> <li>NA</li> </ul>




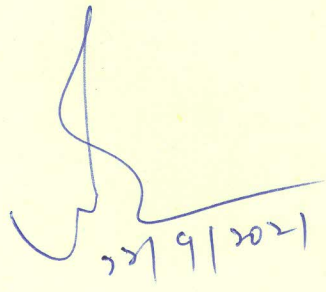
• Battery backup • Building Floor Plans	NA	NA	NA
	NA	NA	NA
10. Special Fire Protection System for Protection of special Risks, if any:	NA	NA	NA

The fire protection systems provided in the building were test checked and found functional at the time of inspection.

In view of the deemed compliance of the minimum standards of the fire prevention and fire safety measures as required under the rules the NOC issued vide letter no. F.6/DFS/MS/2019/WZ/114 dated 16.01.2019 (Gr.+3) & F.6/DFS/MS/School/2017/WZ/1298 dated 28.08.2017 (Gr.+1) is recommended for renewal under rule 37 of the Delhi Fire Service rules 2010.

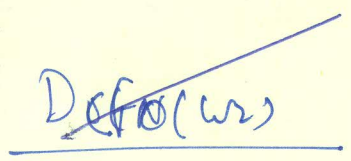
  
 Signature of the Inspecting Officer  
 Name Ajay Kumar Sharma  
 Designation ADO(Rohini)


DO (NW) - en nr  



  
 27/9/2021

ADO Rohini

FT letter is put up for kind  
 perusal and signature please.



  
 27/9/2021

  
 23/9/21

ms/elf