

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEAD QUARTERS: DELHI FIRE SERVICE, CONNAUGHT PLACE
NEW DELHI

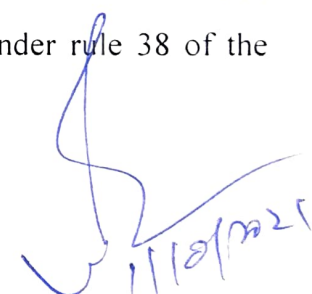
No. F6/DFS/MS/WZ/2021/ 480

Dated: 01/10/2021

FIRE SAFETY CERTIFICATE

Certified that the M/s. JVS Pharma Co. Located at A-108, Wazipur Industrial Area, New Delhi-110052 is running at Ground & First Floor in a building comprised of Basement + Ground + 02 Upper Floor was issued Fire Safety Certificate by this department vide letter No. F5/(3)/DFS/2010/260 Dated-26/08/2010. The said premises was re inspected by the officer concerned of this department on 24.09.2021 in the presence of Sh. Jitin Jot Singh (Director) & Sh. Manik Singh (Manager) and found that the premises have deemed complied with the fire prevention and fire safety requirements in accordance with rule 33 of the Delhi Fire Service Rule, 2010 and that the building/premises is fit for occupancy class "Industrial" Group G (for Ground & First Floor) with effect from 01/10/2021 for a period of three years in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules, 2010, printed overleaf.

Issued on 01/10/2021 at New Delhi by.


(Dharampal Bhardwaj)
Dy. Chief Fire Officer
(West Zone)

Copy to: -

1. Sh. Inderjeet Kaur, M/s. JVS Pharma Co., A-108, Wazipur Industrial Area, New Delhi-110052.
2. The Dy. Drug Controller, GNCT of Delhi, F-17, Karkardooma, 4th Floor, Shahdara, Delhi-110032.

Following Fire Safety Directive must be adhered to :-

1. All the means of escape shall be kept free of all type of obstruction all the time.
2. All the employees shall be acquainted with the use and maintenance of all fire equipments and method of smooth and speedy safe evacuation of occupants in case of emergency.
3. All the fire fighting equipments shall be maintained in perfect working condition all the time and any lapse rendering non-functional if fire safety measures, management shall be responsible.
4. Any deviation, with regards to construction, ventilation, occupation, electric load etc. shall be reported to the concerned authority for its approval.
5. The Fire Safety Certificate may not be treated in any case for regularizations of unauthorized construction / unauthorized use of land if any.
6. All comments / directions of licensing Department shall always be permitted and followed.
7. The owner / occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rule 2010. The form is available on www.dfs.delhigovt.nic.in
8. The owner / occupier shall apply for renewal of this Fire Safety Certificate to the Director in 'Form J' (sub Rule (1) of Rule 37) along with copy of the certificate, six months prior to its expiry.
9. Smoking, Cooking & dwelling shall not be allowed in the licensed premises
10. No naked flame shall be brought in the premises.
11. The employee shall wear rubber sole shoes in the mfg. area.
12. The Management of JVS Pharma Co. submitted an undertaking that they will not use basement. If the same is used by the management FSC will be null & void.

M/B

INSPECTION REPORT

1. Name & address of the building: **M/s. JVS Pharma Co. Located at A-108, Wazirpur Industrial Area, Delhi-110052.**
2. Type of Occupancy : **Industry, Ground + 01 Upper Floor having Plot area 350 m²** (In a building comprised of Basement + Ground + 02 Upper Floors)
3. Type of Case : **Renewal**
4. Details of previous NOC : **F5/(3)/DFS/2010/260 Dated-26/08/2010**
5. Fire Safety directives Letter No : **Nil**
6. Date of inspection : **24/09/2020**
7. Name of the Inspecting Officer : **S.P. Bhardwaj, ADO (WP)**
8. Name and designation of Officer
from the building side : **Sh. Jitin jot Singh (Director) & Sh. Manik Singh (Manager)**
9. Year of Construction : **2006**
10. Applicant's letter No. : **email dated 08.09.2021**

S No	Minimum standards on fire prevention and fire safety U/R 33	BBL Requirements/letter dated 26.08.2010	Provided at site	Remarks MR/NMR
1.	Access of building			
	<ul style="list-style-type: none"> • Road width • Gate width • Width of internal road 	<ul style="list-style-type: none"> 06 mtrs. 5m NA 	<ul style="list-style-type: none"> 60 mtrs. Provided NA 	<ul style="list-style-type: none"> MR MR NA
2.	Number, width, Type & Arrangements of exits			
	<ul style="list-style-type: none"> a. Number of staircases • Upper floors • Basements b. Width of staircases • Upper floors • Basements c. Protection of exits • Fire check door • Pressurization d. No of continuous staircase to terrace e. Width Of Corridor f. Door Size 	<ul style="list-style-type: none"> 2 2 Old case NA Required NA 01 NA Old Case 	<ul style="list-style-type: none"> Provided Provided 1.10 m (up to 1st Floor) & 1.20 m up to Second floor/Terrace NA Provided at basement NA Provided NA Provided 01 mtr 	<ul style="list-style-type: none"> MR MR MR (old case) NA MR NA MR NA MR being old case
3.	Compartmentation			
	<ul style="list-style-type: none"> • Fire check door • Sealing of electrical shafts • Fire Rating of shaft door • Water Curtain • Fire Dampers 	<ul style="list-style-type: none"> Required NA NA NA NA 	<ul style="list-style-type: none"> Provided at basement NA NA NA NA 	<ul style="list-style-type: none"> MR NA NA NA NA
4.	Smoke managements System			
	<ul style="list-style-type: none"> • Basements • Upper floors 	<ul style="list-style-type: none"> Required NA 	<ul style="list-style-type: none"> Provided NA 	<ul style="list-style-type: none"> MR NA
5.	Fire Extinguishers			
	<ul style="list-style-type: none"> • Total numbers • Types • IS marking 	<ul style="list-style-type: none"> 08 nos. ABC & CO₂ ISI marked 	<ul style="list-style-type: none"> provided provided Provided 	<ul style="list-style-type: none"> MR MR MR

NF 14			
6.	First – Aid Hose Reels		
	• Total numbers on each floor	1	provided MR
	• Length of hose reel hose	30 mtrs.	provided MR
	• Nozzle diameter	5mm	provided MR
7.	Automatic fire detection and alarming system		
	• Type of detectors	NA	NA NA
	• Location of Main Panel	NA	NA NA
	• Location of Repeater Panel	NA	NA NA
	• Alternate source of power	NA	NA NA
	• Hooters' Location	NA	NA NA
8.	MOEFA	NA	Provided NA
9.	Public Address System	NA	NA NA
10.	Automatic Sprinkler System		
	• Basements	Required	Provided MR
	• Upper Floor	Required	Provided MR
	• Sprinkler above false ceiling	NA	NA NA
11.	Internal Hydrants:		
	• Size of riser/down- comer	100 mm	Provided MR
	• Number of hydrants per floor	01	Provided MR
	• Hose Box	01	Provided MR
12.	Yard Hydrants		
	• Total number of hydrants	Required	provided MR
	• Hose Box	Required	provided MR
13.	Pumping Arrangements:		
	• Ground Level		
	• Discharge of main pump	NA	NA NA
	➤ Head of main pump	NA	NA NA
	➤ Number of main pumps	NA	NA NA
	➤ Jockey pump out put	NA	NA NA
	➤ Jockey pump head	NA	NA NA
	➤ Standby Pump out put	NA	NA NA
	➤ Standby Pump Head	NA	NA NA
	➤ Auto Staring/Manual stopping	NA	NA NA
	➤ Pump House Access	NA	NA NA
	• Terrace level		
	➤ Discharge of pump	450 lpm & 180 lpm	Provided MR
	➤ Head of the pump	40m	Provided MR
	➤ Power supply	Required	Provided MR
	➤ Auto starting of pump	Required	Provided MR
14.	Captive water Storage for firefighting:		
	• Underground tank capacity	NA	NA NA
	➤ Draw off connection	NA	NA NA
	➤ Fire service inlet	NA	NA NA
	➤ Access to tank	NA	NA NA
	• Overhead Tank capacity	10000 ltrs	Provided MR
15.	Exit Signage	Required	Provided MR
16.	Provision of Lifts		
	➤ Pressurization of Lift Shaft	NA	NA NA
	➤ Pressurization of lift lobby	NA	NA NA
	➤ Communication in lift Car	NA	NA NA
	➤ Fireman's Grounding Switch	NA	NA NA
	➤ Lift Signage	NA	NA NA
17.	Standby power supply	Required	provided MR
18.	Refuge Area		
	➤ Total area	NA	NA NA
	➤ Location	NA	NA NA

19.	Fire control room	NA	NA	NA
	➤ Detector system panel	NA	NA	NA
	➤ Flow Switch Panel	NA	NA	NA
	➤ PA System Panel	NA	NA	NA
	➤ Battery backup	NA	NA	NA
	➤ Building Floor Plans	Required	provided	MR
20.	Special Fire Protection Systems for Protection of special Risks, if any;	Required	ABC type fire Ext. provided near electrical panel	MR

The fire protection systems provided in the building were checked and found functional at the time of inspection. The Shortcomings vide letter no. F6/DFS/MS/2021/COS/1229 dated 25.06.2021 found rectified.

Note: - Renewal of FSC for Second Floor will be applied separately, as separate NOC was issued vide letter no. F.5/(3)/DFS/2007/318 dated 26.07.2007.

Keeping in view the deemed compliance of the minimum standards on fire prevention and fire safety requirements under the rules, renewal of FSC issued vide letter no. F5(3)/DFS/2010/260 Dated-26/08/2010 is recommended for **Ground & First Floor** under rule 37 of the Delhi Fire Service Rules, 2010 under the DFS Act 2007.

~~DO/wert~~

S.P. Bhardwaj, ADO (WP)
28/8/21

~~dy~~
28/9/2021

227
28/09/21

~~Defo (wz)~~

~~[Signature]~~
30/9/2021

~~AA/for P~~

FT is put up for signature

~~Defo wz~~

~~[Signature]~~
11/10/21

~~[Signature]~~
30/9/21

at 28/9